



Action Cancer Hospital

World-class Care



Date: 05.11.2024

To,

The Director
Integrated Regional Office
Ministry of Environment & Forest
A-209&218, Aranya Bhawan, Mahatma Gandhi Road,
Jhalana Institutional Area, Jaipur-304002

Subject: Submission of six-monthly EC Compliance report for the Period 1st April 2024 – 30th September 2024 of "Action Cancer Hospital" at A-4, Paschim Vihar, Near Paschim Vihar East Metro Station, New Delhi by M/s Manav Sevarth Trust.

Reference: EC Lr. No.: F.No.21-8/2019-1A-III; **Dated:** 06/08/2019

Dear Sir,

This is with reference to the above-mentioned subject, we are hereby submitting six-monthly EC Compliance Report for the period 1st April 2024 – 30th September 2024 for "Action Cancer Hospital" at A-4, Paschim Vihar, Near Paschim Vihar East Metro Station, New Delhi by M/s Manav Sevarth Trust along with the necessary annexure for your kind perusal. We understand that the above is in line with requirement of Ministry of Environment, Forest and Climate Change.

Thanking You,

Yours Sincerely,

For M/s Manav Sevarth Trust

(Authorized Signatory)

Copy to: 1. Member Secretary, Delhi Pollution Control Board (DPCC), ISBT Building Kashmere Gate, Delhi, 110006

2. Member Secretary, SEIAA, Delhi, 5th Floor, ISBT Building Kashmere Gate, Delhi, 110006
H-2/FC-34, A-4, Paschim Vihar, New Delhi-110063
Tel.: 011-49-222-222

E-mail: info@actioncancerhospital.com, Website: www.actioncancerhospital.com

A UNIT OF MANAV SEVARTH TRUST

M/s Manav Sevarth Trust

COMPLIANCE REPORT
of

**Expansion of "Action Cancer Hospital"
at A-4, Paschim Vihar, Near Paschim
Vihar East Metro Station, New Delhi**

SUBMITTED BY

M/s Manav Sevarth Trust

1st April 2024 To 30th September 2024

**Expansion of "Action Cancer Hospital" at A-4, Paschim Vihar, Near Paschim Vihar East
Metro Station, New Delhi by M/s Manav Sevarth Trust**

COMPLIANCE REPORT DECEMBER 2024

For Compliance of environmental clearance conditions as mentioned in the Environmental Clearance Letter issue File.No.21-8/2019-1A-III Dated: 6th August, 2019, for Construction and Operation phases of the Project (Annexure-I).

PART A- SPECIFIC CONDITIONS		
S. No.	CONDITIONS	COMPLIANCE
i	Consent to Establish/Operate for the project shall be obtained from the State Pollution Control Board as required under the Air (Prevention and Control of Pollution) Act, 1981 and the Water (Prevention and Control of Pollution) Act, 1974.	Consent to Establish application for Expansion has been obtained from DPCC. A copy of "Consent to Establish" for 270 Beds vide Lr. No.: DPCC/CMC/2021/5803079 dated 20.04.2022 A copy of the CTE is enclosed in Annexure II. Consent to Operate for 130 Beds has been obtained from DPCC. A copy of "Consent to Operate" vide Lr. No.: DPCC/CMC/2021/6762004 dated: 20.04.2022 A copy of the CTO is included in Annexure III.
ii	The project proponent shall provide for adequate fire safety measures and equipment as per National Building Code/required by Fire Service Act of the State and instructions issued by the local Authority/Directorate of fire, from time to time. Further, the project proponent shall take necessary permission/NOC regarding fire safety from Competent Authority as required.	Adequate fire safety measures and equipment will be provided as per the National Building Code/required by the Fire Service Act of the State and instructions issued by the local authority/directorate of fire from time to time. A copy of the Fire NOC is attached as Annexure IV .
iii	The project proponent shall obtain all necessary clearance/ permission from all relevant agencies including town planning authority before commencement of work. All the construction shall be done in accordance with the local building byelaws.	Complied. Project proponent have obtained following necessary clearance: 1. EC Letter 2. CTC 3. CTO 4. Fire NOC A copy of the necessary clearance is attached as Annexure I, II, III and IV .
iv	As proposed, fresh water requirement from Delhi Jal Board shall not exceed 54 KLD for which project proponent has already connection for the existing Hospital. Existing water supply is sufficient to cater the future demand and no additional water is required for the proposed project.	The project proponent has already connected to the existing hospital. Existing water supply is sufficient to cater to future demand, and no additional water is required for the proposed project. A copy of the water bills from the Delhi Jal Board is enclosed as Annexure-V .

**Expansion of "Action Cancer Hospital" at A-4, Paschim Vihar, Near Paschim Vihar East
Metro Station, New Delhi by M/s Manav Sevarth Trust**

v	<p>Sewage shall be treated in the STP based on MBBR Technology with tertiary treatment i.e. Ultra-Filtration. The treated effluent from STP shall be recycled/re-used for flushing, gardening, & HVAC cooling purposes. No excess treated water from STP shall be discharged to municipal drain.</p>	<p>Sewage is treated in the STP based on MBBR Technology with tertiary treatment, i.e., ultrafiltration with 600 KLD capacity. STP Logbook is Attached as Annexure VI. A photograph of STP is attached as Annexure VII.</p> <p>STP treated water is used only for flushing and gardening purposes. No excess treated water from STP is discharged to municipal drains without prior permission from competent authority.</p>
vi	<p>The project proponents would devise a monitoring plan to the satisfaction of the State Pollution Control Board so as to continuously monitor the treated waste water being used for flushing in terms of faecal coliforms and other pathogenic bacteria.</p>	<p>Noted & Agreed.</p> <p>Water quality monitoring report of STP is enclosed at Annexure-VIII.</p>
vii	<p>The project proponents would commission a third party study on the implementation of conditions related to quality and quantity of recycle and reuse of treated water, efficiency of treatment systems, quality of treated water being supplied for flushing (specially the bacterial counts), comparative bacteriological studies from toilet seats using recycled treated waters and fresh waters for flushing, and quality of water being supplied through spray faucets attached to toilet seats.</p>	<p>Noted and agreed.</p> <p>The quality of treated water was monitored & found to be within the prescribed standards of SPCB/CPCB. The water quality monitoring report is enclosed in Annexure-VIII.</p>
viii	<p>The local bye-law provisions on rain water harvesting should be followed. If local bye-law provision is not available, adequate provision for storage and recharge should be followed as per the Ministry of Urban Development Model Building Byelaws, 2016. As proposed 2 nos. of rain water harvesting recharge pits shall be provided for rain water harvesting after filtration as per CGWB guidelines.</p>	<p>Agreed.</p> <p>Rain water harvesting pit are provided per the Ministry of Urban Development Model Building Byelaws, 2016.</p> <p>Photograph of Existing Rain water harvesting pit is attached as Annexure-IX.</p>
ix	<p>Separate wet and dry bins must be provided in each unit and at the ground level for facilitating segregation of waste. Solid waste shall be segregated into wet garbage and inert materials. Wet garbage shall be composted in Organic Waste Converter. Adequate area shall be provided for solid waste management within</p>	<p>Separate wet and dry bins are provided, and solid waste generated shall be disposed of as per Solid Waste Management Rules, 2016.</p> <p>A photograph of separate wet and dry bins is attached as Annexure-X.</p>

**Expansion of "Action Cancer Hospital" at A-4, Paschim Vihar, Near Paschim Vihar East
Metro Station, New Delhi by M/s Manav Sevarth Trust**

	the premises which will include area for segregation, composting. The inert waste from project will be sent to dumping site.	
x	Laboratory wastes shall be managed in accordance to the BMW Rules, 2016 and the atomic Energy Commission regulations as applicable.	<p>Agreed.</p> <p>Laboratory wastes will be managed in accordance with the BMW Rules, 2016. An agreement has been made with M/s SMS Water Grace BMW Pvt. Ltd. for proper disposal of BMW.</p> <p>A copy of the authorization & agreement for BMW management is enclosed as Annexure-XI.</p>
xi	Traffic Management Plan as submitted shall be implemented in letter and spirit. Further, a detailed traffic management and traffic decongestion plan shall be drawn up to ensure that the current level of service of the roads within a 05 kms radius of the project is maintained and improved upon after the implementation of the project. This plan should be based on cumulative impact of all development and increased habitation being carried out or proposed to be carried out by the project or other agencies in this 05 Kms radius of the site in different scenarios of space and time and the traffic management plan shall be duly validated and certified by the State Urban Development department and the P.W.D./competent authority for road augmentation and shall also have their consent to the implementation of components of the plan which involve the participation of these departments.	<p>Noted the condition.</p> <p>Traffic circulation plan is attached as Annexure-XII.</p>
xii	No tree cutting/transplantation of existing trees has been proposed in the instant project. A minimum of 1 tree for every 80 sqm of land should be planted and maintained. The existing trees will be counted for this purpose. The landscape planning should include plantation of native species. The species with heavy foliage, broad leaves and wide canopy cover are desirable. Water intensive and/or invasive species should not be used for landscaping. As	<p>Agreed.</p> <p>Green belt development plan is enclosed as Annexure-XIII.</p> <p>Photographs of Greenbelt Development Area is enclosed as Annexure-XIV.</p>

**Expansion of "Action Cancer Hospital" at A-4, Paschim Vihar, Near Paschim Vihar East
Metro Station, New Delhi by M/s Manav Sevarth Trust**

	proposed 2,255.879 sqm (22.60% of total area) area shall be provided for green area development.	
xiii	As per the Ministry's Office Memorandum F.No. 22-65/2017-IA.III dated 1 st May 2018, and proposed by the project proponent, an amount of Rs. 0.5 Crores (1.0% of the project cost) shall be earmarked under Corporate Environment Responsibility (CER) for the activities such as clean drinking water, skill development etc. The activities proposed under CER shall be restricted to the affected area around the project. The entire activities proposed under the CER shall be treated as project and shall be monitored. The monitoring report shall be submitted to the regional office as a part of half yearly compliance report, and to the District Collector. It should be posted on the website of the project proponent.	Detailed CER Budget with activities is enclosed as Annexure XV .

PART B- STANDARD CONDITIONS

I. Statutory Compliance

i	The project proponent shall obtain all necessary clearance/ permission from all relevant agencies including town planning authority before commencement of work. All the construction shall be done in accordance with the local building byelaws.	Agreed. Environmental clearance has been granted to the project vide ministry letter No. F. No. 21-8/2019-IA-III, dated 06/08/2019 (Annexure 1). A copy of land documents is enclosed in Annexure XVI . Consent to Establish for expansion has been obtained. A copy of the CTE is enclosed as Annexure II . Consent to Operate for 130 Beds has been obtained from DPCC. A copy of "Consent to Operate" vide Lr. No.: DPCC/CMC/2021/6762004 dated: 20.04.2022 A copy of the CTO is included in Annexure III .
ii	The approval of the Competent Authority shall be obtained for structural safety of buildings due to earthquakes, adequacy of firefighting equipment etc as per National Building Code including protection measures from lightning etc.	Agreed and Noted This Condition. A copy of the Fire NOC is attached as Annexure IV .

**Expansion of "Action Cancer Hospital" at A-4, Paschim Vihar, Near Paschim Vihar East
Metro Station, New Delhi by M/s Manav Sevarth Trust**

iii	The project proponent shall obtain the necessary permission for drawl of ground water / surface water required for the project from the competent authority.	Water connection has been taken from Delhi Jal Board. A copy of the water bills is enclosed as Annexure-V .
iv	A certificate of adequacy of available power from the agency supplying power to the project along with the load allowed for the project should be obtained.	The approval from the power department has been obtained for power usage with the applicable load. A copy of electricity bills is enclosed as Annexure-XVII .
v	All other statutory clearances such as the approvals for storage of diesel from Chief Controller of Explosives, Fire Department, Civil Aviation Department shall be obtained, as applicable, by project proponents from the respective competent authorities.	Agreed and noted this condition. A copy of the Fire NOC is attached as Annexure IV .
vi	The provisions of the Solid Waste Management Rules, 2016, e-Waste (Management) Rules, 2016, and the Plastics Waste Management Rules, 2016, shall be followed.	Agreed. Solid waste is being managed as per Solid Waste Management Rules, 2016. E-Waste is being managed as per e-Waste (Management) Rules, 2016. Plastic Waste is being managed as per Plastics Waste Management Rules, 2016.
vii	The project proponent shall follow the ECBC/ECBC-R prescribed by Bureau of Energy Efficiency, Ministry of Power strictly.	Noted. This condition will be complied.

II. Air quality monitoring and preservation

i	Notification GSR 94(E) dated 25.01.2018 of MoEF&CC regarding Mandatory Implementation of Dust Mitigation Measures for Construction and Demolition Activities for projects requiring Environmental Clearance shall be complied with.	Agreed. This condition is being complied. We have also registered our project on Dust Pollution Control Self-Assessment, DPCC.
ii	A management plan shall be drawn up and implemented to contain the current exceedance in ambient air quality at the site.	Agreed.
iii	The project proponent shall install system to carryout Ambient Air Quality monitoring for common/criterion parameters relevant to the main pollutants released (e.g. PM10 and PM25) covering upwind and downwind directions during the construction period.	PM10 and PM 2.5 sensor is installed at project site to monitor ambient air quality. Photograph of sensor is attached as Annexure-XXI .

**Expansion of "Action Cancer Hospital" at A-4, Paschim Vihar, Near Paschim Vihar East
Metro Station, New Delhi by M/s Manav Sevarth Trust**

iv	<p>Diesel power generating sets proposed as source of backup power should be of enclosed type and conform to rules made under the Environment (Protection) Act, 1986. The height of stack of DG sets should be equal to the height needed for the combined capacity of all proposed DG sets. Use of low sulphur diesel. The location of the DG sets may be decided with in consultation with State Pollution Control Board.</p>	<p>DG sets will be enclosed type and conform to rules as per Environment (Protection) Act, 1986.</p> <p>The height of the stack of DG sets will be maintained as per the norms proposed for DG sets.</p> <p>Low Sulphur diesel shall be used.</p> <p>A photograph of DG Set (existing) is attached as Annexure XVIII.</p>
v	<p>Construction site shall be adequately barricaded before the construction begins. Dust, smoke & other air pollution prevention measures shall be provided for the building as well as the site. These measures shall include screens for the building under construction, continuous dust/wind breaking walls all around the site (at least 3 meter height). Plastic/tarpaulin sheet covers shall be provided for vehicles bringing in sand, cement, murram and other construction materials prone to causing dust pollution at the site as well as taking out debris from the site</p>	<p>Complied.</p> <p>In order to control dust pollution, water sprinkling happen at the construction site.</p> <p>Photographs of water sprinkling and anti-smog gun is attached as Annexure- XIX</p> <p>Photograph of wind breaking wall is attached as Annexure-XX</p>
vi	<p>Sand, murram, loose soil, cement, stored on site shall be covered adequately so as to prevent dust pollution.</p>	<p>Noted the condition.</p> <p>The Building material to be used for construction activity is being kept under covered.</p> <p>Photographs of covered material with Green net is attached as Annexure XXI.</p>
vii	<p>Wet jet shall be provided for grinding and stone cutting.</p>	<p>Noted the condition.</p>
viii	<p>Unpaved surfaces and loose soil shall be adequately sprinkled with water to suppress dust.</p>	<p>Dust is being suppressed through water sprinkling.</p> <p>Photographs of water sprinkling and anti-smog gun is attached as Annexure- XIX</p>
ix	<p>All construction and demolition debris shall be stored at the site (and not dumped on the roads or open spaces outside) before they are properly disposed. All demolition and construction waste shall be managed as per the provisions of the Construction and Demolition Waste Management Rules 2016.</p>	<p>All construction and demolition waste will be disposed of as per the provisions of the Construction and Demolition Waste Management Rules, 2016.</p>

**Expansion of "Action Cancer Hospital" at A-4, Paschim Vihar, Near Paschim Vihar East
Metro Station, New Delhi by M/s Manav Sevarth Trust**

x	The diesel generator sets to be used during construction phase shall be low sulphur diesel type and shall conform to Environmental (Protection) prescribed for air and noise emission standards.	Noted, The low Sulphur diesel type DG sets used.
xi	The gaseous emissions from DG set shall be dispersed through adequate stack height as per CPCB standards. Acoustic enclosure shall be provided to the DG sets to mitigate the noise pollution. Low sulphur diesel shall be used. The location of the DG set and exhaust pipe height shall be as per the provisions of the Central Pollution Control Board (CPCB) norms.	Noted and Agreed
xii	For indoor air quality the ventilation provisions as per National Building Code of India.	Ventilation provisions will be provided as per National Building Code of India.

III. Water Quality Monitoring and Preservation

i	The natural drain system should be maintained for ensuring unrestricted flow of water. No construction shall be allowed to obstruct the natural drainage through the site, on wetland and water bodies. Check dams, bio-swales, landscape, and other sustainable urban drainage systems (SUDS) are allowed for maintaining the drainage pattern and to harvest rain water.	Agreed. No construction is obstructing the natural drainage through the site.
ii	Buildings shall be designed to follow the natural topography as much as possible. Minimum cutting and filling should be done.	Noted the condition. The Natural Topography of the project site will not disturb.
iii	The quantity of fresh water usage, water recycling and rainwater harvesting shall be measured and recorded to monitor the water balance as projected by the project proponent. The record shall be submitted to the Regional Office, MoEF&CC along with six monthly Monitoring reports.	Agreed. The drinking water monitoring report is attached as Annexure-VIII .

**Expansion of "Action Cancer Hospital" at A-4, Paschim Vihar, Near Paschim Vihar East
Metro Station, New Delhi by M/s Manav Sevarth Trust**

iv	A certificate shall be obtained from the local body supplying water, specifying the total annual water availability with the local authority, the quantity of water already committed the quantity of water allotted to the project under consideration and the balance water available. This should be specified separately for ground water and surface water sources, ensuring that there is no impact on other users.	Water connection have obtained from Delhi Jal board. Water bill is attached as Annexure- V
v	At least 20% of the open spaces as required by the local building bye-laws shall be pervious. Use of Grass pavers, paver blocks with at least 50% opening, landscape etc. would be considered as pervious surface.	Noted and Agreed
vi	Installation of dual pipe plumbing for supplying fresh water for drinking, cooking and bathing etc and other for supply of recycled water for flushing, landscape irrigation, car washing, thermal cooling, conditioning etc. shall be done.	Noted & Agreed.
vii	Use of water saving devices/ fixtures (viz. low flow flushing systems; use of low flow faucets tap aerators etc) for water conservation shall be incorporated in the building plan.	Noted. Use of water saving devices/low-flow fixtures will be incorporated in the operational phase of the project.
viii	Separation of grey and black water should be done by the use of dual plumbing system. In case of single stack system separate recirculation lines for flushing by giving dual plumbing system be done.	Provision of dual plumbing shall be provided.
ix	Water demand during construction should be reduced by use of pre-mixed concrete, curing agents and other best practices referred	Noted and agreed
x	A rain water harvesting plan needs to be designed where the recharge bores of minimum one recharge bore per 5,000 square meters of built up area and storage capacity of minimum one day of total fresh water requirement shall be provided. In areas where ground water recharge is not feasible, the rain water should be harvested and stored for reuse. The ground water shall not be withdrawn without approval	Rainwater harvesting pits are constructed as per the approved plan. A photograph of the rainwater harvesting pit is attached as Annexure IX .

**Expansion of "Action Cancer Hospital" at A-4, Paschim Vihar, Near Paschim Vihar East
Metro Station, New Delhi by M/s Manav Sevarth Trust**

	from the Competent Authority.	
xi	All recharge should be limited to shallow aquifer.	Noted the condition.
xii	No ground water shall be used during construction phase of the project.	No ground water is being used for the construction of project. STP treated water is being used for construction purpose. STP Logbook is Attached as Annexure-VI . Photograph of STP is Attached as Annexure – VII .
xiii	Any ground water dewatering should be properly managed and shall conform to the approvals and the guidelines of the CGWA in the matter. Formal approval shall be taken from the CGWA for any ground water abstraction or dewatering.	No groundwater is use at project site. Water connection have obtained from Delhi Jal Board. Water bill is attached as Annexure -V
xiv	The quantity of fresh water usage, water recycling and rainwater harvesting shall be measured and recorded to monitor the water balance as projected by the project proponent. The record shall be submitted to the Regional Office, MoEF&CC along with six monthly Monitoring reports.	Noted. Drinking water monitoring report is attached as Annexure-VIII
xv	Sewage shall be treated in the STP with tertiary treatment. The treated effluent from STP shall be recycled/re-used for flushing, AC make up water and gardening. As proposed, no treated water shall be disposed in to municipal drain.	Agreed. STP treated water is used for flushing and horticulture purposes. STP monitoring report is attached as Annexure-VIII
xvi	No sewage or untreated effluent water would be discharged through storm water drains.	Noted the condition. Separate lines for sewage or untreated effluent will be provided.
xvii	Onsite sewage treatment of capacity of treating 100% waste water to be installed. The installation of the Sewage Treatment Plant (STP) shall be certified by an independent expert and a report in this regard shall be submitted to the Ministry before the project is commissioned for operation. Treated waste water shall be reused on site for landscape, flushing, cooling tower, and other end-uses. Excess treated water shall be discharged as per statutory norms notified by Ministry of Environment, Forest and Climate	Noted and agreed. Treated waste water will be reused for landscaping, flushing, cooling towers, and other purposes. STP Logbook is Attached as Annexure VI . A photograph of STP is attached as Annexure VII .

**Expansion of "Action Cancer Hospital" at A-4, Paschim Vihar, Near Paschim Vihar East
Metro Station, New Delhi by M/s Manav Sevarth Trust**

	Change. Natural treatment systems shall be promoted.	
xviii	Periodical monitoring of water quality of treated sewage shall be conducted. Necessary measures should be made to mitigate the odour problem from STP.	Noted the condition. Periodical monitoring of water quality is being conducted report is enclosed as Annexure-VIII .
xix	Sludge from the onsite sewage treatment, including septic tanks, shall be collected, conveyed and disposed as per the Ministry of Urban Development, Central Public Health and Environmental Engineering Organization (CPHEEO) Manual on Sewerage and Sewage Treatment Systems, 2013.	Noted the condition.

IV. Noise Monitoring and Prevention

i	Ambient noise levels shall conform to residential area/commercial area/industrial area/silence zone both during day and night as per Noise Pollution (Control and Regulation) Rules, 2000. Incremental pollution loads on the ambient air and noise quality shall be closely monitored during construction phase. Adequate measures shall be made to reduce ambient air and noise level during construction phase, so as to conform to the stipulated standards by CPCB / SPCB.	Ambient air and noise quality has been monitored by an accredited lab. Monitoring report of ambient air and noise has been attached as Annexure-VIII .
ii	Noise level survey shall be carried as per the prescribed guidelines and report in this regard shall be submitted to Regional Officer of the Ministry as a part of six-monthly compliance report.	Complied. A noise monitoring report has been submitted to the regional office of the ministry with six monthly compliance reports. The result of noise monitoring is under the permissible limit. The noise monitoring report is attached as Annexure-VIII .
iii	Acoustic enclosures for DG sets, noise barriers for ground-run bays, ear plugs for operating personnel shall be implemented as mitigation measures for noise impact due to ground sources.	Noted. Acoustic enclosures has been installed in DG sets & ear plug has been provided to operator.

V. Energy Conservation Measures

**Expansion of "Action Cancer Hospital" at A-4, Paschim Vihar, Near Paschim Vihar East
Metro Station, New Delhi by M/s Manav Sevarth Trust**

i	Compliance with the Energy Conservation Building Code (ECBC) of Bureau of Energy Efficiency shall be ensured. Buildings in the States which have notified their own ECBC, shall comply with the State ECBC.	Building design and construction is in compliance with ECBC.
ii	Outdoor and common area lighting shall be LED.	LED will be installed. LED bill has been attached as Annexure XXVI
iii	Concept of passive solar design that minimize energy consumption in buildings by using design elements, such as building orientation, landscaping, efficient building envelope, appropriate fenestration, increased day lighting design and thermal mass etc. shall be incorporated in the building design. Wall, window, and roof u-values shall be as per ECBC specifications.	Noted the condition.
iv	Energy conservation measures like installation of CFLs/ LED for the lighting the area outside the building should be integral part of the project design and should be in place before project commissioning	Agreed & Noted the condition.
v	Solar, wind or other Renewable Energy shall be installed to meet electricity generation equivalent to 1% of the demand load or as per the state level/ local building bye-laws requirement, whichever is higher.	Solar, wind or other renewable energy will be installed to reduce the electricity demand once the project comes under the full operation phase of the project.
vi	Solar power shall be used for lighting in the apartment to reduce the power load on grid. Separate electric meter shall be installed for solar power. Solar water heating shall be provided to meet 20% of the hot water demand of the commercial and institutional building or as per the requirement of the local building bye-laws, whichever is higher. Residential buildings are also recommended to meet its hot water demand from solar water heaters, as far as possible.	Solar water heating system and solar inverters will be incorporated during full operational phase of the project.

VI. Waste Management

**Expansion of "Action Cancer Hospital" at A-4, Paschim Vihar, Near Paschim Vihar East
Metro Station, New Delhi by M/s Manav Sevarth Trust**

i	A certificate from the competent authority handling municipal solid wastes, indicating the existing civic capacities of handling and their adequacy to cater to the M.S.W. generated from project shall be obtained.	Noted the condition.
ii	Disposal of muck during construction phase shall not create any adverse effect on the neighbouring communities and be disposed taking the necessary precautions for general safety and health aspects of people, only in approved sites with the approval of competent authority.	Muck generated during the construction phase is being disposed of as per the C and D rules.
iii	Organic waste compost/ Vermiculture pit/ Organic Waste Converter within the premises with a minimum capacity of 0.3 kg /person/day must be installed.	Organic waste compost, vermiculture pit, and organic waste converter will be installed.
iv	All non-biodegradable waste shall be handed over to authorized recyclers for which a written tie up must be done with the authorized recyclers.	Agreed.
v	Any hazardous waste generated during construction phase, shall be disposed off as per applicable rules and norms with necessary approvals of the State Pollution Control Board.	Hazardous waste generated during construction phase & operational phase, will be disposed off as per hazardous waste management rule, 2016.
vi	Use of environment friendly materials in bricks, blocks and other construction materials, shall be required for at least 20% of the construction material quantity. These include Fly Ash bricks, hollow bricks, AACs, Fly Ash Lime Gypsum blocks, Compressed earth blocks, and other environment friendly materials.	Noted the Condition the environment friendly building materials are being used for construction purpose.
vii	Fly ash should be used as building material in the construction as per the provision of Fly Ash Notification of September, 1999 and amended as on 27 th August, 2003 and 25th January, 2016. Ready mixed concrete must be used in building construction.	Noted and agreed
viii	Any wastes from construction and demolition activities related thereto shall be managed so as to strictly conform to the Construction and Demolition Waste Management Rules, 2016.	Construction and Demolition waste will be handled as per Construction and Demolition Waste Management Rules, 2016.

**Expansion of "Action Cancer Hospital" at A-4, Paschim Vihar, Near Paschim Vihar East
Metro Station, New Delhi by M/s Manav Sevarth Trust**

ix	Used CFLs and TFLs should be properly collected and disposed off/sent for recycling as per the prevailing guidelines/ rules of the regulatory authority to avoid mercury contamination.	Noted the condition. Used CFLs and TFLs will be properly collected and disposed off as per Solid waste Management Rules, 2016.
VII. Green Cover		
i	Topsoil should be stripped to a depth of 20 cm from the areas proposed for buildings, roads, paved areas, and external services. It should be stockpiled appropriately in designated areas and reapplied during plantation of the proposed vegetation on site.	Complied. Photograph of green belt is attached as Annexure-XIV
VIII. Transport		
i	A comprehensive mobility plan, as per MoUD best practices guidelines (URDPFI), shall be prepared to include motorized, non-motorized, public, and private networks. Road should be designed with due consideration for environment, and safety of users. The road system can be designed with these basic criteria. a. Hierarchy of roads with proper segregation of vehicular and pedestrian traffic. b. Traffic calming measures. c. Proper design of entry and exit points. d. Parking norms as per local regulation.	Noted the condition.
ii	Vehicles hired for bringing construction material to the site should be in good condition and should have a pollution check certificate and should conform to applicable air and noise emission standards be operated only during nonpeak hours.	All vehicles hired for construction sites have valid PUC certificates and abide by all the rules and regulations. A copy of the valid PUC certificate is enclosed as Annexure XXIII .
IX. Human Health Issues		
i	All workers working at the construction site and involved in loading, unloading, carriage of construction material and construction debris or working in any area with dust pollution shall be provided with dust mask.	Dust mask has been provided to laborers at the construction site.
ii	For indoor air quality the ventilation provisions as per National Building Code of India.	Ventilation provisions will be provided as per the National Building Code of India.

**Expansion of "Action Cancer Hospital" at A-4, Paschim Vihar, Near Paschim Vihar East
Metro Station, New Delhi by M/s Manav Sevarth Trust**

iii	Emergency preparedness plan based on the Hazard identification and Risk Assessment (HIRA) and Disaster Management Plan shall be implemented.	Noted the Condition.
iv	Provision shall be made for the housing of construction labour within the site with all necessary infrastructure and facilities such as fuel for cooking, mobile toilets, mobile STP, safe drinking water, medical health care, crèche etc. The housing may be in the form of temporary structures to be removed after the completion of the project.	Local laborers have been procured for construction & Mobile toilets have been provided to laborers.
v	Occupational health surveillance of the workers shall be done on a regular basis.	Noted the condition.
vi	A First Aid Room shall be provided in the project both during construction and operations of the project.	Noted and Agreed.

X. Corporate Environment Responsibility

i	The company shall have a well laid down environmental policy duly approved by the Board of Directors. The environmental policy should prescribe for standard operating procedures to have proper checks and balances and to bring into focus any infringements/deviation/violation of the environmental / forest / wildlife norms/ conditions. The company shall have defined system of reporting infringements / deviation / violation of the environmental / forest /wildlife norms / conditions and / or shareholders / stakeholders. The copy of the board resolution in this regard shall be submitted to the MoEF&CC as a part of six-monthly report.	Noted the condition.
ii	A separate Environmental Cell both at the project and company head quarter level, with qualified personnel shall be set up under the control of senior Executive, who will directly report to the head of the organization.	A separate Environmental Cell as required will be made during the operational phase of the project.

**Expansion of "Action Cancer Hospital" at A-4, Paschim Vihar, Near Paschim Vihar East
Metro Station, New Delhi by M/s Manav Sevarth Trust**

iii	<p>Action plan for implementing EMP and environmental conditions along with responsibility matrix of the company shall be prepared and shall be duly approved by competent authority. The year wise funds earmarked for environmental protection measures shall be kept in separate account and not to be diverted for any other purpose. Year wise progress of implementation of action plan shall be reported to the Ministry/Regional Office along with the Six Monthly Compliance Report.</p>	<p>Noted the condition. An action plan for implementing EMP and environmental conditions, along with the responsibility matrix of the company, will be prepared and duly approved by competent authority.</p>
XI. Miscellaneous		
i	<p>The project proponent shall prominently advertise it at least in two local newspapers of the District or State, of which one shall be in the vernacular language within seven days indicating that the project has been accorded environment clearance and the details of MoEFCC/SEIAA website where it is displayed.</p>	<p>Complied. A copy of the newspaper advertisement is enclosed as Annexure XXIV.</p>
ii	<p>The copies of the environmental clearance shall be submitted by the project proponents to the Heads of local bodies, Panchayats and Municipal Bodies in addition to the relevant offices of the Government who in turn has to display the same for 30 days from the date of receipt.</p>	<p>A copy of the environmental clearance had been submitted to concerned authorities by the project proponent.</p>
iii	<p>The project proponent shall upload the status of compliance of the stipulated environment clearance conditions, including results of monitored data on their website and update the same on half-yearly basis.</p>	<p>Noted the condition.</p>
iv	<p>The project proponent shall submit six-monthly reports on the status of the compliance of the stipulated environmental conditions on the website of the ministry of Environment, Forest and Climate Change at environment clearance portal.</p>	<p>Noted the condition. We are regularly submitting the six monthly compliance reports to the regional offices of MoEF&CC & DPCC. E-Mail Receiving of Previous Compliance Report of June 2024 is attached as Annexure-XXV.</p>

**Expansion of "Action Cancer Hospital" at A-4, Paschim Vihar, Near Paschim Vihar East
Metro Station, New Delhi by M/s Manav Sevarth Trust**

v	The project proponent shall submit the environmental statement for each financial year in Form-V to the concerned State Pollution Control Board as prescribed under the Environment (Protection) Rules, 1986, as amended subsequently and put on the website of the company.	Noted and agreed
vi	The project proponent shall inform the Regional Office as well as the Ministry, the date of financial closure and final approval of the project by the concerned authorities, commencing the land development work and start of production operation by the project.	Noted the condition.
vii	The project authorities must strictly adhere to the stipulations made by the State Pollution Control Board and the State Government.	Agreed.
viii	The project proponent shall abide by all the commitments and recommendations made in the EIA/EMP report, commitment made during their presentation to the Expert Appraisal Committee.	The project proponent is abiding by all the commitments and recommendations as suggested by concerned authorities.
ix	No further expansion or modifications in the plant shall be carried out without prior approval of the Ministry of Environment, Forest and Climate Change (MoEF&CC).	Noted the condition.
x	Concealing factual data or submission of false/fabricated data may result in revocation of this environmental clearance and attract action under the provisions of Environment (Protection) Act, 1986.	Agreed and noted.
xi	The Ministry may revoke or suspend the clearance, if implementation of any of the above conditions is not satisfactory.	Agreed and Noted
xii	The Ministry reserves the right to stipulate additional conditions if found necessary. The Company in a time bound manner shall implement these conditions.	Agreed.
xiii	The Regional Office of this Ministry shall monitor compliance of the stipulated conditions. The project authorities should extend full cooperation to the officer(s) of the Regional Office by furnishing the requisite data /information/monitoring reports.	Agreed. All the officials from regional offices MoEF and CC shall be given full cooperation in conducting inspections at the site.

**Expansion of "Action Cancer Hospital" at A-4, Paschim Vihar, Near Paschim Vihar East
Metro Station, New Delhi by M/s Manav Sevarth Trust**

xiv	The above conditions shall be enforced, inter-alia under the provisions of the Water (Prevention & Control of Pollution) Act, 1974, the Air (Prevention & Control of Pollution) Act, 1981, the Environment (Protection) Act, 1986, Hazardous and Other Wastes (Management and Transboundary Movement) Rules, 2016, and the Public Liability Insurance Act, 1991 along with their amendments and Rules and any other orders passed by the Hon'ble Supreme Court of India / High Courts and any other Court of Law relating to the subject matter.	Noted the condition.
xv	Any appeal against this EC shall lie with the National Green Tribunal, if preferred, within a period of 30 days as prescribed under Section 16 of the National Green Tribunal Act, 2010.	Noted the condition.

Annexure- I

Environment Clearance letter for

Expansion

F.No.21-8/2019-IA-III
Government of India
Ministry of Environment, Forest and Climate Change
(IA.III Section)

Indira Paryavaran Bhawan,
Jor Bagh Road, New Delhi - 3

Date: 6th August, 2019

To,

Shri Ram Chandra, Trustee
M/s Manav Sevarth Trust
Manav Sevarth Trust at Facility No. 34,
Paschim Vihar, Punjabi Bagh, Delhi -110063
E-mail: satyapal@actioncancerhospital.com

Subject: Expansion of "Action Cancer Hospital" at A-4, Paschim Vihar, Near Paschim Vihar East Metro Station, New Delhi by M/s Manav Sevarth Trust - Environmental Clearance - reg.

Sir,

This has reference to your online proposal No. IA/DL/MIS/91893/2019 dated 24th January, 2019, submitted to this Ministry for grant of Environmental Clearance (EC) in terms of the provisions of the Environment Impact Assessment (EIA) Notification, 2006 under the Environment (Protection) Act, 1986.

2. The proposal for grant of environmental clearance to the project Expansion of "Action Cancer Hospital" at A-4, Paschim Vihar, Near Paschim Vihar East Metro Station, New Delhi by M/s Manav Sevarth Trust, was considered by the Expert Appraisal Committee (Infra-2) in its 39th meeting held during 26-28 March, 2019. Correction made in the minutes of 40th meeting held on 23rd April, 2019. The details of the project, as per the documents submitted by the project proponent, and also as informed during the above meeting are as under:-

- (i) The project will be located at Latitude: 28°40'26.36" N and Longitude: 77°06'41.50" E.
- (ii) The proposed project is an Expansion project. The existing hospital complex was constructed in year 2009. The built-up area of existing hospital is 9623.55 sqm, which is less than 20,000 sqm. Hence, it did not attract the provisions of EIA notification 2006. Now, due to increase in the capacity of handling of patients and increase in beds, two towers are proposed, resulting in increase in built up area. Hence, proposal for EC for Expansion of the Hospital Complex has been made.
- (iii) Total plot area of 10,000 sqm and built-up area of the project will be 33,021.717 sqm. No. of beds after expansion will be 270 and maximum height of the building will be 32.40 m. Due to increase in the capacity of handling of patients and increase in beds, in the existing complex, a new tower with MLCP will be constructed and vertical addition to existing tower will be done. Hence, 23,398.167 sqm area will be added to existing built up area of 9,623.550 sqm which will result in total Built-up area of 33,021.717 sqm after expansion. Total beds after expansion shall be increased to 270 beds (IPD Only) from existing 200 beds (IPD & OPD) & there will be addition of Hospital

J. hose

& Residential Tower, Multi-level car parking Tower, four no. of basements, atrium & Non-FAR area as well. The details are as follows:

S. No.	Particulars	Unit	Total after expansion
1.	Plot area	sqm	10,000 (1.0 Ha)
2.	Project cost	Rs.	50 Crore
3.	Permissible ground coverage	sqm	4,000.000
4.	Permissible ground coverage for parking	sqm	500.000
5.	Permissible total ground coverage for parking and hospital	sqm	4,500.000
6.	Permissible ground coverage for Atrium	sqm	1,000.00
7.	Proposed ground coverage	sqm	4,286.46
8.	Proposed ground coverage for parking	sqm	500.000
9.	Proposed ground coverage for parking and hospital	sqm	3,887.456
10.	Proposed ground coverage for atrium	sqm	399.004
11.	Permissible FAR	sqm	25000.000
12.	Proposed FAR- A	sqm	21123.831
	Hospital Block	sqm	15311.290
	Residential Block	sqm	5812.539
13.	Non-FAR- B	sqm	2,789.044
	Basement-I	sqm	2,394.633
	Basement-II	sqm	1,411.425
	Basement-III	sqm	400.232
	Basement-IV	sqm	400.232
14.	Total Basement Area-C	sqm	4,606.522
15.	Multilevel Car Parking Area (Excluding Area)-D	sqm	4,502.320
16.	Built-up Area (A+B+C+D)	sqm	33,021.717

- (iv) During construction phase, total water requirement is expected to be 5 KLD for construction purpose which will be met by treated water nearby STP. During the construction phase, soak pits and septic tanks will be provided for disposal of waste water. Temporary sanitary toilets will be provided during peak labour force.
- (v) During operational phase, total water demand of the project is expected to be 123 KLD out of which fresh water demand is 54 KLD will be met through Delhi Jal Board and tanker supply and 68 KLD of treated water from STP will be reused in flushing, gardening & DG & HVAC Cooling. The total waste water generation will be 79 KLD from Domestic and Flushing uses & 0.5 KLD from Laboratory which will be treated in STP of 600 KLD Capacity & rest 3 KLD of excess treated wastewater will be discharged into sewer line.
- (vi) After expansion, total 72 tons/annum of solid waste shall be generated from the hospital. Biodegradable waste of 43 tons/annum shall be treated in Organic waste converter within the complex and non- biodegradable waste of 14 tons/annum and recyclable waste of 14 tons/annum will be given to approved vendor. 0.19 kL/annum (16 litres/month) of used oil shall be generated. E-waste generation shall be 0.024 -0.036 tons/annum which will be given to Authorised recycler. Biomedical waste generation from beds will be 16.4 tons/annum after expansion which will be given to authorized vendor.
- (vii) The total power requirement of the complex is 500 KW which will be met by BSES. In case of power failure, power backup shall be provided through D.G sets of 1 X 750 kVA (Existing) and 1x750 kVA (Proposed). Hence to reduce the air emissions proper stack height shall be provided as per prescribed norms by CPCB.

S. Rose

- (viii) Total 2 nos. of RWH pits will be constructed to recharge the ground water (out of which 1 no. of pit is already in the hospital).
- (ix) Total Parking requirement is 358 ECS. Total parking provision will be 368 ECS.
- (x) No Eco Sensitive area lies within the 10 km radius of the project site. Hence, NBWL Clearance is not required.
- (xi) Forest Clearance is not required.
- (xii) There is no Court case pending against the project.
- (xiii) Cost of the project is Rs. 50 Crores
- (xiv) Employment potential: Labourers during construction phase 150 no. and about 463 personnel as hospital staff during operation phase.
- (xv) Benefits of the project: Employment opportunities provided due to the project will lead to better quality of life and will also set a standard for future developments in the area. The project will lead to increase in the infrastructure of the area and encouraged others for further development of the area. The Hospital will boast some of the best medical care infrastructure in the country. It will render tertiary and specialized treatment to general population. It will provide healthy, green & safe premises for living. People have more open and green spaces, bringing them closer to nature. People live, stay and recreate; and have immediate access to entertainment facilities in a single, spacious and secured area. Corporate Environment Responsibility will also be considered for the social benefits of the society.

3. The project/activity is covered under category 'B' of item 8(a) 'Building and Construction projects' of the Schedule to the EIA Notification, 2006 and its subsequent amendments, and requires appraisal at State level by sectoral EAC. However, due to absence of SEIAA/SEAC in Delhi, the proposal has been appraised at Central Level.

4. The Committee was informed that the existing hospital complex was constructed in year 2009. The built-up area of existing hospital is 9623.55 sqm, which is less than 20,000 sqm. Hence, it did not attract EIA notification 2006. The project is having Consent to Operate (CTO) from Delhi Pollution Control Committee (DPCC). Now, to increase the capacity of handling of patients and increase in beds, in the existing complex, two new towers will be constructed. Hence, 23,398.167 sqm will be added to existing hospital thereafter total Built-up area will be 33,021.717 sqm. Total beds after expansion shall be 270 from existing 200 beds. CTO for existing hospital was renewed by DPCC/WMC/2016/37169 dated 02.06.2016 and was valid up to 18.12.2018. The project proponent has applied to the DPCC for renewal of CTO and the application is under consideration with DPCC. The project proponent confirmed before the Committee that the present water requirement is being fulfilled by water supply connection from Delhi Jal Board and existing water supply is sufficient to cater the future demand and no additional water is required for the proposed project.

5. The EAC in its 39th meeting held on 26-28 March, 2019, based on the information submitted and clarifications provided by the Project Proponent and detailed discussions held on all the issues, recommended the project for grant of

J. Basu.

environmental clearance with stipulated specific conditions along with other Standard EC Conditions as specified by the Ministry vide OM dated 4th January, 2019 for the said project/activity, while considering for accord of environmental clearance. Correction made in the minutes of 40th meeting held on 23rd April, 2019. As per recommendations of the EAC, the Ministry of Environment, Forest and Climate Change hereby accords Environmental Clearance to the project Expansion of "Action Cancer Hospital" at A-4, Paschim Vihar, Near Paschim Vihar East Metro Station, New Delhi by M/s Manav Sevarth Trust, under the provisions of the EIA Notification, 2006 and amendments/circulars issued thereon, and subject to the specific and general conditions as under:-

A. Specific Conditions:

- (i) Consent to Establish/Operate for the project shall be obtained from the State Pollution Control Board as required under the Air (Prevention and Control of Pollution) Act, 1981 and the Water (Prevention and Control of Pollution) Act, 1974.
- (ii) The project proponent shall provide for adequate fire safety measures and equipment as per National Building Code/required by Fire Service Act of the State and instructions issued by the local Authority/Directorate of fire, from time to time. Further, the project proponent shall take necessary permission/NOC regarding fire safety from Competent Authority as required.
- (iii) The project proponent shall obtain all necessary clearance/ permission from all relevant agencies including town planning authority before commencement of work. All the construction shall be done in accordance with the local building byelaws.
- (iv) As proposed, fresh water requirement from Delhi Jal Board shall not exceed 54 KLD for which project proponent has already connection for the existing Hospital. Existing water supply is sufficient to cater the future demand and no additional water is required for the proposed project.
- (v) Sewage shall be treated in the STP based on MBBR Technology with tertiary treatment i.e. Ultra Filtration. The treated effluent from STP shall be recycled/re-used for flushing, gardening, & HVAC cooling purposes. No excess treated water from STP shall be discharged to municipal drain.
- (vi) The project proponents would devise a monitoring plan to the satisfaction of the State Pollution Control Board so as to continuously monitor the treated waste water being used for flushing in terms of faecal coliforms and other pathogenic bacteria.
- (vii) The project proponents would commission a third party study on the implementation of conditions related to quality and quantity of recycle and reuse of treated water, efficiency of treatment systems, quality of treated water being supplied for flushing (specially the bacterial counts), comparative bacteriological studies from toilet seats using recycled treated waters and fresh waters for flushing, and quality of water being supplied through spray faucets attached to toilet seats.
- (viii) The local bye-law provisions on rain water harvesting should be followed. If local bye-law provision is not available, adequate provision for storage and recharge should be followed as per the Ministry of Urban Development Model Building Byelaws, 2016. As proposed 2 nos. of rain water harvesting recharge

pits shall be provided for rain water harvesting after filtration as per CGWB guidelines.

- (ix) Separate wet and dry bins must be provided in each unit and at the ground level for facilitating segregation of waste. Solid waste shall be segregated into wet garbage and inert materials. Wet garbage shall be composted in Organic Waste Converter. Adequate area shall be provided for solid waste management within the premises which will include area for segregation, composting. The inert waste from project will be sent to dumping site.
- (x) Laboratory wastes shall be managed in accordance to the BMW Rules, 2016 and the atomic Energy Commission regulations as applicable.
- (xi) Traffic Management Plan as submitted shall be implemented in letter and spirit. Further, a detailed traffic management and traffic decongestion plan shall be drawn up to ensure that the current level of service of the roads within a 05 kms radius of the project is maintained and improved upon after the implementation of the project. This plan should be based on cumulative impact of all development and increased habitation being carried out or proposed to be carried out by the project or other agencies in this 05 Kms radius of the site in different scenarios of space and time and the traffic management plan shall be duly validated and certified by the State Urban Development department and the P.W.D./ competent authority for road augmentation and shall also have their consent to the implementation of components of the plan which involve the participation of these departments.
- (xii) No tree cutting/transplantation of existing trees has been proposed in the instant project. A minimum of 1 tree for every 80 sqm of land should be planted and maintained. The existing trees will be counted for this purpose. The landscape planning should include plantation of native species. The species with heavy foliage, broad leaves and wide canopy cover are desirable. Water intensive and/or invasive species should not be used for landscaping. As proposed 2,255.879 sqm (22.60% of total area) area shall be provided for green area development.
- (xiii) As per the Ministry's Office Memorandum F.No. 22-65/2017-IA.III dated 1st May 2018, and proposed by the project proponent, an amount of Rs. 0.5 Crores (1.0% of the project cost) shall be earmarked under Corporate Environment Responsibility (CER) for the activities such as clean drinking water, skill development etc. The activities proposed under CER shall be restricted to the affected area around the project. The entire activities proposed under the CER shall be treated as project and shall be monitored. The monitoring report shall be submitted to the regional office as a part of half yearly compliance report, and to the District Collector. It should be posted on the website of the project proponent.

B. Standard Conditions:

I. Statutory compliance:

- i. The project proponent shall obtain all necessary clearance/ permission from all relevant agencies including town planning authority before commencement of work. All the construction shall be done in accordance with the local building byelaws.

S. Basu

- ii. The approval of the Competent Authority shall be obtained for structural safety of buildings due to earthquakes, adequacy of firefighting equipment etc as per National Building Code including protection measures from lightening etc.
- iii. The project proponent shall obtain the necessary permission for drawl of ground water / surface water required for the project from the competent authority.
- iv. A certificate of adequacy of available power from the agency supplying power to the project along with the load allowed for the project should be obtained.
- v. All other statutory clearances such as the approvals for storage of diesel from Chief Controller of Explosives, Fire Department, Civil Aviation Department shall be obtained, as applicable, by project proponents from the respective competent authorities.
- vi. The provisions of the Solid Waste Management Rules, 2016, e-Waste (Management) Rules, 2016, and the Plastics Waste Management Rules, 2016, shall be followed.
- vii. The project proponent shall follow the ECBC/ECBC-R prescribed by Bureau of Energy Efficiency, Ministry of Power strictly.

II. Air quality monitoring and preservation:

- i. Notification GSR 94(E) dated 25.01.2018 of MoEF&CC regarding Mandatory Implementation of Dust Mitigation Measures for Construction and Demolition Activities for projects requiring Environmental Clearance shall be complied with.
- ii. A management plan shall be drawn up and implemented to contain the current exceedance in ambient air quality at the site.
- iii. The project proponent shall install system to carryout Ambient Air Quality monitoring for common/criterion parameters relevant to the main pollutants released (e.g. PM₁₀ and PM_{2.5}) covering upwind and downwind directions during the construction period.
- iv. Diesel power generating sets proposed as source of backup power should be of enclosed type and conform to rules made under the Environment (Protection) Act, 1986. The height of stack of DG sets should be equal to the height needed for the combined capacity of all proposed DG sets. Use of low sulphur diesel. The location of the DG sets may be decided with in consultation with State Pollution Control Board.
- v. Construction site shall be adequately barricaded before the construction begins. Dust, smoke & other air pollution prevention measures shall be provided for the building as well as the site. These measures shall include screens for the building under construction, continuous dust/ wind breaking walls all around the site (at least 3 meter height). Plastic/tarpaulin sheet covers shall be provided for vehicles bringing in sand, cement, murram and other construction materials prone to causing dust pollution at the site as well as taking out debris from the site.
- vi. Sand, murram, loose soil, cement, stored on site shall be covered adequately so as to prevent dust pollution.

J. Basu

- vii. Wet jet shall be provided for grinding and stone cutting.
- viii. Unpaved surfaces and loose soil shall be adequately sprinkled with water to suppress dust.
- ix. All construction and demolition debris shall be stored at the site (and not dumped on the roads or open spaces outside) before they are properly disposed. All demolition and construction waste shall be managed as per the provisions of the Construction and Demolition Waste Management Rules 2016.
- x. The diesel generator sets to be used during construction phase shall be low sulphur diesel type and shall conform to Environmental (Protection) prescribed for air and noise emission standards.
- xi. The gaseous emissions from DG set shall be dispersed through adequate stack height as per CPCB standards. Acoustic enclosure shall be provided to the DG sets to mitigate the noise pollution. Low sulphur diesel shall be used. The location of the DG set and exhaust pipe height shall be as per the provisions of the Central Pollution Control Board (CPCB) norms.
- xii. For indoor air quality the ventilation provisions as per National Building Code of India.

III. Water quality monitoring and preservation:

- i. The natural drain system should be maintained for ensuring unrestricted flow of water. No construction shall be allowed to obstruct the natural drainage through the site, on wetland and water bodies. Check dams, bio-swales, landscape, and other sustainable urban drainage systems (SUDS) are allowed for maintaining the drainage pattern and to harvest rain water.
- ii. Buildings shall be designed to follow the natural topography as much as possible. Minimum cutting and filling should be done.
- iii. The quantity of fresh water usage, water recycling and rainwater harvesting shall be measured and recorded to monitor the water balance as projected by the project proponent. The record shall be submitted to the Regional Office, MoEF&CC along with six monthly Monitoring reports.
- iv. A certificate shall be obtained from the local body supplying water, specifying the total annual water availability with the local authority, the quantity of water already committed, the quantity of water allotted to the project under consideration and the balance water available. This should be specified separately for ground water and surface water sources, ensuring that there is no impact on other users.
- v. At least 20% of the open spaces as required by the local building bye-laws shall be pervious. Use of Grass pavers, paver blocks with at least 50% opening, landscape etc. would be considered as pervious surface.
- vi. Installation of dual pipe plumbing for supplying fresh water for drinking, cooking and bathing etc and other for supply of recycled water for flushing, landscape irrigation, car washing, thermal cooling, conditioning etc. shall be done.

S. Rose.

- vii. Use of water saving devices/ fixtures (viz. low flow flushing systems; use of low flow faucets tap aerators etc) for water conservation shall be incorporated in the building plan.
- viii. Separation of grey and black water should be done by the use of dual plumbing system. In case of single stack system separate recirculation lines for flushing by giving dual plumbing system be done.
- ix. Water demand during construction should be reduced by use of pre-mixed concrete, curing agents and other best practices referred.
- x. A rain water harvesting plan needs to be designed where the recharge bores of minimum one recharge bore per 5,000 square meters of built up area and storage capacity of minimum one day of total fresh water requirement shall be provided. In areas where ground water recharge is not feasible, the rain water should be harvested and stored for reuse. The ground water shall not be withdrawn without approval from the Competent Authority.
- xi. All recharge should be limited to shallow aquifer.
- xii. No ground water shall be used during construction phase of the project.
- xiii. Any ground water dewatering should be properly managed and shall conform to the approvals and the guidelines of the CGWA in the matter. Formal approval shall be taken from the CGWA for any ground water abstraction or dewatering.
- xiv. The quantity of fresh water usage, water recycling and rainwater harvesting shall be measured and recorded to monitor the water balance as projected by the project proponent. The record shall be submitted to the Regional Office, MoEF&CC along with six monthly Monitoring reports.
- xv. Sewage shall be treated in the STP with tertiary treatment. The treated effluent from STP shall be recycled/re-used for flushing, AC make up water and gardening. As proposed, no treated water shall be disposed in to municipal drain.
- xvi. No sewage or untreated effluent water would be discharged through storm water drains.
- xvii. Onsite sewage treatment of capacity of treating 100% waste water to be installed. The installation of the Sewage Treatment Plant (STP) shall be certified by an independent expert and a report in this regard shall be submitted to the Ministry before the project is commissioned for operation. Treated waste water shall be reused on site for landscape, flushing, cooling tower, and other end-uses. Excess treated water shall be discharged as per statutory norms notified by Ministry of Environment, Forest and Climate Change. Natural treatment systems shall be promoted.
- xviii. Periodical monitoring of water quality of treated sewage shall be conducted. Necessary measures should be made to mitigate the odour problem from STP.
- xix. Sludge from the onsite sewage treatment, including septic tanks, shall be collected, conveyed and disposed as per the Ministry of Urban Development, Central Public Health and Environmental Engineering Organization (CPHEEO) Manual on Sewerage and Sewage Treatment Systems, 2013.

S. Rose'

IV. Noise monitoring and prevention:

- i. Ambient noise levels shall conform to residential area/commercial area/industrial area/silence zone both during day and night as per Noise Pollution (Control and Regulation) Rules, 2000. Incremental pollution loads on the ambient air and noise quality shall be closely monitored during construction phase. Adequate measures shall be made to reduce ambient air and noise level during construction phase, so as to conform to the stipulated standards by CPCB / SPCB.
- ii. Noise level survey shall be carried as per the prescribed guidelines and report in this regard shall be submitted to Regional Officer of the Ministry as a part of six-monthly compliance report.
- iii. Acoustic enclosures for DG sets, noise barriers for ground-run bays, ear plugs for operating personnel shall be implemented as mitigation measures for noise impact due to ground sources.

V. Energy Conservation measures:

- i. Compliance with the Energy Conservation Building Code (ECBC) of Bureau of Energy Efficiency shall be ensured. Buildings in the States which have notified their own ECBC, shall comply with the State ECBC.
- ii. Outdoor and common area lighting shall be LED.
- iii. Concept of passive solar design that minimize energy consumption in buildings by using design elements, such as building orientation, landscaping, efficient building envelope, appropriate fenestration, increased day lighting design and thermal mass etc. shall be incorporated in the building design. Wall, window, and roof u-values shall be as per ECBC specifications.
- iv. Energy conservation measures like installation of CFLs/ LED for the lighting the area outside the building should be integral part of the project design and should be in place before project commissioning.
- v. Solar, wind or other Renewable Energy shall be installed to meet electricity generation equivalent to 1% of the demand load or as per the state level/ local building bye-laws requirement, whichever is higher.
- vi. Solar power shall be used for lighting in the apartment to reduce the power load on grid. Separate electric meter shall be installed for solar power. Solar water heating shall be provided to meet 20% of the hot water demand of the commercial and institutional building or as per the requirement of the local building bye-laws, whichever is higher. Residential buildings are also recommended to meet its hot water demand from solar water heaters, as far as possible.

VI. Waste Management:

- i. A certificate from the competent authority handling municipal solid wastes, indicating the existing civic capacities of handling and their adequacy to cater to the M.S.W. generated from project shall be obtained.
- ii. Disposal of muck during construction phase shall not create any adverse effect on the neighbouring communities and be disposed taking the necessary precautions for general safety and health aspects of people, only in approved sites with the approval of competent authority.

S. Rose

- iii. Organic waste compost/ Vermiculture pit/ Organic Waste Converter within the premises with a minimum capacity of 0.3 kg /person/day must be installed.
- iv. All non-biodegradable waste shall be handed over to authorized recyclers for which a written tie up must be done with the authorized recyclers.
- v. Any hazardous waste generated during construction phase, shall be disposed off as per applicable rules and norms with necessary approvals of the State Pollution Control Board.
- vi. Use of environment friendly materials in bricks, blocks and other construction materials, shall be required for at least 20% of the construction material quantity. These include Fly Ash bricks, hollow bricks, AACs, Fly Ash Lime Gypsum blocks, Compressed earth blocks, and other environment friendly materials.
- vii. Fly ash should be used as building material in the construction as per the provision of Fly Ash Notification of September, 1999 and amended as on 27th August, 2003 and 25th January, 2016. Ready mixed concrete must be used in building construction.
- viii. Any wastes from construction and demolition activities related thereto shall be managed so as to strictly conform to the Construction and Demolition Waste Management Rules, 2016.
- ix. Used CFLs and TFLs should be properly collected and disposed off/sent for recycling as per the prevailing guidelines/ rules of the regulatory authority to avoid mercury contamination.

VII. Green Cover:

- i. Topsoil should be stripped to a depth of 20 cm from the areas proposed for buildings, roads, paved areas, and external services. It should be stockpiled appropriately in designated areas and reapplied during plantation of the proposed vegetation on site.

VIII. Transport

- i. A comprehensive mobility plan, as per MoUD best practices guidelines (URDPFI), shall be prepared to include motorized, non-motorized, public, and private networks. Road should be designed with due consideration for environment, and safety of users. The road system can be designed with these basic criteria.
 - a. Hierarchy of roads with proper segregation of vehicular and pedestrian traffic.
 - b. Traffic calming measures.
 - c. Proper design of entry and exit points.
 - d. Parking norms as per local regulation.
- ii. Vehicles hired for bringing construction material to the site should be in good condition and should have a pollution check certificate and should conform to applicable air and noise emission standards be operated only during non-peak hours.

3. base:

IX. Human health issues:

- i. All workers working at the construction site and involved in loading, unloading, carriage of construction material and construction debris or working in any area with dust pollution shall be provided with dust mask.
- ii. For indoor air quality the ventilation provisions as per National Building Code of India.
- iii. Emergency preparedness plan based on the Hazard identification and Risk Assessment (HIRA) and Disaster Management Plan shall be implemented.
- iv. Provision shall be made for the housing of construction labour within the site with all necessary infrastructure and facilities such as fuel for cooking, mobile toilets, mobile STP, safe drinking water, medical health care, crèche etc. The housing may be in the form of temporary structures to be removed after the completion of the project.
- v. Occupational health surveillance of the workers shall be done on a regular basis.
- vi. A First Aid Room shall be provided in the project both during construction and operations of the project.

X. Corporate Environment Responsibility:

- i. The company shall have a well laid down environmental policy duly approved by the Board of Directors. The environmental policy should prescribe for standard operating procedures to have proper checks and balances and to bring into focus any infringements/deviation/violation of the environmental / forest / wildlife norms / conditions. The company shall have defined system of reporting infringements / deviation / violation of the environmental / forest / wildlife norms / conditions and / or shareholders / stake holders. The copy of the board resolution in this regard shall be submitted to the MoEF&CC as a part of six-monthly report.
- ii. A separate Environmental Cell both at the project and company head quarter level, with qualified personnel shall be set up under the control of senior Executive, who will directly report to the head of the organization.
- iii. Action plan for implementing EMP and environmental conditions along with responsibility matrix of the company shall be prepared and shall be duly approved by competent authority. The year wise funds earmarked for environmental protection measures shall be kept in separate account and not to be diverted for any other purpose. Year wise progress of implementation of action plan shall be reported to the Ministry/Regional Office along with the Six Monthly Compliance Report.

XI. Miscellaneous:

- i. The project proponent shall prominently advertise it at least in two local newspapers of the District or State, of which one shall be in the vernacular language within seven days indicating that the project has been accorded environment clearance and the details of MoEFCC/SEIAA website where it is displayed.
- ii. The copies of the environmental clearance shall be submitted by the project proponents to the Heads of local bodies, Panchayats and Municipal Bodies in

S. Rose

addition to the relevant offices of the Government who in turn has to display the same for 30 days from the date of receipt.

- iii. The project proponent shall upload the status of compliance of the stipulated environment clearance conditions, including results of monitored data on their website and update the same on half-yearly basis.
- iv. The project proponent shall submit six-monthly reports on the status of the compliance of the stipulated environmental conditions on the website of the ministry of Environment, Forest and Climate Change at environment clearance portal.
- v. The project proponent shall submit the environmental statement for each financial year in Form-V to the concerned State Pollution Control Board as prescribed under the Environment (Protection) Rules, 1986, as amended subsequently and put on the website of the company.
- vi. The project proponent shall inform the Regional Office as well as the Ministry, the date of financial closure and final approval of the project by the concerned authorities, commencing the land development work and start of production operation by the project.
- vii. The project authorities must strictly adhere to the stipulations made by the State Pollution Control Board and the State Government.
- viii. The project proponent shall abide by all the commitments and recommendations made in the EIA/EMP report, commitment made during their presentation to the Expert Appraisal Committee.
- ix. No further expansion or modifications in the plant shall be carried out without prior approval of the Ministry of Environment, Forest and Climate Change (MoEF&CC).
- x. Concealing factual data or submission of false/fabricated data may result in revocation of this environmental clearance and attract action under the provisions of Environment (Protection) Act, 1986.
- xi. The Ministry may revoke or suspend the clearance, if implementation of any of the above conditions is not satisfactory.
- xii. The Ministry reserves the right to stipulate additional conditions if found necessary. The Company in a time bound manner shall implement these conditions.
- xiii. The Regional Office of this Ministry shall monitor compliance of the stipulated conditions. The project authorities should extend full cooperation to the officer (s) of the Regional Office by furnishing the requisite data / information/monitoring reports.
- xiv. The above conditions shall be enforced, inter-alia under the provisions of the Water (Prevention & Control of Pollution) Act, 1974, the Air (Prevention & Control of Pollution) Act, 1981, the Environment (Protection) Act, 1986, Hazardous and Other Wastes (Management and Transboundary Movement) Rules, 2016, and the Public Liability Insurance Act, 1991 along with their amendments and Rules and any other orders passed by the Hon'ble Supreme Court of India / High Courts and any other Court of Law relating to the subject matter.

J. Basu

xv. Any appeal against this EC shall lie with the National Green Tribunal, if preferred, within a period of 30 days as prescribed under Section 16 of the National Green Tribunal Act, 2010.

6. This issues with the approval of the Competent Authority.

S. Bose
(Dr. Subrata Bose)
Scientist F

Copy to:

- 1) The Secretary, Department of Environment, Government of Delhi, New Delhi.
- 2) The Addl. Principal Chief Conservator of Forests (C), Ministry of Environment, Forests and Climate Change, Kendriya Bhavan, 5th Floor, Sector-H, Aliganj, Lucknow - 226024.
- 3) The Chairman, Central Pollution Control Board Parivesh Bhavan, CBD-cum-Office Complex, East Arjun Nagar, New Delhi - 110 032.
- 4) The Member Secretary, Delhi Pollution Control Committee, Department of Environment, Government of N.C.T. Delhi, 4th Floor, ISBT Building, Kashmere Gate, Delhi.
- 5) Monitoring Cell, MoEF&CC, Indira Paryavaran Bhavan, New Delhi.
- 6) Guard File/ Record File/ Notice Board.
- 7) MoEFCC website.

S. Bose
(Dr. Subrata Bose)
Scientist F

Annexure-II

Copy of Consent to Establish



DELHI POLLUTION CONTROL COMMITTEE

(Government of N.C.T. of Delhi)

4th & 5th Floor, ISBT Building Kashmere Gate, Delhi 110006

(Visit us at <https://www.dpccocmms.nic.in>)

CONSENT ORDER

Certificate No. :G-23090

Name of the unit	:	ACTION CANCER HOSPITAL (A UNIT OF MANAV SEVARATH TRUST)
Address	:	A-4,FC 34 H2 PASCHIM VIHAR, Health Care Facility, Delhi - 110063
Consent Order No	:	DPCC/CMC/2021/5803079
Date of issue	:	20/04/2022
Product/Activity	:	Health Care Establishments having bed strength above 50 beds and connected or not connected to Sewer and without boiler
Manufacturing Activities	:	HEALTH CARE FACILITY (270 BEDDED)
Category Name	:	[RED]
Product Capacity	:	0 Metric Tonnes/Day

This Consent to Establish is hereby granted under section 21 of the Air (Prevention & Control of Pollution) Act, 1981 and under section 25/26 of the Water (Prevention & Control of Pollution) Act, 1974 under **RED** Category. This consent is subjected to terms and conditions specified overleaf. **This is being issued with reference to your application id 5803079 valid from 07/06/2021 to 06/06/2024.**

Senior Environmental Engineer

Terms and Conditions

1. The Consentee shall meet the effluent standards i.e. pH = 6.5-9, Total Suspended Solids (TSS) = 100, Biochemical Oxygen Demand (3 days at 27 degree Cent.) = 30, COD = 250, Oil and Grease = 10, Bio-assay Test (Present survival of fish after 96 hours in 100% effluent) = 90-100 %.
All effluent parameters are in mg/l except pH value & Bioassay test value.
2. The Consent is activity specific and based on the information provided in the consent application along with the subsequent documents/ information submitted to Delhi Pollution Control Committee (DPCC). The Consentee shall apply for fresh consent in case of any change in the activity/ manufacturing process.
3. The Consentee shall display the Name of the unit along with its Address, name of the Proprietor /Directors/ Partners etc, Contact Phone No(s) and its Activities/ Processes/ Products on a Display Board to be placed / fixed at the main gate of the unit.
4. The Consentee/ unit shall have/ take separate Electricity/ Power connection in its name and shall have/ install separate meter in this regard.
5. The Consentee shall provide and maintain a separate drainage system for collection of trade and sewage effluents. Terminal manholes shall be provided at the end of the collection system and shall be connected to the conveyance system/ sewerage system of the area leading to the Common Effluent Treatment Plant of the Industrial Area/ Sewage Treatment Plant of the catchment area.
6. The Consentee shall obtain permission from Delhi Jal Board for ground water extraction, if any, as per the various orders/ Notification of Govt. of NCT of Delhi. The Consentee shall not extract the groundwater without obtaining prior permission in this regard from DJB/ CGWA. The Consentee shall ensure that there is no bore well in the premises and if exist, the same shall be closed/ sealed with immediate effect till permission received from DJB/ CGWA.
7. The Consentee shall ensure proper channelization/ control system for fugitive emissions generated from the various activities/ processes of the unit and maintain good housekeeping practices so as to maintain a clean & safe environment in and around the premises of the unit.
8. The Consentee shall comply with the noise standards laid down vide Gazette Notification of Ministry of Environment and Forest (MoEF), Government of India Dated 17.05.2002 & 12.07.2004, as amended to date, for the Diesel Generator Set(s) and shall also comply with the Emission Standards prescribed for Diesel Engines [(Engine rating more than 0.8 MW) for Power Plant, Generator Set applications and other requirements], if any, as per the Gazette Notification of MoEF, Dated 09.07.2002, as amended to date. Stack Height for sets (Engine rating more than 0.8 MW) commissioned after 01.07.2003 shall be maximum of following:
 - a) Minimum 6 metre above the building where generator set is installed
 - b) 30 metre
 - c) $14Q^{0.3}$ (Q- Total SO₂ emission from the plant in kg/hr) and for other DG Set(s) (upto 0.8 MW) stack height shall be as per the following formula, $H = h + 0.2(KVA)^{0.5}$ (H- Total Height of stack in metre, h = Height of the building in metres where the Generator Set is installed, KVA - Total Generator capacity of the set in KVA).
9. The Consentee shall comply with the provisions of the Hazardous and Other Wastes(Management and Transboundary Movement) Rules, 2016, as amended to date, the Batteries (Management and Handling)

Rules, 2001 as amended to date, Solid Waste Management Rules, 2016 and E-Waste (Management) Rules, 2016, the Manufacture, Storage and Import of Hazardous Chemicals Rules, 1989, as amended to date, wherever applicable. All such wastes generated from the unit will be managed and handled as per the provisions of the said Rules and will be disposed off only through the Recycler/ Preprocessors/ Authorised Agencies for such wastes, authorised by MoEF/ Central Pollution Control Board/ State Pollution Control Board/ Committee/ DPCC as per details available on their websites.

10. The Consentee shall comply with the provisions of Solid Waste Management Rules, 2016 as amended to date.

11. The Consentee shall comply with the provisions of the Biomedical Waste Management Rules, 2016, as amended to date.

12. The Consentee shall comply with the provisions of the Plastic Waste Management Rules, 2016, as amended to date, if applicable.

13. The Consentee shall comply the other prescribed standards of Effluent/ Emissions as prescribed and as applicable under the provisions of the Environment (Protection) Act, 1986, as amended to date and the various Rules made there under including the Noise Pollution (Regulation and Control) Rules, 2000 as amended to date.

14. The Consentee shall promote the use of LED and recovery of mercury from CFL Lamps and should create a system of replacing old bulbs for new to enable recovery of mercury after the bulbs are fused.

15. Total water demand of the project is expected to be approx. 123 KLD and the same will be met by 54 KLD fresh water from DJB & Tanker Supply; 68 KLD from treated water from STP. Expected Domestic wastewater generation will be 79 KLD and will be treated in STP of 600 KLD.

16. Quantity of Effluent Discharge from the unit shall not exceed (i) Sewage / Domestic Effluent 79 KLD (ii) Trade Effluent 0.5 KLD and will be treated in ETP of 2 KLD.

17. Sludge from Effluent Treatment Plant shall be given to common bio-medical waste treatment facility for incineration or to hazardous waste treatment, storage and disposal facility for disposal.

18. The zero wastewater discharge condition to be achieved with installation of onsite Sewage Treatment Plant. Trade effluent shall conform to the norms and standards prescribed by Delhi Pollution Control Committee. The STP should be certified by an independent expert and a report in this regard should be submitted to Delhi Pollution Control Committee before the project is commissioned for operation. Necessary measures should be made to mitigate the odour problem from STP.

19. The treated wastewater of STP shall be recycled and reused for horticulture/ landscaping/ cooling/ flushing purposes to reduce the demand of fresh water as committed.

20. The Project Proponent shall provide electromagnetic flow meter at the inlet and outlet of the water supply, inlet and outlet of the STP and any pipeline to be used for re-using the treated wastewater back into the system for cooling, flushing and for horticulture purpose/ green etc. and shall maintain a record of readings of each such meter on daily basis.

21. The quantity of fresh water usage and water recycling shall be measured and recorded to monitor the water balance as projected by the Project Proponent. The record shall be submitted to the Delhi Pollution Control Committee on six monthly basis. The water requirement shall be met from the sources as per the details mentioned in the Environmental Clearance and fresh water requirement shall not exceed 54 KLD during the operation phase of the HCF.

22. Capacity of the Diesel Generator Set (s) installed in the HCF are 2*750 KVA. The Consentee shall properly maintain the Acoustic Enclosure/ Acoustic Treated room for DG Set(s) in good condition and maintain the adequate stack height for DG Set(s) to meet the prescribed standards/ norms as mentioned above. The Consentee shall not operate the DG Set(s) till compliance of the prescribed norms/standards for DG Sets.

23. The Consentee shall comply with the applicable provisions/ Directions given vide Gazette Notification of Department of Environment, Govt. of NCT of Delhi, dated 23.10.2012 including the directions that no person shall manufacture, import, store, sell or transport any kind of plastic carry bags (including that of PolyPropylene, Non-woven fabric type carry bags) in the whole of National Capital Territory of Delhi if applicable.

24. The Consentee shall provide widespread Green Cover and the use of Fly Ash as per Fly Ash notification dated 14.09.1999 shall be mandatory.

25. Project Proponent will ensure use of Ozone Depletion Substances (ODS) free appliances so that no toxic gases in air conditioning/ refrigeration/ fire extinguishers are created.

26. During the Construction Phase for Control of dust pollution all precautionary measure should be ensured in compliance of Hon'ble National Green Tribunal order dated 04.12.2014 in the matter of Vardhaman Kaushik vs. Union of India & Ors. and Sanjay Kulshrestha vs. Union of India & Ors. and as notified by MoEF&CC, GOI vide Notification No. G.S.R. 94(E) dated 25.01.2018. Consignee shall use Anti-Smog Gun(s) compulsorily for undertaking construction & demolition activity including excavation, material handling and other dust generating activities for compliance of Hon'ble Supreme Court orders dated 13.01.2020 in WPC No. 13029/1985 titled M.C. Mehta vs. Union of India & Ors.

27. It will be the responsibility of the Project Proponent to obtain prior clearances/ approval and ensure compliances under all other relevant Acts/ Rules/ Regulations/ Guidelines/ Instructions/ Court Orders/ Tribunal Orders as applicable to this project before starting of the project.

28. The Consentee shall not carry out any activity falling under the Prohibited/ Negative list of Industries (Annexure III of MPD -2021) which are prohibited in National Capital Territory of Delhi, as per Master Plan of Delhi.

29. Unit shall implement the environmental safeguards as per stipulations in Environmental Clearance issued by SEIAA Delhi and shall submit a half yearly compliance report in respect of terms and conditions of Environmental Clearance to Regional Office of MoEF & CC and simultaneously to DPCC on the prescribed date.

30. The Consentee shall submit an application for extension of the Consent to Establish/ Consent to Operate under Water and Air Acts & Authorization under BMWM Rules, 2016 one month in advance of the expiry date of this Consent Order/ date of start of operation of the HCF.

31. This consent is being granted focusing only on the Water Act 1974/ Air Act 1981. The project will be regulated by the concerned local Civic Authorities under the provisions of the relevant provisions of the extant MPD-2021, Building Control Regulations and Safety Regulations. The investment made in the project, if any, based on Consent so granted, in anticipation of the clearance from other statutory authorities shall be entirely at the cost and risk of the project proponent, DPCC shall not be responsible in this regard in any manner.

32. The Consenee is allowed to run the pollution control devices and collect and test the data. The trial for these aforesaid purposes is permitted within the period of maximum three months from the date of completion. The Consenee shall give prior intimation to DPCC, of the dates on which trial would start and end. Thereafter Project Proponent shall apply for Consent to Operate along with requisite details and test reports to DPCC.

33. The Consenee shall abide by the Guidelines on Environmental Management of Construction and Demolition (C&D) Waste and Guidelines on Dust Mitigation Measure in Handling Construction Material and C&D waste developed and published by CPCB available at www.cpcb.nic.in

34. The Consenee shall display the enclosed template of Notice for Construction and Demolition Waste Management at the site.

35. The Consenee shall ensure the compliance of policy to be followed regarding operation of Ready Mix Concrete Plants (RMC Plants) issued vide office order No. DPCC/CMC I/RMC/2017/2596 to 2614 dated 27.12.2017 (available at DPCC website).

36. In the event of any information furnished by the Consenee found to be false OR in case of failure to comply with any of the above mentioned consent conditions, consent granted through this Consent Order shall be deemed to be revoked without any notice and necessary action as per law shall be taken, which may include closure of the unit and prosecution for wrong declaration.

37. Notwithstanding anything contained in this Consent Order. Delhi Pollution Control Committee, reserves its right to review any/ or all the conditions imposed herein above and to make such variations as deemed fit for the purpose of enforcement of the Air (Prevention and Control of Pollution) Act, 1981, as amended to date and the Water (Prevention and Control of Pollution) Act, 1974, as amended to date.

38. The Consent granted to the Consenee is to ensure control of pollution from the premises of the unit in accordance with various Pollution Control Laws and in no way confers the right to the Consenee / unit to exist in violation of other laws and statutory provisions including the Master Plan of Delhi.

39. The Consenee shall ensure the safeguards as envisaged in Environmental Clearance issued to Shri Ram Chandra, Trustee M/s Manav Sevarth Trust vide file no. 21-8/2019-IA-III dated 06.08.2019 including the dust control measures during the construction stage.

40. This issue in view of the Office Order dated 12.04.2016 regarding processing of the Consent to Establish cases.

Template for displaying notice w.r.t. Condition No. 34 to be displayed on board of size 6 feet X 4 feet.

Background color - Yellow, Letters - Black

NOTICE

(Construction and demolition waste management rule 2016)

The construction/Demolition site is authorized by... Vide file no... Dated.....

1. Name and Address with contact number of contractor/developer
2. Address of the site
3. Area/length
4. Date of initiation of the project (dd/mm/yy)
5. Scheduled completion date of the project (dd/mm/yy)
6. Details date of completion/disposal/clearing of the site (dd/mm/yy)
7. Estimated waste (TPD)
8. Total estimated waste (MT) for the entire project
9. Nature of waste (concrete/iron/plastic/soil) (TPD)
10. Material Generated Recycled Reused Disposed

Sand -----

Concrete -----

11. Identified waste disposal site
12. Mode of utilization of waste (reuse/recycle/convert to construction material)
13. Mode of disposal
14. Mode of handling and transportation (manual/mechanical/pneumatic)(by road/rail)
15. Dust mitigation measures at the site (water sprinkling/curtain/barrister)
16. Reason of delay in disposing waste (in any)
17. Accidents reported (in any)

Name of Agency Owner

Telephone number

Annexure-III

Copy of Consent to Operate



DELHI POLLUTION CONTROL COMMITTEE

(Government of N.C.T. of Delhi)

4th & 5th Floor, ISBT Building Kashmere Gate, Delhi 110006

CONSENT ORDER

Certificate No. :G-23155

Name of the unit	:	ACTION CANCER HOSPITAL (A UNIT OF MANAV SEVARATH TRUST)
Address	:	A-4,FC 34 H2 PASCHIM VIHAR, Health Care Facility, Delhi - 110063
Consent Order No	:	DPCC/CMC/2021/6762004
Date of issue	:	20/04/2022
Product/Activity	:	Health Care Establishments having bed strength above 50 beds and connected or not connected to Sewer and without boiler
Manufacturing Activities	:	HEALTH CARE (130 BEDDED)
Category Name	:	[RED]
Product Capacity	:	0 Metric Tonnes/Day

This Consent to Operate is hereby granted under section 21 of the Air (Prevention & Control of Pollution) Act, 1981 and under section 25/26 of the Water (Prevention & Control of Pollution) Act, 1974 under RED Category. This consent is subjected to terms and conditions specified overleaf. This is being issued with reference to your application id 6762004 valid from 30/11/2021 to 29/11/2026.

Prem Swarup
Pankaj
Senior Environmental Engineer

Digitally signed by Prem
Swarup Pankaj
Date: 2022.04.22 12:38:33
+05'30'

Annexure-IV
Copy of Fire NOC



GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI- 110001

20/06/2023


No. F6/DFS/MS/Hospital/WZ/2023/ 297

Dated:- 20/06/2023

FIRE SAFETY CERTIFICATE

Certified that the Manav Sevarth Trust Hospital (Action Cancer Hospital) Located at, FC-34, A-4, Block, Paschim Vihar, New Delhi-110063, comprised of Two Blocks, A Block (Cancer Hospital), Basement + Ground + 03 Upper Floors & B Block (Nursing Hostel), 02 Basement + Ground + 02 Upper Floors only owned/occupied by Manav Sevarth Trust Hospital, was issued Fire Safety Certificate vide Letter No. F6/DFS/MS/WZ/Hospital/2020/WZ/268 dated 24.07.2020. The said premises was re-inspected by the officers concerned of this department on 27.05.2023 in the presence of Sh. Mandeep Lakra (A.G.M) and found that the building/premises have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rule, 2010, and that the premises/building is fit for occupancy class "Institutional Building" Group C Sub Division C-1 with effect from 20/06/2023 for a period of three years in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010, printed below.

Issued on 20/06/2023 at New Delhi by.


(Atul Goyal
Director
Delhi Fire Service

Copy to:-

Dr. Archana Atreja, Medical Superintendent, Action Cancer Hospital, FC-34, A-4, Paschim Vihar, New Delhi-110063.

Following fire safety directives must be adhered to:-

1. All the means of escape shall be kept free of all type of obstruction all the time. It should not bolt /locked.
2. All the employees shall be acquainted with the use and maintenance of all fire equipments and method of smooth and speedy safe evacuation of occupants in case of emergency.
3. All the fire fighting equipments shall be maintained in perfect working condition all the time and any loss of life any property due to the non-functional of any fire safety measures, management shall be held responsible.
4. Any deviation, with regards to construction, ventilation, occupation, electric installation etc. may be got verified from the concerned authorities.
5. The Fire Safety Certificate may not be treated in any case for regularizations of unauthorized construction / unauthorized use of land if any.
6. All comments / directions of building Department shall always be permitted and followed.
7. The owner /occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on www.dfs.delhigovt.nic.in
8. The owner / occupier shall apply for renewal of this Fire Safety Certificate to the Director in 'Form J' (sub Rule (1) of Rule 37) along with copy of the certificate, six months prior to its expiry.
9. The basement shall be used as per BBL.

Annexure-V

Copy of Water Bills



STOP CORONA:

- I. Wear Mask.
- II. Follow Physical Distancing.
- III. Maintain Hand Hygiene.

Delhi Jal Board (दिल्ली जल बोर्ड)

(Government of NCT of Delhi)

www.djb.gov.in

Regular Water Bill



Catch the Rain



Name(नाम): SH MANAV SEVARATH TRUST
 Address(पता): A-4/FC-34 G, F, PASCHIM VIHAR, Delhi
 Mobile No. . (मोबाइल): 9811052607
 Zone/Loc (लेट्रे / स्थान): / Kanhaiya Nagar
 Area Code (एरिया कोड): A-2
 MR Code (एमआर कोड): 296/BULK
 KNO(केएनओ): 2156471000

Consumer Category(उपभोक्ता श्रेणी): CAT II
 Premise Detail (परिसर विवरण): (No of floors-1, No of Borewell-1)
 Meter No. (मीटर संख्या): 15017227
 Meter Type (मीटर का प्रकार) (DJB/Pvt): PVT
 Bill No. (बिल संख्या): 215128168754
 Bill Cycle(बिल चक्र): ZALL(B1-2024)
 Bill Basis(बिल आधार): REGULAR

Bill Date(बिल की तिथि)

30-APR-2024

Bill Amount (Rs.) (बिल राशि (₹))
142371Bill Amount Payable (Rs.)(देय बिल राशि (₹))
(Nearest up to Rs. 10) (लगभग 10 रु. तक)

142370

Bill Due Date(बिल देय तिथि)
17-MAY-2024Amount Payable After Due Date(Rs.)
(देय तिथि के बाद देय राशि (₹))
149489

Meter No (मीटर संख्या)	UoM (मीटर)	Current Meter Read (मीटर की वर्तमान रीडिंग)		Previous Meter Read (मीटर की पिछली रीडिंग)		Consumption (खपत)	
		Meter Reading Date (मीटर रीडिंग की तारीख)	Reading / Meter Status (रीडिंग / मीटर स्थिति)	Meter Reading Date (मीटर रीडिंग की तारीख)	Reading / Meter Status (रीडिंग / मीटर स्थिति)	Days (दिन)	Units (क्षेत्रफल)
15017227	KL	18-APR-2024	122663 / OK	23-MAR-2024	122072 / OK	26	591

Bill Details: Current Period Charges (बिल विवरण: वर्तमान अवधि शुल्क) (23-MAR-2024 to 18-APR-2024)

Applicable Rate Period	Description	Amount(Rs.)
24-MAR-2024 to 18-APR-2024	Total Consumption Charges	97201.99
24-MAR-2024 to 18-APR-2024	Sewerage Charge (60 % of Water Consumption Charge)	58321.19
24-MAR-2024 to 18-APR-2024	Service Charge - Consumption > 100 KL	1142.00
24-MAR-2024 to 18-APR-2024	Additional Sewerage Maintenance Charge for Hospitals/NH	10833.33
24-MAR-2024 to 18-APR-2024	Sub Total Bill Amount without Meter Rent	167498.51
24-MAR-2024 to 18-APR-2024	Discount for WH or WWR(10% of Total Water Bill)	-16749.85
24-MAR-2024 to 18-APR-2024	Discount for both WH & WWR(5% of Total Water Bill)	-8374.93
24-MAR-2024 to 18-APR-2024	Subtotal Bill Amount	142373.73
Adjustment Details Are Listed Below		

Arrear, If any (Rs.) (बकाया, यदि कोई (₹)) -3.55

Total Consolidated Bill Amount Payable (Rs.) (कुल समेकित बिल राशि देय (₹)) 142371

Late Payment Surcharge (Rs.)(देय से भुगतान पर अधिभार) (5% surcharge will be applicable after due date)(देय तिथि के बाद, 5% अधिभार लागू होगा) 7118 .51 Amount with LPSC after due date (Rs.) (देय तिथि के बाद अधिभार के साथ राशि (₹)) 149489

PAYABLE AMOUNT TO AVAIL REBATE SCHEME (Rs.) (छूट योजना के लिए देय राशि (₹))

Bill History (पिछला वित्त)							Payment History (पिछला भुगतान)		
Bill from Date	Bill to Date	Days	Reading	Status	Units	Amount(Rs)	Receipt Id	Amount(Rs)	Date
19-FEB-2024	23-MAR-2024	33	122072	OK	751	180917	215043645268	180920.00	12-APR-2024
29-JAN-2024	19-FEB-2024	21	121321	OK	543	130681	215075795557	130681.00	13-MAR-2024
29-DEC-2023	29-JAN-2024	31	120778	OK	690	166254	215594839144	166254.00	15-FEB-2024
29-NOV-2023	29-DEC-2023	30	120088	OK	689	165971	215469675471	165970.00	15-JAN-2024
30-OCT-2023	29-NOV-2023	30	119399	OK	689	165973	215505565809	165970.00	08-DEC-2023

Important Message

If bill is not paid till Bill Due Date- connection may be disconnected (यदि बिल देय तिथि तक बिल का भुगतान नहीं किया जाता है- कनेक्शन काट दिया जा सकता है)

For any assistance / query : Please call 1916 or www.djb.gov.in (किसी भी सहायता / जानकारी के लिए: 1916 पर कॉल करें या www.djb.gov.in पर जाएं)Delhi Jal Board
Bill Payment Counter FoilCheque / DD should be drawn in favour of DJB in the following format
(नोट: डिमार्ट ड्रायर भुगतान करने के लिए निम्न पार्मेट का उपयोग करें) DJB KNO

KNO(केएनओ)	2156471000	Name(नाम)	SH MANAV SEVARATH TRUST	Bill No. (बिल संख्या)	215128168754
Bill Date(बिल की तिथि)	30-APR-2024	Bill Due Date (बिल देय तिथि)	17-MAY-2024	Bill Amount (Rs.) (बिल राशि (₹))	142371
Bill Amount with LPSC (Rs.): 149489 (LPSC के साथ बिल राशि (₹)):	Payment Date/ (भुगतान की तारीख)	Amount Paid(Rs.) (राशि का भुगतान (₹))	Cash/Cheque No/DD No.: (क्रेड / चेक नंबर / डीडी नं.)		
Name of Bank / Branch (बैंक / शाखा का नाम)					

30 APR 2024

Tariff Structure for monthly consumption w.e.f 01-02-2018

Category	Monthly Consumption (KL)	Service Charge (Rs)	Volumetric Charge (Rs. per KL)
Category - I(Domestic)	Up-to 20	146.41	5.27
	20-30	219.62	26.36
	Above 30	292.82	43.93
Category - II(Non-Domestic)	0-6	146.41	17.57
	6-15	292.82	26.35
	15-25	585.64	35.14
	25-50	1024.87	87.85
	50-100	1171.28	140.56
	100-above	1317.69	175.69

Note: To ensure proper implementation of Rain Water Harvesting and Waste Water Recycling norms and in compliance of Building Byelaws, it will be mandatory for plots/properties having area of 100 Sq. Mtrs. or more to have functional Rain Water Harvesting System, even if the property is constructed prior to 28-07-2001. Such plot/property owning consumers would be required to install functional Rain Water Harvesting System and will get rebate on water bill. In case, consumer fail to comply with the aforesaid mandatory provision within the time limit prescribed, the traffic as applicable for respective consumer category will be increased by 1.5 times, till the system is installed and intimated to the respective Zonal Revenue officer. Functionality certificate of RWH need to be given in the month of 'May' of every year in ZRO Office.

Payment Facilities:

Besides DJB ZRO Offices listed below, consumers can make payment online through e-payment gateways of Axis Bank, Utkarsh Bank, IDBI & Union Bank at Customer portal (www.djb.gov.in) and branches of authorized bank at IDBI Bank. Payment can also be made online through e-wallets, Net Banking, Debit/Credit Card, UPI etc. though any agency under Bharat Bill Payment System (BBPS) viz Paytm, Google Pay, Phone Pay, Amazon Pay, Freecharge & other major banks. Cheque may be issued in favor of "DJB KNO XXXXXXXXX", where XXXXXXXXX represent 10-digit of New K. No. of the consumer mentioned on the bill.

Payment may be made through NEFT/RTGS to DJB A/C using Utkarsh Small Finance Bank Limited, Axis Bank Ltd, South Indian Bank Ltd. & IDBI Banks. Please visit Customer portal (www.djb.gov.in) - Pay Online > Pay through NEFT/RTGS for details of beneficiary account.

- For any issue related to reading, billing, the consumer can call **CUSTOMER CARE NUMBER No. 1916- Extn. 2** and take online complaint No. instantly. Consumer can avail different online facilities regarding New Connection, Mutation, Re-Opening, Disconnection, online payments and register grievances through Customer portal (www.djb.gov.in). Please use your New K.NO for all communication with DJB. Consumer can contact concerned ZRO or his Dy. Director Revenue or Joint Director Revenue to resolve all billing and application regarding New Connection, Mutation, Re-Opening, Disconnection and Payment related grievance at followings:

Abbreviations on bill:

New Code	Meter Status	New Code	Meter Status
OK	OK	RDDT	Reading Detained
NUW	NO Use Of Water	TEST	Meter Under Testing
PLUG	Plugged	DFMT	Defective Meter
DEM	Demolished	STP	Stopped
PLOC	Premises Locked	MTTM	Meter Tempered
NRES	NO Response	MREV	Meter Reverse
MBUR	Meter Buried	UNMT	Running Unmetered
VMMT	Vapoured/Moistured Meter	BYPS	T-Joint/ByPass
DUST	Dusty Meter	CUT	Meter Cut-Off
MLOC	Meter Locked	ADF	Access Denied/Refused
UOM Unit Of Measurement			

SL.No	Zone	ZRO Location and Collection Counter	Office No.	SL.No	Zone	ZRO Location and Collection Counter	Office No.
1	NW1	Sultan Puri	25476298	26	CZ2	Pratap Nagar	23692201
2	WZ1	Subhash Nagar	25408765	27	SW3	R K Puram	26193424
3	WZ2	Punjabi Bagh	25223568	28	SZ2	Lajpat Nagar	29814106
4	NW1	Kiran	8920657545	29	SZ3	Greater Kailash	29239668
5	NE1	Shahadara	22591171	30	PP1	MNWS R K Puram	18001024669
6	NE2	Yamuna Vihar	22810491	31	PP1	MNWS Mehrauli	18001024669
7	NE1	GTB Enclave	22571986	32	PP1	MNWS Greater Kailash	18001024669
8	NE3	New Seelam Pur	22182253	33	PP2	MVV R K Puram	18001037232
9	CZ1	Jhandewalan	23612792	34	PP2	MVV Mohrauli	18001037232
10	NW4	Kewal Park	27675270	35	EZ1	Preet Vihar	22444424
11	NZ2	Mukherjee Nagar	27606627	36	EZ2	Shiv Puri	22047239
12	WZ3	Paschim Vihar	25252797	37	EZ2	Yojna Vihar	22158119
12	NZ2	Burari	27613757	38	EZ1	Mayur Vihar	22759551
14	PP3	NWS BHERA ENCLAVE	180030000136	39	EZ1	MANDAWALI	22444424
15	PP3	NWS Mohan Garden	18001020389	40	NW2	Narela	27281673
16	SW1	Kakrola More	8851254848	41	NW2	Rohini	27040004
17	WZ1	Janak Puri	25557475	42	NW3	Canhaya Nagar	27395044
18	PP3	Nangli Water Service	27675270	43	NW3	Ashok Vihar	27301456
19	WZ1	Rejouri Garden	8800233484	44	CZ2	Tibbiya College	23546251
20	SW4	Dwarka	28082442				
21	WZ2	Rajendra Nagar	25724938				
22	SW2	Vasant Kunj	26897787				
23	SZ1	Saket	29561916				
24	SZ2	Giri Nagar	26212219				
25	SZ4	Sarila Vihar	29941159				

As can be observed from the tariff that Delhi Jal Board emphasizes on the conservation of water and tariff is designed on the principle- 'Use More Pay More'. Hence, consumers are advised to conserve water by:-

1. Plugging all leakages in pipes, joints, taps, overhead tanks etc.
2. To use kitchen waste water for gardening purposes.
3. To wash vehicle etc. by bucket instead of pipe.
4. Install valve before meter and close it when water is not use.
5. Consumers should use MDPE pipes for underground position for carrying portable water.

Tariff consists of following components:

1. Water-to be measured on volumetric charges of water consumed as reported in meter.
2. Sewerage maintenance charge- @60% of water volumetric consumption charges.
3. Service Charges-Levied on the basis of slab wise consumption.
4. Meter rent in case meter has been provided by DJB.

How to Calculate Bill- Divide the total units consumed by number of days for which bill has been issued and multiply by 30 to give per month average water consumption. Water consumption charge (multiplying monthly charge by the actual period of reading) will be calculated as per tariff for the respective category as mentioned above. Sewerage maintenance charge will be 60% of water consumption charges. Add service charges as per respective category and Consumption slab. It will give you the bill amount

Note: Payment in respect of New water connection, mutation, disconnection and reopening cases should be made within prescribed time, failure may result in withdrawal of sanction.

Any work on DJB Water & Sewer Lines can be allowed only through Licensed Plumber or Authorized Agency of DJB with prior approval/sanction.

For any issue related to water, contamination, tanker or sewerage consumer can call **CUSTOMER CARE NUMBER No. 1916- Extn. 1** or visit www.delhijalboard.nic.in



STOP CORONA:
 I. Wear Mask.
 II. Follow Physical Distancing.
 III. Maintain Hand Hygiene.

Delhi Jal Board (दिल्ली जल बोर्ड)

(Government of NCT of Delhi)

www.djb.gov.in

Regular Water Bill



Name(नाम): M/S.BALAJI HOSPITAL (MEDICAL INSTITUTE)
Address(पता): A-4/(FC-34), PASCHIM VIHAR, Delhi
Mobile No. . (मोबाइल): 9288877015
Zone/Loc (क्षेत्र / स्थान): / Kanhaiya Nagar
Area Code (एरिया कोड): A-1
MR Code (एमआर कोड): 296/BULK
KNO(केएनओ): 6056471000

Consumer Category(उपभोक्ता श्रेणी): CAT II
Premise Detail (परिसर विवरण): (No of floors-1)
Meter No. (मीटर संख्या): NA
Meter Type (मीटर का प्रकार) (DJB/Pvt): PVT
Bill No. (बिल संख्या): 605314621596
Bill Cycle(बिल चक्र): ZALL(B1-2024)
Bill Basis(बिल आधार): REGULAR

Bill Date(बिल की तिथि)
 29-APR-2024

Bill Amount (Rs.) (बिल राशि (₹))
 103451

Bill Amount Payable (Rs.) (देय बिल राशि (₹))
 (Nearest up to Rs. 10) (लगभग 10 रु. तक)
 103450

Bill Due Date(बिल देय तिथि)
 16-MAY-2024

Amount Payable After Due Date(Rs.)
 (देय तिथि के बाद देय राशि (₹))
 108623

Meter No (मीटर संख्या)	UoM (मीटर संख्या)	Current Meter Read (नीटर की वर्तमान रीडिंग)		Previous Meter Read (मीटर की पिछली रीडिंग)		Consumption (खपत)	
		Meter Reading Date (मीटर रीडिंग की तारीख)	Reading / Meter Status (रीडिंग / मीटर स्थिति)	Meter Reading Date (मीटर रीडिंग की तारीख)	Reading / Meter Status (रीडिंग / मीटर स्थिति)	Days (दिन)	Units (यूनिट)
NA	KL	18-APR-2024	19542 / OK	23-MAR-2024	19137 / OK	26	405

Bill Details: Current Period Charges (बिल विवरण: वर्तमान अवधि शुल्क) (23-MAR-2024 to 18-APR-2024)

Applicable Rate Period	Description	Amount(Rs.)
24-MAR-2024 to 18-APR-2024	Total Consumption Charges	64523.65
24-MAR-2024 to 18-APR-2024	Sewerage Charge (60 % of Water Consumption Charge)	38714.19
24-MAR-2024 to 18-APR-2024	Service Charge - Consumption > 100 KL	1142.00
24-MAR-2024 to 18-APR-2024	Additional Sewerage Maintenance Charge for Hospitals/NH	17333.33
24-MAR-2024 to 18-APR-2024	Sub Total Bill Amount without Meter Rent	121713.17
24-MAR-2024 to 18-APR-2024	Discount for WH & WWR(10% of Total Water Bill)	-12171.32
24-MAR-2024 to 18-APR-2024	Discount for both WH & WWR(5% of Total Water Bill)	-6085.66
24-MAR-2024 to 18-APR-2024	Subtotal Bill Amount	103456.19
	Adjustment Details Are Listed Below	

Arrear, If any (Rs.) (बकाया, यदि कोई (₹))	-5.91
Total Consolidated Bill Amount Payable (Rs.) (कुल समेकित बिल राशि देय (₹))	103451
Late Payment Surcharge (Rs.) (देर से भुगतान पर अधिभार) (5% surcharge will be applicable after due date)(देय तिथि के बाद 5% अधिभार लागू होगा)	5172 .51

Amount with LPSC after due date (Rs.) (देय तिथि के बाद अधिभार के साथ राशि (₹))

PAYABLE AMOUNT TO AVAIL REBATE SCHEME (Rs.) (छूट योग्यता के लिए देय राशि (₹))						
Bill History (पिछला बिल)						Payment History (पिछला भुगतान)
Bill from Date	Bill to Date	Days	Reading	Status	Units	Amount(Rs)
20-FEB-2024	23-MAR-2024	32	19137	OK	453	114885
19-DEC-2023	20-FEB-2024	63	18884	OK	1127	-1584
28-NOV-2023	19-DEC-2023	21	17557	OK	434	109097
30-OCT-2023	28-NOV-2023	29	17123	OK	613	15927
17-SEP-2023	30-OCT-2023	43	16510	OK	817	222830

Important Message

If bill is not paid till Bill Due Date- connection may be disconnected (यदि बिल देय तिथि तक बिल का भुगतान नहीं किया जाता है- कनेक्शन काट दिया जा सकता है)
 For any assistance / query : Please call 1916 or www.djb.gov.in (किसी भी सहायता / जानकारी के लिए: 1916 पर कॉल करें या www.djb.gov.in पर जाएं)

Delhi Jal Board Bill Payment Counter Foil				Cheque / DD should be drawn in favour of DJB in the following format (केश / चेक डब्ल्यूएफ द्वारा भुगतान करने के लिए निम्न फॉर्म का उपयोग करें) DJB KNO		
KNO(केएनओ)	6056471000	Name(नाम)	M/S.BALAJI HOSPITAL (MEDICAL INSTITUTE)	Bill No. (बिल संख्या)	605314621596	
Bill Date(बिल की तिथि)	29-APR-2024	Bill Due Date (बिल देय तिथि)	16-MAY-2024	Bill Amount (Rs.) (बिल राशि (₹))	103451	
Bill Amount with LPSC (Rs.): (LPSC के साथ बिल राशि (₹)):	108623	Payment Date/ (भुगतान की तारीख)		Cash/Cheque No./DD No.:		(केश / चेक नंबर / डीडी नं.):
Amount Paid(Rs.): (साप्त बिल राशि (₹)):		Amount Paid(Rs.) (राशि का भुगतान (₹))				

30 APR 2024

_____	Name of Bank / Branch (बङ्क / शाखा का नाम)	_____
-------	--	-------

Tariff Structure for monthly consumption w.e.f 01-02-2018

Category	Monthly Consumption (KL)	Service Charge (Rs.)	Volumetric Charge (Rs. per KL)
Category - I(Domestic)	Up-to 20	146.41	5.27
	20-30	219.62	26.36
	Above 30	292.82	43.93
Category - II(Non-Domestic)	0-6	146.41	17.57
	6-15	292.82	26.35
	15-25	585.64	35.14
	25-50	1024.87	87.85
	50-100	1171.28	140.56
	100-above	1317.69	175.69

Note: To ensure proper implementation of Rain Water Harvesting and Waste Water Recycling norms and in compliance of Building Byelaws, it will be mandatory for plots/properties having area of 100 Sq. Mtrs. or more to have functional Rain Water Harvesting System, even if the property is constructed prior to 28-07-2001. Such plot/property owning consumers would be required to install functional Rain Water Harvesting System and will get rebate on water bill. In case, consumer fail to comply with the aforesaid mandatory provision within the time limit prescribed, the traffic as applicable for respective consumer category will be increased by 1.5 times, till the system is installed and intimated to the respective Zonal Revenue officer. Functionality certificate of RWH need to be given in the month of 'May' of every year in ZRO Office.

Payment Facilities:

Besides DJB ZRO Offices listed below, consumers can make payment online through e-payment gateways of Axis Bank, Utkarsh Bank, IDBI & Union Bank at Customer portal (www.djb.gov.in) and branches of authorized bank at IDBI Bank. Payment can also be made online through e-wallets, Net Banking, Debit/Credit Card, UPI etc. though any agency under Bharat Bill Payment System (BBPS) viz Paytm, Google Pay, Phone Pay, Amazon Pay, Freecharge & other major banks. Cheque may be issued in favor of "DJB KNO XXXXXXXXX", where XXXXXXXXX represent 10-digit of New K. No. of the consumer mentioned on the bill.

Payment may be made through NEFT/RTGS to DJB A/C using Utkarsh Small Finance Bank Limited, Axis Bank Ltd, South Indian Bank Ltd. & IDBI Banks. Please visit Customer portal (www.djb.gov.in) - Pay Online > Pay through NEFT/RTGS for details of beneficiary account.

- For any issue related to reading, billing, the consumer can call **CUSTOMER CARE NUMBER No. 1916- Extn. 2** and take online complaint No. instantly. Consumer can avail different online facilities regarding New Connection, Mutation, Re-Opening, Disconnection, online payments and register grievances through Customer portal (www.djb.gov.in). Please use your New K.NO for all communication with DJB. Consumer can contact concerned ZRO or his Dy. Director Revenue or Joint Director Revenue to resolve all billing and application regarding New Connection, Mutation, Re-Opening, Disconnection and Payment related grievance at followings:

Abbreviations on bill:

SL.No	Zone	ZRO Location and Collection Counter	Office No.	SL.No	Zone	ZRO Location and Collection Counter	Office No.
1	NW1	Sultan Puri	25476298	26	CZ2	Pratep Nagar	23692201
2	WZ1	Subhash Nagar	25408765	27	SW3	R K Puram	26193424
3	WZ2	Punjabi Bagh	25223568	28	SZ2	Lajpat Nagar	29814106
4	NW1	Kirari	8920657545	29	SZ3	Greater Kailash	20239668
5	NE1	Shahadara	22591171	30	PP1	MNWS R K Puram	18001024669
6	NE2	Yamuna Vihar	22910491	31	PP1	MNWS Mehrauli	18001024669
7	NE1	GTB Enclave	22571986	32	PP1	MNWS Greater Kailash	18001024669
8	NE3	New Seelam Pur	22182253	33	PP2	MVV R K Puram	18001037232
9	CZ1	Jhandewalan	23612792	34	PP2	MVV Mehrauli	18001037232
10	NW4	Kewal Park	27675270	35	EZ1	Proel Vihar	22444424
11	NZ2	Mukherjee Nagar	27606627	36	EZ2	Shiv Puri	22047239
12	WZ3	Paschim Vihar	25252797	37	EZ2	Yojna Vihar	22158119
12	NZ2	Burari	27613757	38	EZ1	Mayur Vihar	22758551
14	PP3	NWS BHERA ENCLAVE	180030000136	39	EZ1	MANDAWALI	22444424
15	PP3	NWS Mohan Garden	18001020389	40	NW2	Narela	27281673
16	SW1	Kakrola More	8851254848	41	NW2	Rohini	27040004
17	WZ1	Janak Puri	25557475	42	NW3	Kanhalya Nagar	27395044
18	PP3	Nangloi Water Service	27675270	43	NW3	Ashok Vihar	27301456
19	WZ1	Rajouri Garden	8800233484	44	CZ2	Tibbiya College	23546251
20	SW4	Dwarka	28082442				
21	WZ2	Rajendra Nagar	25724938				
22	SW2	Vasant Kunj	26897787				
23	SZ1	Saket	29561916				
24	SZ2	Giri Nagar	26212219				
25	SZ4	Sanita Vihar	29941159				

Tariff consists of following components:

- Water to be measured on volumetric charges of water consumed as reported in meter.
- Sewerage maintenance charge- @60% of water volumetric consumption charges.
- Service Charges-Levied on the basis of slab wise consumption.
- Meter rent in case meter has been provided by DJB.

How to Calculate Bill- Divide the total units consumed by number of days for which bill has been issued and multiply by 30 to give per month average water consumption. Water consumption charge (multiplying monthly charge by the actual period of reading) will be calculated as per tariff for the respective category as mentioned above. Sewerage maintenance charge will be 60% of water consumption charges. Add service charges as per respective category and Consumption slab. It will give you the bill amount.

New Code	Meter Status	New Code	Meter Status
OK	OK	RDDT	Reading Detained
NUW	NO Use Of Water	TEST	Meter Under Testing
PLUG	Plugged	DFMT	Defective Meter
DEM	Demolished	STP	Stopped
PLOC	Premises Locked	MTTM	Meter Tempered
NRES	NO Response	MREV	Meter Reverse
MBUR	Meter Buried	UNMT	Running Unmetered
VMMT	Vapoured/Moistured Meter	BYPS	T-Joint/ByPass
DUST	Dusty Meter	CUT	Meter Cut-Off
MLOC	Meter Locked	ADF	Access Denied/Refused
UOM		Unit Of Measurement	

As can be observed from the tariff that Delhi Jal Board emphasizes on the conservation of water and tariff is designed on the principle- 'Use More Pay More'. Hence, consumers are advised to conserve water by:-

- Plugging all leakages in pipes, joints, taps, overhead tanks etc.
- To use kitchen waste water for gardening purposes.
- To wash vehicle etc. by bucket instead of pipe.
- Install valve before meter and close it when water is not use.
- Consumers should use MDPE pipes for underground position for carrying portable water.

Note: Payment in respect of New water connection, mutation, disconnection and reopening cases should be made within prescribed time, failure may result in withdrawal of sanction.

Any work on DJB Water & Sewer Lines can be allowed only through Licensed Plumber or Authorized Agency of DJB with prior approval/sanction.

For any issue related to water, contamination, tanker or sewerage consumer can call **CUSTOMER CARE NUMBER No. 1916- Extn. 1** or visit www.delhijalboard.nic.in



STOP CORONA:
 I. Wear Mask.
 II. Follow Physical Distancing.
 III. Maintain Hand Hygiene.

Delhi Jal Board (दिल्ली जल बोर्ड)

(Government of NCT of Delhi)

www.djb.gov.in

Regular Water Bill



Name(नाम): M/S.BALAJI HOSPITAL
(MEDICAL INSTITUTE)

Address(पता): A-4/(FC-34), PASCHIM VIHAR, Delhi

Mobile No. (मोबाइल): 9288877015

Zone/Loc (क्षेत्र / स्थान): / Kanhaiya Nagar

Area Code (एरिया कोड): A-1

MR Code (एमआर कोड): 296/BULK

KNO(केएनओ): 6056471000

Consumer Category(उपभोक्ता श्रेणी): CAT II

Premise Detail (परिसर विवरण): (No of floors-1)

Meter No. (मीटर संख्या): NA

Meter Type (मीटर का प्रकार) (DJB/Pvt): PVT

Bill No. (बिल संख्या): 605746153078

Bill Cycle(बिल चक्र): ZALL(B4-2024)

Bill Basis(बिल आधार): REGULAR

Bill Date(बिल की तिथि):

29-JUL-2024

Bill Amount (Rs.) (बिल राशि (₹))

118379

Bill Amount Payable (Rs.) (देय बिल राशि (₹))

(Nearest up to Rs. 10) (लगभग 10 रु. तक)

118380

Bill Due Date(बिल देय तिथि):

16-AUG-2024

Amount Payable After Due Date (Rs.)

(देय तिथि केबाद देय राशि (₹))

124298

Meter No (मीटर संख्या)	UoM (मीटर)	Current Meter Read (मीटर की वर्तमान रीडिंग)		Previous Meter Read (मीटर की पिछली रीडिंग)		Consumption (छपत)	
		Meter Reading Date (मीटर रीडिंग की तारीख)	Reading / Meter Status (रीडिंग / मीटर स्थिति)	Meter Reading Date (मीटर रीडिंग की तारीख)	Reading / Meter Status (रीडिंग / मीटर स्थिति)	Days (दिन)	Units (शूनिट)
NA	KL	29-JUL-2024	20958 / OK	27-JUN-2024	20497 / OK	32	461

Bill Details: Current Period Charges (बिल विवरण: वर्तमान अवधि शुल्क) (27-JUN-2024 to 29-JUL-2024)

Applicable Rate Period	Description	Amount(Rs.)
28-JUN-2024 to 29-JUL-2024	Total Consumption Charges	72832.14
28-JUN-2024 to 29-JUL-2024	Sewerage Charge (60 % of Water Consumption Charge)	43699.28
28-JUN-2024 to 29-JUL-2024	Service Charge - Consumption > 100 KL	1405.54
28-JUN-2024 to 29-JUL-2024	Additional Sewerage Maintenance Charge for Hospitals/NH	21333.33
28-JUN-2024 to 29-JUL-2024	Sub Total Bill Amount without Meter Rent	139270.28
28-JUN-2024 to 29-JUL-2024	Discount for WH or WWR(10% of Total Water Bill)	-13927.03
28-JUN-2024 to 29-JUL-2024	Discount for both WH & WWR(5% of Total Water Bill)	-6963.51
28-JUN-2024 to 29-JUL-2024	Subtotal Bill Amount	118379.75
Adjustment Details Are Listed Below .		

Arrear, If any (Rs.) (वकाया, यदि कोई (₹))

-0.77

Total Consolidated Bill Amount Payable (Rs.) (कुल समेकित बिल राशि देय (₹))

118379

Late Payment Surcharge (Rs.) (देय से भुगतान पर अधिभार)
(5% surcharge will be applicable after due date)(देय तिथि केबाद 5% अधिभार नामु होगा)

5918 Amount with LPSC after due date (Rs.)

(देय तिथि के बाद अधिभार के साथ राशि (₹))

124298

PAYABLE AMOUNT TO AVAIL REBATE SCHEME (Rs.) (छूट योजना के लिए देय राशि (₹))

Bill History (पिछला बिल)							Payment History (पिछला भुगतान)		
Bill from Date	Bill to Date	Days	Reading	Status	Units	Amount(Rs)	Receipt Id	Amount(Rs)	Date
27-MAY-2024	27-JUN-2024	31	20497	OK	442	113579	605472037291	113579.00	15-JUL-2024
18-APR-2024	27-MAY-2024	39	20055	OK	513	132606	605328832481	132610.00	11-JUN-2024
23-MAR-2024	18-APR-2024	26	19542	OK	405	103451	605269443888	103450.00	15-MAY-2024
20-FEB-2024	23-MAR-2024	32	10137	OK	453	114885	605345054918	114890.00	06-APR-2024
19-DEC-2023	20-FEB-2024	63	18684	OK	1127	-1584	605563757592	292520.00	15-FEB-2024

Important Message

01 AUG 2024

If bill is not paid till Bill Due Date- connection may be disconnected (यदि बिल देय तिथि तक बिल का भुगतान नहीं किया जाता है- कनेक्शन काट दिया जा सकता है)
For any assistance / query : Please call 1916 or www.djb.gov.in (किसी भी सहायता / जानकारी के लिए: 1916 पर कॉल करें या www.djb.gov.in पर जाएं)



Delhi Jal Board
Bill Payment Counter Foil

Cheque / DD should be drawn in favour of DJB in the following format
(रेक / डिमांड ड्राफ्ट द्वारा भुगतान करने के लिए निम्न कार्ड का उपयोग करें) DJB KNO

KNO(केएनओ)	6056471000	Name(नाम)	M/S.BALAJI HOSPITAL (MEDICAL INSTITUTE)	Bill No. (बिल संख्या)	605746153078
Bill Date(बिल की तिथि)	29-JUL-2024	Bill Due Date (बिल देय तिथि)	16-AUG-2024	Bill Amount (Rs.) (बिल राशि (₹))	118379
Bill Amount with LPSC (Rs.) (LPSC के साथ बिल राशि (₹)):	124298	Payment Date/ (भुगतान की तारीख)		Cash/Cheque No./DD No.:	
(LPSC के साथ बिल राशि (₹)):		Amount Paid(Rs.) (राशि का भुगतान (₹))		(केश / चेक नंबर / डीडी नं.):	

[Signature]

<input type="text"/>	Name of Bank / Branch (बँक / शाखा का नाम)	<input type="text"/>
----------------------	--	----------------------

Tariff Structure for monthly consumption w.e.f 01-02-2018

Category	Monthly Consumption (KL)	Service Charge (Rs)	Volumetric Charge (Rs. per KL)
Category - I(Domestic)	Up-to 20	146.41	5.27
	20-30	219.62	26.36
	Above 30	292.82	43.93
Category - II(Non-Domestic)	0-8	148.41	17.57
	8-15	292.82	26.35
	15-25	585.64	35.14
	25-50	1024.87	87.85
	50-100	1171.28	140.56
	100-above	1317.69	175.69

Note: To ensure proper implementation of Rain Water Harvesting and Waste Water Recycling norms and incompliance of Building Byelaws, it will be mandatory for plots/properties having area of 100 Sq. Mtrs. or more to have functional Rain Water Harvesting System, even if the property is constructed prior to 28-07-2001. Such plot/property owning consumers would be required to install functional Rain Water Harvesting System and will get rebate on water bill. In case, consumer fail to comply with the aforesaid mandatory provision within the time limit prescribed, the traffic as applicable for respective consumer category will be increased by 1.5 times, till the system is installed and intimated to the respective Zonal Revenue officer. Functionality certificate of RWH need to be given in the month of 'May' of every year in ZRO Office.

Payment Facilities:

Besides DJB ZRO Offices listed below, consumers can make payment online through e-payment gateways of Axis Bank, Utkarsh Bank, IDBI & Union Bank at Customer portal (www.djb.gov.in) and branches of authorized bank at IDBI Bank. Payment can also be made online through e-wallets, Net Banking, Debit/Credit Card, UPI etc. though any agency under Bharat Bill Payment System (BBPS) viz Paytm, Google Pay, Phone Pay, Amazon Pay, Freecharge & other major banks. Cheque may be issued in favor of "DJB KNO XXXXXXXXX", where XXXXXXXXX represent 10-digit of New K. No. of the consumer mentioned on the bill.

Payment may be made through NEFT/RTGS to DJB A/C using Utkarsh Small Finance Bank Limited, Axis Bank Ltd, South Indian Bank Ltd. & IDBI Banks. Please visit Customer portal (www.djb.gov.in) - Pay Online > Pay through NEFT/RTGS for details of beneficiary account.

- For any issue related to reading, billing, the consumer can call **CUSTOMER CARE NUMBER No. 1916- Extn. 2** and take online complaint No. instantly, Consumer can avail different online facilities regarding New Connection, Mutation, Re-Opening, Disconnection, online payments and register grievances through Customer portal (www.djb.gov.in). Please use your New K.NO for all communication with DJB. Consumer can contact concerned ZRO or his Dy. Director Revenue or Joint Director Revenue to resolve all billing and application regarding New Connection, Mutation, Re-Opening, Disconnection and Payment related grievance at following:

SL.No	Zone	ZRO Location and Collection Counter	Office No.	SL.No	Zone	ZRO Location and Collection Counter	Office No.
1	NW1	Sultan Puri	25476298	26	CZ2	Pratap Nagar	23692201
2	WZ1	Subhash Nagar	25408765	27	SW3	R K Puram	26193424
3	WZ2	Punjabi Bagh	25223568	28	SZ2	Lajpat Nagar	29814106
4	NW1	Kirari	8920657545	29	SZ3	Greater Kailash	29239668
5	NE1	Shahadara	22591171	30	PP1	MNWS R K Puram	18001024669
6	NE2	Yamuna Vihar	22910491	31	PP1	MNWS Mehrauli	18001024669
7	NE1	GTB Enclave	22571986	32	PP1	MNWS Greater Kailash	18001024669
8	NE3	New Seelam Pur	22182253	33	PP2	MVV R K Puram	18001037232
9	CZ1	Jhandewalan	23612792	34	PP2	MVV Mehrauli	18001037232
10	NW4	Kewal Park	27675270	35	EZ1	Preet Vihar	22444424
11	NZ2	Mukherjee Nagar	27606627	36	EZ2	Shiv Puri	22047239
12	WZ3	Paschim Vihar	25252797	37	EZ2	Yojna Vihar	22158119
12	NZ2	Burari	27613757	38	EZ1	Mayur Vihar	22759551
14	PP3	NWS BHERA ENCLAVE	180030000136	39	EZ1	MANDAWALI	22444424
15	PP3	NWS Mohan Garden	18001020389	40	NW2	Narela	27281673
16	SW1	Kakrola More	8851254848	41	NW2	Rohini	27040004
17	WZ1	Janak Puri	25557475	42	NW3	Kanhaiya Nagar	27395044
18	PP3	Nangloi Water Service	27675270	43	NW3	Ashok Vihar	27301456
19	WZ1	Rajouri Garden	8800233484	44	CZ2	Tibbiya College	23546251
20	SW4	Dwarka	28082442				
21	WZ2	Rajendra Nagar	25724938				
22	SW2	Vasant Kunj	26897787				
23	SZ1	Saket	29561916				
24	SZ2	Giri Nagar	26212219				
25	SZ4	Sarita Vihar	29941159				

As can be observed from the tariff that Delhi Jal Board emphasizes on the conservation of water and tariff is designed on the principle- 'Use More Pay More'. Hence, consumers are advised to conserve water by:-

- Plugging all leakages in pipes, joints, taps, overhead tanks etc.
- To use kitchen waste water for gardening purposes.
- To wash vehicle etc. by bucket instead of pipe.
- Install valve before meter and close it when water is not use.
- Consumers should use MDPE pipes for underground position for carrying portable water.

Tariff consists of following components:

- Water-to be measured on volumetric charges of water consumed as reported in meter.
- Sewerage maintenance charge- @60% of water volumetric consumption charges.
- Service Charges-Levied on the basis of slab wise consumption.
- Meter rent in case meter has been provided by DJB.

How to Calculate Bill- Divide the total units consumed by number of days for which bill has been issued and multiply by 30 to give per month average water consumption. Water consumption charge (multiplying monthly charge by the actual period of reading) will be calculated as per tariff for the respective category as mentioned above. Sewerage maintenance charge will be 60% of water consumption charges. Add service charges as per respective category and Consumption slab. It will give you the bill amount

Abbreviations on bill:

New Code	Meter Status	New Code	Meter Status
OK	OK	RDDT	Reading Detained
NUW	NO Use Of Water	TEST	Meter Under Testing
PLUG	Plugged	DFMT	Defective Meter
DEM	Demolished	STP	Stopped
PLOC	Premises Locked	MTTM	Meter Tempered
NRES	NO Response	MREV	Meter Reverse
MBUR	Meter Buried	UNMT	Running Unmetered
VMMT	Vapoured/Moistured Meter	BYPS	T-Joint/ByPass
DUST	Dusty Meter	CUT	Meter Cut-Off
MLOC	Meter Locked	ADF	Access Denied/Refused
UOM		Unit Of Measurement	

Note: Payment in respect of New water connection, mutation, disconnection and reopening cases should be made within prescribed time, failure may result in withdrawal of sanction.

Any work on DJB Water & Sewer Lines can be allowed only through Licensed Plumber or Authorized Agency of DJB with prior approval/sanction.

For any issue related to water, contamination, tanker or sewerage consumer can call **CUSTOMER CARE NUMBER No. 1916- Extn. 1** or visit www.delhijalboard.nic.in



STOP CORONA:
 I. Wear Mask.
 II. Follow Physical Distancing.
 III. Maintain Hand Hygiene.

Delhi Jal Board (दिल्ली जल बोर्ड)

(Government of NCT of Delhi)

www.djb.gov.in

Regular Water Bill



SAVE RAIN WATER
INSTALL RAIN WATER HARVESTING

Catch the Rain
www.djb.gov.in



Name(नाम): M/S.BALAJI HOSPITAL
(MEDICAL INSTITUTE)
Address(पता): A-4/(FC-34), PASCHIM VIHAR, Delhi
Mobile No. . (मोबाइल): 9288877015
Zone/Loc (लोक / स्थान): / Kanhaiya Nagar
Area Code (एरिया कोड): A-1
MR Code (एमआर कोड): 296/BULK
KNO(केएनओ): 6056471000

Consumer Category(उपभोक्ता श्रेणी): CAT II
Premise Detail (परिसर विवरण): (No of floors-1)
Meter No. (मीटर संख्या): NA
Meter Type (मीटर का प्रकार) (DJB/Pvt): PVT
Bill No. (बिल संख्या): 605634962814
Bill Cycle(बिल चक्र): ZALL(B6-2024)
Bill Basis(बिल आधार): REGULAR

Bill Date(बिल की तिथि)
23-SEP-2024

Bill Amount (Rs.) (बिल राशि (रु))
101503

Bill Amount Payable (Rs.) (देय बिल राशि (रु))
(Nearest up to Rs. 10) (लगभग 10 रु. तक)
101500

Bill Due Date(बिल देय तिथि)
10-OCT-2024

Amount Payable After Due Date(Rs.)
(देय तिथि के बाद देय राशि (रु))
106578

Meter No (मीटर संख्या)	UoM (मीटर संख्या)	Current Meter Read (मीटर की वर्तमान रीडिंग)		Previous Meter Read (मीटर की पिछली रीडिंग)		Consumption (खपत)	
		Meter Reading Date (मीटर रीडिंग की तारीख)	Reading / Meter Status (रीडिंग / मीटर स्थिति)	Meter Reading Date (मीटर रीडिंग की तारीख)	Reading / Meter Status (रीडिंग / मीटर स्थिति)	Days (दिन)	Units (गुणित)
NA	KL	23-SEP-2024	21860 / OK	30-AUG-2024	21461 / OK	24	399

Bill Details: Current Period Charges (बिल विवरण: वर्तमान अवधि शुल्क) (30-AUG-2024 to 23-SEP-2024)

Applicable Rate Period	Description	Amount(Rs.)
31-AUG-2024 to 23-SEP-2024	Total Consumption Charges	63979.69
31-AUG-2024 to 23-SEP-2024	Sewerage Charge (60 % of Water Consumption Charge)	38387.81
31-AUG-2024 to 23-SEP-2024	Service Charge - Consumption > 100 KL	1054.15
31-AUG-2024 to 23-SEP-2024	Additional Sewerage Maintenance Charge for Hospitals/NH	16000.00
31-AUG-2024 to 23-SEP-2024	Sub Total Bill Amount without Meter Rent	119421.65
31-AUG-2024 to 23-SEP-2024	Discount for WH or WWR(10% of Total Water Bill)	-11942.17
31-AUG-2024 to 23-SEP-2024	Discount for both WH & WWR(5% of Total Water Bill)	-5971.08
31-AUG-2024 to 23-SEP-2024	Subtotal Bill Amount	101508.40
	Adjustment Details Are Listed Below	

Arrear, If any (Rs.) (बकाया, यदि कोई (रु))

-5.86

Total Consolidated Bill Amount Payable (Rs.) (कुल समेकित बिल राशि देय (रु))

101503

Late Payment Surcharge (Rs.) (देय से भुगतान पर अधिभार)
(5% surcharge will be applicable after due date) (देय तिथि के बाद 5% अधिभार लागू होगा)

5075
.13 **Amount with LPSC after due date (Rs.)**

106578

देय तिथि के बाद अधिभार के साथ राशि (रु)

PAYABLE AMOUNT TO AVAIL REBATE SCHEME (Rs.) (कूट योजना के लिए देय राशि (रु))

Bill History (पेटला बिल)							Payment History (पेटला भुगतान)		
Bill from Date	Bill to Date	Days	Reading	Status	Units	Amount(Rs)	Receipt Id	Amount(Rs)	Date
29-JUL-2024	30-AUG-2024	32	21461	OK	503	128415	605653260172	128420.00	10-SEP-2024
27-JUN-2024	29-JUL-2024	32	20958	OK	481	118379	605577013786	118380.00	14-AUG-2024
27-JUN-2024	27-JUN-2024	31	20497	OK	442	113579	605472037291	113579.00	15-JUL-2024
18-APR-2024	27-MAY-2024	39	20055	OK	513	132606	605328832481	132610.00	11-JUN-2024
23-MAR-2024	18-APR-2024	26	19542	OK	405	103451	605269443888	103450.00	15-MAY-2024

Important Message

Sign/Stamp

If bill is not paid till Bill Due Date- connection may be disconnected (यदि बिल देय तिथि तक जिल जी भुगतान नहीं किया जाता है- कनेक्शन काट दिया जा सकता है)

For any assistance / query : Please call 1916 or www.djb.gov.in (किसी भी सहायता / जानकारी के लिए: 1916 पर कॉल करें या www.djb.gov.in पर जाएं)

Delhi Jal Board Bill Payment Counter Foil				Cheque / DD should be drawn in favour of DJB in the following format (वेक्ष / डिमांड ड्राइव द्वारा भुगतान करने के लिए निम्न फॉर्मेट का उपयोग करें) DJB KNO		
KNO(केएनओ)	6056471000	Name(नाम)	M/S.BALAJI HOSPITAL (MEDICAL INSTITUTE)	Bill No. (बिल संख्या)	605634962814	
Bill Date(बिल की तिथि)	23-SEP-2024	Bill Due Date (बिल देय तिथि)	10-OCT-2024	Bill Amount (Rs.) (बिल राशि (रु))	101503	
Bill Amount with LPSC (Rs.): (LPSC के साथ बिल राशि (रु)):	106578	Payment Date/ (भुगतान की तारीख)		Cash/Cheque No./DD No.:		
		Amount Paid(Rs.) (राशि का भुगतान (रु))		(केवा / वेक्ष नंबर / डीची नं.)		

30 SEP 2024

_____	Name of Bank / Branch (बँक / शाखा का नाम)	_____
-------	---	-------

Tariff Structure for monthly consumption w.e.f 01-02-2018

Category	Monthly Consumption (KL)	Service Charge (Rs)	Volumetric Charge (Rs. per KL)
Category - I(Domestic)	Up-to 20	146.41	5.27
	20-30	219.62	26.36
	Above 30	292.82	43.93
Category - II(Non-Domestic)	0-6	146.41	17.57
	6-15	292.82	26.35
	15-25	585.64	35.14
	25-50	1024.87	87.85
	50-100	1171.28	140.56
	100-above	1317.69	175.69

Note: To ensure proper implementation of Rain Water Harvesting and Waste Water Recycling norms and incompliance of Building Byelaws, it will be mandatory for plots/properties having area of 100 Sq. Mtrs. or more to have functional Rain Water Harvesting System, even if the property is constructed prior to 28-07-2001. Such plot/property owning consumers would be required to install functional Rain Water Harvesting System and will get rebate on water bill. In case, consumer fail to comply with the aforesaid mandatory provision within the time limit prescribed, the traffic as applicable for respective consumer category will be increased by 1.5 times, till the system is installed and intimated to the respective Zonal Revenue officer. Functionality certificate of RWH need to be given in the month of 'May' of every year in ZRO Office.

Payment Facilities:

Besides DJB ZRO Offices listed below, consumers can make payment online through e-payment gateways of Axis Bank, Utkarsh Bank, IDBI & Union Bank at Customer portal (www.djb.gov.in) and branches of authorized bank at IDBI Bank. Payment can also be made online through e-wallets, Net Banking, Debit/Credit Card, UPI etc. through any agency under Bharat Bill Payment System (BBPS) viz Paytm, Google Pay, Phone Pay, Amazon Pay, Freecharge & other major banks. Cheque may be issued in favor of "DJB KNO XXXXXXXXXX", where XXXXXXXXXX represent 10-digit of New K. No. of the consumer mentioned on the bill.

Payment may be made through NEFT/RTGS to DJB A/C using Utkarsh Small Finance Bank Limited, Axis Bank Ltd, South Indian Bank Ltd. & IDBI Banks. Please visit Customer portal (www.djb.gov.in) - Pay Online > Pay through NEFT/RTGS for details of beneficiary account.

- For any issue related to reading, billing, the consumer can call **CUSTOMER CARE NUMBER No. 1916- Extn. 2** and take online complaint No. instantly. Consumer can avail different online facilities regarding New Connection, Mutation, Re-Opening, Disconnection, online payments and register grievances through Customer portal (www.djb.gov.in). Please use your New K.NO for all communication with DJB. Consumer can contact concerned ZRO or his Dy. Director Revenue or Joint Director Revenue to resolve all billing and application regarding New Connection, Mutation, Re-Opening, Disconnection and Payment related grievance at followings:

SL.No	Zone	ZRO Location and Collection Counter	Office No.	SL.No	Zone	ZRO Location and Collection Counter	Office No.
1	NW1	Sultan Pur	25476298	26	CZ2	Pratap Nagar	23692201
2	WZ1	Subhash Nagar	25408765	27	SW3	R K Puram	26193424
3	WZ2	Punjabi Bagh	25223568	28	SZ2	Lajpat Nagar	29814106
4	NW1	Kiran	8920657545	29	SZ3	Greater Kailash	29239668
5	NE1	Shahadara	22591171	30	PP1	MNWS R K Puram	18001024689
6	NE2	Yamuna Vihar	22910491	31	PP1	MNWS Mehrauli	18001024669
7	NE1	GTB Enclave	22571986	32	PP1	MNWS Greater Kailash	18001024669
8	NE3	New Seelam Pur	22182253	33	PP2	MVV R K Puram	18001037232
9	CZ1	Jhandewalan	23612792	34	PP2	MVV Mehrauli	18001037232
10	NW4	Kewal Park	27675270	35	EZ1	Preet Vihar	22444424
11	NZ2	Mukherjee Nagar	27606627	36	EZ2	Shiv Puri	22047239
12	WZ3	Paschim Vihar	25252797	37	EZ2	Yojna Vihar	22158119
12	NZ2	Burari	27613757	38	EZ1	Mayur Vihar	22759551
14	PP3	NWS BHERA ENCLAVE	180030000136	39	EZ1	MANDAWALI	22444424
15	PP3	NWS Mohan Garden	18001020389	40	NW2	Narela	27281673
16	SW1	Kakrola More	8851254848	41	NW2	Rohini	27040004
17	WZ1	Janak Puri	25557475	42	NW3	Kanhaiya Nagar	27395044
18	PP3	Nanglo Water Service	27675270	43	NW3	Ashok Vihar	27301456
19	WZ1	Rajouri Garden	8800233484	44	CZ2	Tibbiya College	23546251
20	SW4	Dwarka	28082442				
21	WZ2	Rajendra Nagar	25724938				
22	SW2	Vasant Kunj	26897787				
23	SZ1	Saket	29561916				
24	SZ2	Giri Nagar	26212219				
25	SZ4	Santa Vihar	29941159				

As can be observed from the tariff that Delhi Jal Board emphasizes on the conservation of water and tariff is designed on the principle- 'Use More Pay More'. Hence, consumers are advised to conserve water by:-

- Plugging all leakages in pipes, joints, taps, overhead tanks etc.
- To use kitchen waste water for gardening purposes.
- To wash vehicle etc. by bucket instead of pipe.
- Install valve before meter and close it when water is not use.
- Consumers should use MDPE pipes for underground position for carrying portable water.

Tariff consists of following components:

- Water-to be measured on volumetric charges of water consumed as reported in meter.
- Sewerage maintenance charge- @60% of water volumetric consumption charges.
- Service Charges-Levied on the basis of slab wise consumption.
- Meter rent in case meter has been provided by DJB.

How to Calculate Bill- Divide the total units consumed by number of days for which bill has been issued and multiply by 30 to give per month average water consumption. Water consumption charge (multiplying monthly charge by the actual period of reading) will be calculated as per tariff for the respective category as mentioned above. Sewerage maintenance charge will be 60% of water consumption charges. Add service charges as per respective category and Consumption slab. It will give you the bill amount.

Abbreviations on bill:

New Code	Meter Status	New Code	Meter Status
OK	OK	RDDT	Reading Detained
NUW	NO Use Of Water	TEST	Meter Under Testing
PLUG	Plugged	DFMT	Defective Meter
DEM	Demolished	STP	Stopped
PLOC	Premises Locked	MTTM	Meter Tempered
NRES	NO Response	MREV	Meter Reverse
MBUR	Meter Buried	UNMT	Running Unmetered
VMMT	Vapoured/Moistured Meter	BYPS	T-Joint/ByPass
DUST	Dusty Meter	CUT	Meter Cut-Off
MLOC	Meter Locked	ADF	Access Denied/Refused
UOM		Unit Of Measurement	

Note: Payment in respect of New water connection, mutation, disconnection and reopening cases should be made within prescribed time, failure may result in withdrawal of sanction.

Any work on DJB Water & Sewer Lines can be allowed only through Licensed Plumber or Authorized Agency of DJB with prior approval/sanction.

For any issue related to water, contamination, tanker or sewerage consumer can call **CUSTOMER CARE NUMBER No. 1916- Extn. 1** or visit www.delhijalboard.nic.in

Annexure-XI
Copy of STP LOG Book

LOG BOOK

Shri Balaji Action Medical Institute, Paschim Vihar, Delhi

Sewage Treatment Plant - 600 KLD

Star Water Solutions		Sewage Treatment Plant - 600 KLD																			
Time	Sewage Transfer Pump	Sludge Recycling Pump	Air Blower		Hypo Dosing Pump	Filter Feed Pump	Screw Pump	Filter Press	Ultra-Violet System	Flushing Water Pump	Multi-Grade Filter	Activated Carbon Filter	Ultra Filtration Feed Pump	Ultra Filtration	Reverse Osmosis						
Hours	SP-1	SP-2	SRP-1	SRP-2	AB-1	AB-2	AB-3	HDS	FFP-1	FFP-2	SP-1	SP-1	FP	UV	FWTP	MGF	ACF	UFP-1	UFP-2	UF	RO
7.00	ON	—	—	—	ON	—	ON	—	—	—	—	—	—	ON	—	ON	—	ON	—	ON	—
8.00	ON	—	ON	—	ON	—	ON	—	—	—	—	—	—	ON	—	ON	—	ON	—	ON	—
9.00	ON	—	ON	—	ON	—	ON	—	—	—	—	—	—	ON	—	ON	—	ON	—	ON	—
10.00	—	—	ON	—	—	—	—	—	—	—	—	—	—	ON	—	ON	—	ON	—	ON	—
11.00	ON	—	ON	—	ON	—	ON	—	—	—	—	—	—	ON	—	ON	—	ON	—	ON	—
12.00	—	—	—	—	—	—	—	—	—	—	—	—	—	ON	—	ON	—	ON	—	ON	—
13.00	—	—	—	—	—	—	—	—	—	—	—	—	—	ON	—	ON	—	ON	—	ON	—
14.00	—	—	—	—	—	—	—	—	—	—	—	—	—	ON	—	ON	—	ON	—	ON	—
15.00	—	—	—	—	—	—	—	—	—	—	—	—	—	ON	—	ON	—	ON	—	ON	—
16.00	—	—	—	—	—	—	—	—	—	—	—	—	—	ON	—	ON	—	ON	—	ON	—
17.00	—	—	—	—	—	—	—	—	—	—	—	—	—	ON	—	ON	—	ON	—	ON	—
18.00	ON	—	ON	—	ON	—	ON	—	—	—	—	—	—	ON	—	ON	—	ON	—	ON	—
19.00	—	—	ON	—	ON	—	ON	—	—	—	—	—	—	ON	—	ON	—	ON	—	ON	—
20.00	ON	—	—	—	—	—	—	—	—	—	—	—	—	ON	—	ON	—	ON	—	ON	—
21.00	—	ON	—	—	ON	—	ON	—	—	—	—	—	—	ON	—	ON	—	ON	—	ON	—
22.00	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
23.00	ON	—	—	—	ON	—	ON	—	—	—	—	—	—	ON	—	ON	—	ON	—	ON	—
0.00	—	ON	—	—	—	—	—	—	—	—	—	—	—	ON	—	ON	—	ON	—	ON	—
1.00	ON	—	—	—	ON	—	ON	—	—	—	—	—	—	ON	—	ON	—	ON	—	ON	—
2.00	—	ON	—	—	—	—	—	—	—	—	—	—	—	ON	—	ON	—	ON	—	ON	—
3.00	ON	—	—	—	ON	—	ON	—	—	—	—	—	—	ON	—	ON	—	ON	—	ON	—
4.00	—	—	—	—	—	—	—	—	—	—	—	—	—	ON	—	ON	—	ON	—	ON	—
5.00	—	—	—	—	—	—	—	—	—	—	—	—	—	ON	—	ON	—	ON	—	ON	—
6.00	—	ON	—	—	—	—	—	—	—	—	—	—	—	ON	—	ON	—	ON	—	ON	—
	—	ON	—	—	—	—	—	—	—	—	—	—	—	ON	—	ON	—	ON	—	ON	—

Client Signature

Flow Meter Reading		
Meter	Previous	Present
Inlet	984469	984663
Outlet	965069	905200

Backwash	Shift A	Shift B	Shift C	General	Shift - A	Shift - B	Shift - C	Sign
MGF	50m	80m	—	—	—	—	—	—
ACF	45	25m	25m	—	—	—	—	—

Remarks

Star Water
Solutions

Date: 31-07-24


LOG BOOK
Shri Balaji Action Medical Institute, Paschim Vihar, Delhi
Sewage Treatment Plant - 600 KLD

Time	Sewage Transfer Pump		Sludge Recycling Pump		Air Blower		Hypo Dosing Pump		Filter Feed Pump		Screw Pump		Filter Press		Ultra Violet System		Water Transfer Pump		Flushing Pump		Multi Grade Filter		Activated Carbon Filter		Ultra Filtration Feed Pump		Ultra Filtration		Reverse Osmosis	
	STP-1	STP-2	SRP-1	SRP-2	AB-1	AB-2	AB-3	HDS	FPP-1	FPP-2	SP-1	SP-1	FP	UV	FWRP	MGF	ACF	UFP-1	UFP-2	UF	RO									
Hours																														
7:00	ON	-	-	-	ON	-	-	ON	ON	-	-	-	-	-	-	ON	ON	ON	ON	-	-	-	-	-	-	-	-	-		
8:00	-	-	-	-	ON	-	-	ON	-	ON	-	-	-	-	-	ON	-	-	-	-	-	-	-	-	-	-	-	-		
9:00	ON	-	-	-	-	ON	-	ON	-	ON	-	-	-	-	-	ON	-	-	-	-	-	-	-	-	-	-	-	-		
10:00	-	ON	-	-	-	-	ON	-	ON	-	ON	-	-	-	-	ON	-	-	-	-	-	-	-	-	-	-	-	-		
11:00	ON	-	-	-	-	ON	-	ON	-	ON	-	-	-	-	-	ON	-	-	-	-	-	-	-	-	-	-	-	-		
12:00	-	ON	-	-	-	-	ON	-	ON	ON	-	-	-	-	-	ON	ON	-	-	-	-	-	-	-	-	-	-	-		
13:00	ON	-	-	-	-	ON	-	ON	-	ON	ON	-	ON	-	ON	ON	-	-	-	-	-	-	-	-	-	-	-	-		
14:00	-	ON	-	-	-	ON	-	ON	-	ON	-	ON	-	ON	-	ON	-	-	-	-	-	-	-	-	-	-	-	-		
15:00	ON	-	-	-	-	ON	-	ON	-	ON	-	-	-	-	-	ON	-	-	-	-	-	-	-	-	-	-	-	-		
16:00	-	ON	-	-	-	ON	-	ON	-	ON	ON	-	ON	-	ON	ON	-	-	-	-	-	-	-	-	-	-	-	-		
17:00	ON	-	-	-	-	ON	-	ON	-	ON	-	-	-	-	-	ON	-	-	-	-	-	-	-	-	-	-	-	-		
18:00	-	-	-	-	-	ON	-	ON	-	ON	-	-	-	-	-	ON	ON	-	-	-	-	-	-	-	-	-	-	-		
19:00	ON	-	-	-	-	ON	-	ON	-	ON	-	-	-	-	-	ON	-	-	-	-	-	-	-	-	-	-	-	-		
20:00	ON	ON	-	-	-	ON	-	ON	-	ON	ON	-	ON	-	ON	ON	-	-	-	-	-	-	-	-	-	-	-	-		
21:00	ON	-	-	-	-	ON	-	ON	-	ON	ON	-	ON	-	ON	ON	-	-	-	-	-	-	-	-	-	-	-	-		
22:00	-	-	-	-	-	ON	-	ON	-	ON	ON	-	ON	-	ON	ON	-	-	-	-	-	-	-	-	-	-	-	-		
23:00	ON	-	-	-	-	ON	-	ON	-	ON	ON	-	ON	-	ON	ON	-	-	-	-	-	-	-	-	-	-	-	-		
0:00	-	ON	-	-	-	ON	-	ON	-	ON	ON	-	ON	-	ON	ON	-	-	-	-	-	-	-	-	-	-	-	-		
1:00	ON	-	-	-	-	ON	-	ON	-	ON	ON	-	ON	-	ON	ON	-	-	-	-	-	-	-	-	-	-	-	-		
2:00	-	-	-	-	-	ON	-	ON	-	ON	ON	-	ON	-	ON	ON	-	-	-	-	-	-	-	-	-	-	-	-		
3:00	-	-	-	-	-	ON	-	ON	-	ON	ON	-	ON	-	ON	ON	-	-	-	-	-	-	-	-	-	-	-	-		
4:00	-	-	-	-	-	ON	-	ON	-	ON	ON	-	ON	-	ON	ON	-	-	-	-	-	-	-	-	-	-	-	-		
5:00	-	-	-	-	-	ON	-	ON	-	ON	ON	-	ON	-	ON	ON	-	-	-	-	-	-	-	-	-	-	-	-		
6:00	ON	-	-	-	-	ON	-	ON	-	ON	ON	-	ON	-	ON	ON	-	-	-	-	-	-	-	-	-	-	-	-		

Flow Meter Reading

Meter	Previous	Present	Consumption
Inlet	902856	903172	316 KLD
Outlet	909159	909362	268 KLD

Client Signature



Operator Shift Sign

Shift A	Shift B	Shift C	General
Shift - A	Shift - B	Shift - C	Saturday
Shift - A	Shift - B	Shift - C	Sunday

Remarks

→ Rec

LOG BOOK

Shri Balaji Action Medical Institute, Paschim Vihar, Delhi

Star Water Solutions		Sewage Treatment Plant - 600 KLD																			
Date: 01/05/24	Time	Sewage Transfer Pump	Sludge Recycling Pump	Air Blower	Hypo Dosing Pump	Filter Feed Pump	Screw Pump	Filter Press	Ultra-Violet System	Flushing Water Transfer Pump	Multi-Grade Filter	Activated Carbon Filter	Ultra Filtration Feed Pump	Ultra Filtration	Reverse Osmosis						
Hours	SP-1	SP-2	SRP-1	SRP-2	AB-1	AB-2	AB-3	HDS	FPP-1	FPP-2	SP-1	SP-1	FP	UV	FWTP	MGF	ACF	UFP-1	UFP-2	UF	RO
7:00	ON	—	—	—	ON	—	—	ON	—	—	—	—	—	—	—	—	—	—	—	—	
8:00	ON	ON	—	—	—	—	—	ON	—	—	—	—	ON	—	ON	ON	—	—	—	ON	
9:00	ON	—	—	—	ON	—	—	ON	ON	ON	—	—	—	—	ON	ON	—	—	—	ON	
10:00	—	—	—	—	ON	—	—	ON	ON	ON	—	—	—	—	ON	ON	—	—	—	ON	
11:00	ON	—	—	—	ON	—	—	ON	—	—	—	—	ON	—	ON	ON	—	—	—	ON	
12:00	—	—	—	—	ON	—	—	ON	—	—	—	—	ON	—	ON	ON	—	—	—	ON	
13:00	ON	—	—	—	ON	—	—	ON	ON	ON	—	—	—	—	ON	ON	—	—	—	ON	
14:00	—	ON	—	—	—	—	—	ON	—	—	—	—	ON	—	ON	ON	—	—	—	ON	
15:00	ON	—	—	—	ON	—	—	ON	ON	ON	—	—	—	—	ON	ON	—	—	—	ON	
16:00	—	ON	—	—	—	—	—	ON	—	—	—	—	—	—	—	—	—	—	—	ON	
17:00	ON	—	—	—	ON	—	—	ON	—	—	—	—	—	—	—	—	—	—	—	ON	
18:00	ON	—	—	—	ON	—	—	ON	—	—	—	—	—	—	—	—	—	—	—	ON	
19:00	ON	—	—	—	ON	—	—	ON	—	—	—	—	—	—	—	—	—	—	—	ON	
20:00	—	—	—	—	ON	—	—	ON	—	—	—	—	—	—	—	—	—	—	—	ON	
21:00	ON	—	—	—	ON	—	—	ON	ON	ON	—	—	—	—	ON	ON	—	—	—	ON	
22:00	ON	ON	—	—	ON	—	—	ON	ON	ON	—	—	—	—	ON	ON	—	—	—	ON	
23:00	ON	—	—	—	ON	ON	—	ON	ON	ON	—	—	—	—	ON	ON	—	—	—	ON	
0:00	ON	ON	—	—	ON	ON	—	ON	ON	ON	—	—	—	—	ON	ON	—	—	—	ON	
1:00	ON	—	—	—	ON	—	—	ON	ON	ON	—	—	—	—	ON	ON	—	—	—	ON	
2:00	—	—	—	—	ON	—	—	ON	—	—	—	—	—	—	—	—	—	—	—	ON	
3:00	—	ON	—	—	—	—	—	ON	ON	ON	—	—	—	—	ON	ON	—	—	—	ON	
4:00	—	ON	—	—	ON	—	—	ON	—	—	—	—	—	—	—	—	—	—	—	ON	
5:00	—	—	—	—	ON	—	—	ON	—	—	—	—	—	—	—	—	—	—	—	ON	
6:00	—	—	—	—	ON	—	—	ON	—	—	—	—	—	—	—	—	—	—	—	ON	

Operator Shift:

Sign

Client Signature

Meter	Previous	Present	Consumption
Inlet	093172	993477	305
Outlet	09367	99586	195

Recycling Both MBBR Tank. Do backwash in shift-B after 1:00

LOG BOOK

Shri Balaji Action Medical Institute
Paschim Vihar, Delhi.

Star Water Solutions

Star Water Solutions		Sewage Treatment Plant - 600 KLD																													
Date	01/08/24	Sewage Transfer Pump		Sludge Recycling Pump		Air Blower		Hypo Dosing Pump		Filter Feed Pump		Screw Pump		Filter Press		Ultra-Violet System		Flushing Pump		Water Transfer Pump		Multi Grade Filter		Activate d Carbon Filter		Ultra Filtration Feed Pump		Ultra Filtration		Reverse Osmosis	
Time	Hour	STP-1	STP-2	SRP-1	SRP-2	AB-1	AB-2	AB-3	HDS	FPP-1	FPP-2	SP-1	SP-2	FP	UV	UV	WTP	MGF	ACF	UFP-1	UFP-2	UF	RO	RO	RO	RO					
7:00	07/01	-	-	-	-	-	-	-	ON	ON	-	-	-	-	-	ON	ON	ON	ON	ON	-	-	-	ON							
8:00	-	-	ON	ON	-	-	-	ON	ON	ON	-	ON	-	-	-	ON	ON	ON	ON	ON	-	-	-	ON							
9:00	-	-	-	-	-	-	-	ON	ON	ON	-	ON	-	-	-	ON	ON	ON	ON	ON	-	-	-	ON							
10:00	ON	-	-	-	-	-	-	ON	ON	ON	-	ON	-	-	-	ON	ON	ON	ON	ON	-	-	-	ON							
11:00	-	ON	-	-	-	-	-	ON	ON	ON	-	ON	-	-	-	ON	ON	ON	ON	ON	-	-	-	ON							
12:00	ON	-	-	-	-	-	-	ON	ON	ON	-	ON	-	-	-	ON	ON	ON	ON	ON	-	-	-	ON							
13:00	-	ON	-	-	-	-	-	ON	ON	ON	-	ON	-	-	-	ON	ON	ON	ON	ON	-	-	-	ON							
14:00	ON	-	-	-	-	-	-	ON	ON	ON	-	ON	-	-	-	ON	ON	ON	ON	ON	-	-	-	ON							
15:00	-	-	-	-	-	-	-	ON	ON	ON	-	ON	-	-	-	ON	ON	ON	ON	ON	-	-	-	ON							
16:00	-	ON	-	-	-	-	-	ON	ON	ON	-	ON	-	-	-	ON	ON	ON	ON	ON	-	-	-	ON							
17:00	ON	-	-	-	-	-	-	ON	ON	ON	-	ON	-	-	-	ON	ON	ON	ON	ON	-	-	-	ON							
18:00	-	ON	-	-	-	-	-	ON	ON	ON	-	ON	-	-	-	ON	ON	ON	ON	ON	-	-	-	ON							
19:00	ON	-	-	-	-	-	-	ON	ON	ON	-	ON	-	-	-	ON	ON	ON	ON	ON	-	-	-	ON							
20:00	-	ON	-	-	-	-	-	ON	ON	ON	-	ON	-	-	-	ON	ON	ON	ON	ON	-	-	-	ON							
21:00	ON	-	-	-	-	-	-	ON	ON	ON	-	ON	-	-	-	ON	ON	ON	ON	ON	-	-	-	ON							
22:00	-	-	-	-	-	-	-	ON	ON	ON	-	ON	-	-	-	ON	ON	ON	ON	ON	-	-	-	ON							
23:00	-	ON	ON	ON	ON	-	-	ON	ON	ON	-	ON	-	-	-	ON	ON	ON	ON	ON	-	-	-	ON							
0:00	ON	-	-	-	-	-	-	ON	ON	ON	-	ON	-	-	-	ON	ON	ON	ON	ON	-	-	-	ON							
1:00	-	ON	-	-	-	-	-	ON	ON	ON	-	ON	-	-	-	ON	ON	ON	ON	ON	-	-	-	ON							
2:00	ON	-	-	-	-	-	-	ON	ON	ON	-	ON	-	-	-	ON	ON	ON	ON	ON	-	-	-	ON							
3:00	-	ON	-	-	-	-	-	ON	ON	ON	-	ON	-	-	-	ON	ON	ON	ON	ON	-	-	-	ON							
4:00	-	-	-	-	-	-	-	ON	ON	ON	-	ON	-	-	-	ON	ON	ON	ON	ON	-	-	-	ON							
5:00	-	-	-	-	-	-	-	ON	ON	ON	-	ON	-	-	-	ON	ON	ON	ON	ON	-	-	-	ON							
6:00	ON	-	-	-	-	-	-	ON	ON	ON	-	ON	-	-	-	ON	ON	ON	ON	ON	-	-	-	ON							

Flow Meter Reading

Meter	Previous	Present	Consumption
Inlet	1002111	1008370	2591cc
Outlet	914260	914395	1351cc

Operation Shift

Sign

Shift - A
P.M.
Bachep

Client Signature
Ghosh

Backwash	Shift A	Shift B	Shift C	General
MGF	25 min	30 min	20 min	

Shift - B
P.M.
Bachep

Star Water Solutions

Date: 30/09/24

Shri Balaji Action Medical Institute
Paschim Vihar, Delhi.

LOG BOOK

Sewage Treatment Plant - 600 KLD

Time	Sewage Transfer Pump	Sludge Recycling Pump	Air Blower	Hypo Dosing Pump	Filter Feed Pump	Screw Pump	Filter Press	Ultra-Violet System	Flushing Water Transfer Pump	Multi Grade Filter	Activate d Carbon Filter	Ultra Filtration Feed Pump	Ultra Filtration	Reverse Osmosis
Hours	STP-1	STP-2	SRP-1	SRP-2	AB-1	AB-2	AB-3	HDS	FPP-1	FPP-2	SP-1	SP-1	FP	UV
7:00	ON	1	1	1	ON	1	1	1	1	1	1	1	1	1
8:00	—	ON	1	1	1	1	1	1	1	1	1	1	1	1
9:00	ON	1	1	1	ON	1	1	1	1	1	1	1	1	1
10:00	—	ON	1	1	1	1	1	1	1	1	1	1	1	1
11:00	ON	1	1	1	ON	1	1	1	1	1	1	1	1	1
12:00	—	ON	1	1	1	1	1	1	1	1	1	1	1	1
13:00	ON	1	1	1	ON	1	1	1	1	1	1	1	1	1
14:00	—	ON	1	1	ON	1	1	1	1	1	1	1	1	1
15:00	ON	1	1	1	ON	1	1	1	1	1	1	1	1	1
16:00	—	ON	1	1	ON	1	1	1	1	1	1	1	1	1
17:00	ON	1	1	1	ON	1	1	1	1	1	1	1	1	1
18:00	—	ON	1	1	ON	1	1	1	1	1	1	1	1	1
19:00	—	1	1	1	ON	1	1	1	1	1	1	1	1	1
20:00	ON	1	1	1	—	1	1	1	1	1	1	1	1	1
21:00	—	ON	1	1	ON	1	1	1	1	1	1	1	1	1
22:00	ON	1	1	1	ON	1	1	1	1	1	1	1	1	1
23:00	—	ON	1	1	ON	1	1	1	1	1	1	1	1	1
0:00	ON	—	ON	1	ON	ON	ON	ON	ON	ON	ON	ON	ON	ON
1:00	—	ON	1	1	ON	1	1	1	1	1	1	1	1	1
2:00	ON	—	ON	1	—	ON	ON	ON	ON	ON	ON	ON	ON	ON
3:00	—	ON	1	1	ON	—	ON	—	ON	—	ON	—	ON	—
4:00	ON	—	—	ON	1	ON	1	ON	1	ON	1	ON	1	ON
5:00	—	ON	1	1	ON	1	1	ON	1	ON	1	ON	1	ON
6:00	—	1	1	1	—	1	1	1	1	1	1	1	1	1

Client Signature

✓ Ashok Kumar

Flow Meter Reading

Meter	Previous	Present	Consumption
Inlet	1011147	1011423	276 KL
Outlet	9187242	9188899	143 KL

Operation Shift

Sign

Shift - A

Q12

Shift - B

Q12

Shift - C

Sahil

Remarks

Annexure-XXX
Photograph of STP



GPS Map Camera



GPS Map Camera



GPS Map Camera



Annexure-VIKK

Environmental Monitoring Reports



TC-6518

TEST REPORT

Issued to

M/s Action Cancer Hospital
 C/o Manav Sevarth Trust at Facility No. 34
 Paschim Vihar, Punjabi Bagh, Delhi -110063

Doc No. : ELPL/IV/QF/20
 Amend. No. & Amend. Date : 02 & 17.02.2018
Lab Reference No. : 240611015 A
Issue Date : 18/06/2024
Your Reference : Email

Project Name: Expansion of 'Action Cancer Hospital' A-4, Paschim Vihar, Near Paschim Vihar East Metro Station, New Delhi 110063

Sample Particulars: Ambient Air Quality Monitoring was done at Action Cancer Hospital, A-4, Paschim Vihar, Near Paschim Vihar East Metro Station, New Delhi 110063 on 10/06/2024 to 11/06/2024.

Type of sample	: Ambient Air	Sample Registration Date	: 11/06/2024
Sampling Date	: 10/06/2024 to 11/06/2024	Analysis Starting Date	: 11/06/2024
Sampling Done by	: Lab representative	Analysis Completion Date	: 18/06/2024
Quantity received	: 24 Hourly Sample	Tests Required	: Mentioned below
Sample's Location	: Near Gate No-1	Sampling Method	: ELPL/III/SOP/21

Test Report

Page 1 of 1

S.No.	Test Parameters	Units	Results	NAAQS	Test Method
1	Particulate Matter as PM ₁₀	µg/m ³	232	100 (24 Hourly)	IS 5182 (Pt-23)
2	Particulate Matter as PM _{2.5}	µg/m ³	120	060 (24 Hourly)	ELPL/III/SOP/23
3	Sulphur Dioxide as SO ₂	µg/m ³	15.1	080 (24 Hourly)	IS 5182 (Pt-02)
4	Oxides of Nitrogen as NO _x	µg/m ³	46.2	080 (24 Hourly)	IS 5182 (Pt-06)
5	Carbon Monoxide as CO	mg/m ³	0.49	002 (08 Hourly)	IS 5182 (Pt-10)

*****END OF REPORT*****

Sneha Smita
Checked By
 (SNEH SMITA)

Purushottam Sharma
Authorized Signatory
 (PURUSHOTTAM SHARMA)





TEST REPORT

Issued to

M/s Action Cancer Hospital
C/o Manav Sevarth Trust at Facility No. 34
Paschim Vihar, Punjabi Bagh, Delhi -110063

Doc No. : ELPL/IV/QF/20
Amend. No. & Amend. Date : 02 & 17.02.2018
Lab Reference No. : 240611016 N
Issue Date : 18/06/2024
Your Reference : Email

Project Name: Expansion of 'Action Cancer Hospital' A-4, Paschim Vihar, Near Paschim Vihar East Metro Station, New Delhi 110063

Sample Particulars: Ambient Noise level testing was done at Action Cancer Hospital, A-4, Paschim Vihar, Near Paschim Vihar East Metro Station, New Delhi 110063 on 10/06/2024 to 11/06/2024.

Type of sample	: Ambient Noise	Sample Registration Date	: 11/06/2024
Sampling Date	: 10/06/2024 to 11/06/2024	Testing Starting Date	: 11/06/2024
Sampling Done by	: Lab representative	Testing Completion Date	: 12/06/2024
Quantity received	: 24 Hourly Sample	Tests Required	: Mentioned below
Sample's Location	: Near Gate No-1	Sampling Method	: ELPL/III/SOP/37

Page 1 of 1

Time	Unit	Leq	Method
Day Time(06:00 am to 10:00 pm)	dB(A)	59.2	ELPL/III/SOP/37
Night Time(10:00 pm to 06:00 am)	dB(A)	48.6	ELPL/III/SOP/37

Standards for Ambient Noise As per Noise Pollution (Regulation & Control Rule-2000)			
Area Code	Category of Area/Zone	Limits in dB (A) Leq*	
		Day time	Night time
(A)	Industrial area	75	70
(B)	Commercial area	65	55
(C)	Residential area	55	45
(D)	Silence Zone	50	40

*****END OF REPORT*****

*Leq : It is energy mean of the noise level over a specified period.

Sneha Smita
Checked By
(SNEHA SMITA)

Purushottam Sharma
Authorized Signatory
(PURUSHOTTAM SHARMA)





TEST REPORT

Issued to

M/s Action Cancer Hospital
C/o Manav Sevarth Trust at Facility No. 34
Paschim Vihar, Punjabi Bagh, Delhi -110063

Doc No. : ELPL/IV/QF/20
Amend. No. & Amend. Date : 02 & 17.02.2018
Lab Reference No. : 240611011 W
Issue Date : 18/06/2024
Your Reference : Email

Project Name: Expansion of 'Action Cancer Hospital' A-4, Paschim Vihar, Near Paschim Vihar East Metro Station, New Delhi 110063

Sample Particulars: Water sample was collected from water cooler at Action Cancer Hospital, A-4, Paschim Vihar, Near Paschim Vihar East Metro Station, New Delhi 110063 on 10/06/2024.

Type of sample	: Drinking Water	Sample Registration Date	: 11/06/2024
Sampling Date	: 10/06/2024	Analysis Starting Date	: 11/06/2024
Sampling Done by	: Lab representative	Analysis Completion Date	: 18/06/2024
Quantity received	: 2 Ltr approx.	Tests Required	: Mentioned below
Sample's Location	: Near By VIP Lounge	Sampling Method	: ELPL/III/SOP/20

Test Result

Page 1 of 2

S.No	Test Parameters	Units	Results	IS 10500 : 2012		Test Method
				Acceptable Limit, max.	Permissible Limit in the Absence of Alternate source, max.	
1	Color	Hazen	BDL (DL-5.0)	5	15	IS 3025 (Pt-04)
2	Odour	-	Agreeable	Agreeable	Agreeable	IS 3025 (Pt-05)
3	pH	-	7.20	6.5-8.5	No relaxation	IS 3025 (Pt-11)
4	Taste	-	Agreeable	Agreeable	Agreeable	IS 3025 (Pt-08)
5	Turbidity	NTU	BDL(DL-1.0)	1	5	IS 3025 (Pt-10)
6	Total Dissolved Solids	mg/l	120	500	2000	IS 3025 (Pt-16)
7	Ammonia (as total ammonia-N)	mg/l	BDL (DL0.5)	0.5	No relaxation	IS 3025 (Pt-34)
8	Anionic Detergents (as MBAS)	mg/l	BDL (DL0.1)	0.2	1.0	Annex K of IS 13428
9	Calcium (as Ca)	mg/l	18	75	200	IS 3025 (Pt-40)
10	Chloramines (as Cl ₂)	mg/l	BDL (DL0.1)	4.0	No relaxation	IS 3025 (Pt-26)
11	Chloride (as Cl)	mg/l	12.4	250	1000	IS 3025 (Pt-32)
12	Fluoride (as F)	mg/l	BDL (DL0.01)	1.0	1.5	APHA 23 rd Ed 4500F
13	Free Residual Chlorine	mg/l	BDL (DL0.05)	0.2	1	IS 3025 (Pt-26)
14	Nitrate (as NO ₃)	mg/l	BDL (DL1.0)	45	No relaxation	IS 3025 (Pt-34)
15	Phenolic Compounds (as C ₆ H ₅ OH)	mg/l	BDL (DL 0.001)	0.001	0.002	IS 3025 (Pt-43)
16	Sulphate (as SO ₄)	mg/l	38	200	400	IS 3025 (Pt-24)
17	Sulphide (as H ₂ S)	mg/l	BDL(DL 0.02)	0.05	No relaxation	IS 3025 (Pt-29)
18	Total Alkalinity (as CaCO ₃)	mg/l	45	200	600	IS 3025 (Pt-23)
19	Total Hardness (as CaCO ₃)	mg/l	85	200	600	IS 3025 (Pt-21)
20	Cyanide (as CN)	mg/l	BDL(DL 0.02)	0.05	No relaxation	IS 3025 (Pt-27)

Sneha Smita

Checked By
(SNEHA SMITA)

Purushottam Sharma
Authorized Signatory
(PURUSHOTTAM SHARMA)





TC-6518

TEST REPORT

Issued to

M/s Action Cancer Hospital
C/o Manav Sevarth Trust at Facility No. 34
Paschim Vihar, Punjabi Bagh, Delhi -110063

Doc No. : ELPL/IV/QF/20
Amend. No. & Amend. Date : 02 & 17.02.2018
Lab Reference No. : 240611011 W
Issue Date : 18/06/2024
Your Reference : Email

Project Name: Expansion of 'Action Cancer Hospital' A-4, Paschim Vihar, Near Paschim Vihar East Metro Station, New Delhi 110063

Sample Particulars: Water sample was collected from water cooler at Action Cancer Hospital, A-4, Paschim Vihar, Near Paschim Vihar East Metro Station, New Delhi 110063 on 10/06/2024.

Type of sample	: Drinking Water	Sample Registration Date	: 11/06/2024
Sampling Date	: 10/06/2024	Analysis Starting Date	: 11/06/2024
Sampling Done by	: Lab representative	Analysis Completion Date	: 18/06/2024
Quantity received	: 2 Ltr approx.	Tests Required	: Mentioned below
Sample's Location	: Near By VIP Lounge	Sampling Method	: ELPL/III/SOP/20

Test Result

Page 2 of 2

S.No	Test Parameters	Units	Results	IS 10500 : 2012		Test Method
				Acceptable Limit, max.	Permissible Limit in the Absence of Alternate source, max.	
21	Aluminum (as Al)	mg/l	BDL (DL 0.01)	0.03	0.2	APHA 23 rd Ed.3120B
22	Barium (as Ba)	mg/l	BDL (DL 0.1)	0.7	No relaxation	APHA 23 rd Ed.3120B
23	Boron (as B)	mg/l	BDL (DL 0.1)	0.5	2.4	APHA 23 rd Ed.3120B
24	Copper (as Cu)	mg/l	BDL(DL 0.02)	0.05	1.5	APHA 23 rd Ed.3120B
25	Iron (as Fe)	mg/l	BDL (DL 0.05)	1.0	No relaxation	IS 3025 (Pt-53)
26	Magnesium (as Mg)	mg/l	9.7	30	100	APHA 23 rd Ed.3500B
27	Manganese (as Mn)	mg/l	BDL (DL 0.05)	0.1	0.3	APHA 23 rd Ed.3120B
28	Selenium (as Se)	mg/l	BDL (DL 0.01)	0.01	No relaxation	APHA 23 rd Ed.3120B
29	Silver (as Ag)	mg/l	BDL (DL 0.05)	0.1	No relaxation	APHA 23 rd Ed.3120B
30	Zinc (as Zn)	mg/l	BDL (DL 0.05)	5	15	APHA 23 rd Ed.3120B
31	Cadmium (as Cd)	mg/l	BDL(DL 0.001)	0.003	No relaxation	APHA 23 rd Ed.3120B
32	Lead (as Pb)	mg/l	BDL(DL 0.005)	0.01	No relaxation	APHA 23 rd Ed.3120B
33	Mercury (as Hg)	mg/l	BDL (DL0.001)	0.001	No relaxation	APHA 23 rd Ed.3120B
34	Molybdenum (as MO)	mg/l	BDL (DL 0.05)	0.07	No relaxation	APHA 23 rd Ed.3120B
35	Nickel (as Ni)	mg/l	BDL (D L0.01)	0.02	No relaxation	APHA 23 rd Ed.3120B
36	Total Arsenic (as As)	mg/l	BDL (DL 0.01)	0.01	No relaxation	APHA 23 rd Ed.3120B
37	Total Chromium (as Cr)	mg/l	BDL (DL 0.03)	0.05	No relaxation	APHA 23 rd Ed.3120B

*****END OF REPORT*****

BDL: Below Detection Limit

DL: Detection Limit

Sneha Smita
Checked By
(SNEH SMITA)

Purushottam Sharma
Authorized Signatory
(PURUSHOTTAM SHARMA)



TC-6518

TEST REPORT

Issued to

M/s Action Cancer Hospital
C/o Manav Sevarth Trust at Facility No. 34
Paschim Vihar, Punjabi Bagh, Delhi -110063

Doc No. : ELPL/IV/QF/20
Amend. No. & Amend. Date : 02 & 17.02.2018
Lab Reference No. : 240611014 S
Issue Date : 18/06/2024
Your Reference : Email

Project Name: Expansion of 'Action Cancer Hospital' A-4, Paschim Vihar, Near Paschim Vihar East Metro Station, New Delhi 110063.

Sample Particulars: Soil sample was collected from ground at Action Cancer Hospital, A-4, Paschim Vihar, Near Paschim Vihar East Metro Station, New Delhi 110063 on 10/06/2024.

Type of sample	: Soil	Sample Registration Date	: 11/06/2024
Sampling Date	: 10/06/2024	Analysis Starting Date	: 11/06/2024
Sampling Done by	: Lab representative	Analysis Completion Date	: 18/06/2024
Quantity received	: 1 Kg approx.	Tests Required	: Mentioned below
Sample's Location	: Nearby ACH backside area	Sampling Method	: Grab Method

Test Result

Page 1 of 1

S.No.	Test Parameters	Unit	Result	Test Method
1	pH (1:5)	-	8.44	IS 2720(P-26):1987
2	Conductivity (1:5)	µmhos/cm	372	IS 14767:2000
3	Bulk Density	gm/cc	1.32	ELPL/III/SOP/40
4	Chloride as Cl	mg/kg	446	ELPL/III/SOP/46
5	Calcium as Ca	mg/kg	6208	ELPL/III/SOP/42
6	Magnesium as Mg	mg/kg	632	ELPL/III/SOP/43
7	Organic matter	%	0.52	IS 2720(P-22):1972
8	Phosphorous	mg/kg	76	ELPL/III/SOP/47
9	Moisture	%	26.1	ELPL/III/SOP/53
10	Sulphate	mg/kg	136	IS:3025 (P-24)
11	Iron	mg/kg	48	USEPA 6010C:2000
12	Lead	mg/kg	BDL (DL-2.0)	USEPA 6010C:2000

*****END OF REPORT*****

Sneha Smita
Checked By
(SNEHA SMITA)

Authorized Signatory
(PURUSHOTTAM SHARMA)





TC-6518

TEST REPORT

Issued to

M/s Action Cancer Hospital
C/o Manav Sevarth Trust at Facility No. 34
Paschim Vihar, Punjabi Bagh, Delhi -110063

Doc No. : ELPL/IV/QF/20
Amend. No. & Amend. Date : 02 & 17.02.2018
Lab Reference No. : 240611012 W
Issue Date : 18/06/2024
Your Reference : Email

Project Name: Expansion of 'Action Cancer Hospital' A-4, Paschim Vihar, Near Paschim Vihar East Metro Station, New Delhi 110063

Sample Particulars: Waste water sample was collected from STP Inlet at Action Cancer Hospital, A-4, Paschim Vihar, Near Paschim Vihar East Metro Station, New Delhi 110063 on 10/06/2024.

Type of sample	: STP Inlet	Sample Registration Date	: 11/06/2024
Sampling Date	: 10/06/2024	Analysis Starting Date	: 11/06/2024
Sampling Done by	: Lab representative	Analysis Completion Date	: 18/06/2024
Quantity received	: 2 Ltr approx.	Tests Required	: Mentioned below
Sample's Location	: STP Plant Room	Sampling Method	: ELPL/III/SOP/20

Test Result

Page 1 of 1

S.No.	Test Parameters	Units	Results	Test Method
1	pH	-	6.59	IS 3025 (P-11)
2	Oil and grease	mg/l	10	IS 3025 (P-39)
3	Biochemical oxygen demand as BOD at 27°C for 3 days	mg/l	130	IS 3025 (P-44)
4	Chemical oxygen demand as COD	mg/l	360	IS 3025 (P-58)
5	Total suspended solids as TSS	mg/l	62	IS 3025 (P-17)

*****END OF REPORT*****

Sneha Smita
Checked By
(SNEH SMITA)

Purushottam Sharma
Authorized Signatory
(PURUSHOTTAM SHARMA)



TEST REPORT

Issued to

M/s Action Cancer Hospital
C/o Manav Sevarth Trust at Facility No. 34
Paschim Vihar, Punjabi Bagh, Delhi -110063

Doc No. : ELPL/IV/QF/20
Amend. No. & Amend. Date : 02 & 17.02.2018
Lab Reference No. : 240611013 W
Issue Date : 18/06/2024
Your Reference : Email

Project Name: Expansion of 'Action Cancer Hospital' A-4, Paschim Vihar, Near Paschim Vihar East Metro Station, New Delhi 110063

Sample Particulars: Waste water sample was collected from STP Outlet at Action Cancer Hospital, A-4, Paschim Vihar, Near Paschim Vihar East Metro Station, New Delhi 110063 on 10/06/2024.

Type of sample	: STP Outlet	Sample Registration Date	: 11/06/2024
Sampling Date	: 10/06/2024	Analysis Starting Date	: 11/06/2024
Sampling Done by	: Lab representative	Analysis Completion Date	: 18/06/2024
Quantity received	: 2 Ltr approx.	Tests Required	: Mentioned below
Sample's Location	: STP Plant Room	Sampling Method	: ELPL/III/SOP/20

Test Result

Page 1 of 1

S.No.	Test Parameters	Units	Results	As Per CPCB Norm	Test Method
1	pH	-	7.00	5.0-9.0	IS 3025 (P-11)
2	Oil and grease	mg/l	03	10	IS 3025 (P-39)
3	Biochemical oxygen demand as BOD at 27°C for 3 days	mg/l	24	30	IS 3025 (P-44)
4	Chemical oxygen demand as COD	mg/l	120	250	IS 3025 (P-58)
5	Total suspended solids as TSS	mg/l	28	100	IS 3025 (P-17)

*****END OF REPORT*****

Sneha Smita
Checked By
(SNEH SMITA)

Purushottam Sharma
Authorized Signatory
(PURUSHOTTAM SHARMA)



TC-6518

TEST REPORT

Issued to

M/s Action Cancer Hospital
 C/o Manav Sevarth Trust at Facility No. 34
 Paschim Vihar, Punjabi Bagh, Delhi -110063

Doc No. : ELPL/IV/QF/20
 Amend. No. & Amend. Date : 02 & 17.02.2018
Lab Reference No. : 240928001 W
Issue Date : 05/10/2024
Your Reference : Email

Project Name: Expansion of 'Action Cancer Hospital' A-4, Paschim Vihar, Near Paschim Vihar East Metro Station, New Delhi 110063

Sample Particulars: Water sample was collected from water cooler at Action Cancer Hospital, A-4, Paschim Vihar, Near Paschim Vihar East Metro Station, New Delhi 110063 on 28/09/2024.

Type of sample	: Drinking Water	Sample Registration Date	: 28/09/2024
Sampling Date	: 28/09/2024	Analysis Starting Date	: 28/09/2024
Sampling Done by	: Lab representative	Analysis Completion Date	: 05/10/2024
Quantity received	: 2 Ltr approx.	Tests Required	: Mentioned below
Sample's Location	: Near By VIP Lounge	Sampling Method	: ELPL/III/SOP/20

Test Result

Page 1 of 2

S.No	Test Parameters	Units	Results	IS 10500 : 2012		Test Method
				Acceptable Limit, max.	Permissible Limit in the Absence of Alternate source, max.	
1	Color	Hazen	BDL (DL-5.0)	5	15	IS 3025 (Pt-04)
2	Odour	-	Agreeable	Agreeable	Agreeable	IS 3025 (Pt-05)
3	pH	-	7.71	6.5-8.5	No relaxation	IS 3025 (Pt-11)
4	Taste	-	Agreeable	Agreeable	Agreeable	IS 3025 (Pt-08)
5	Turbidity	NTU	BDL(DL-1.0)	1	5	IS 3025 (Pt-10)
6	Total Dissolved Solids	mg/l	178	500	2000	IS 3025 (Pt-16)
7	Ammonia (as total ammonia-N)	mg/l	BDL (DL0.5)	0.5	No relaxation	IS 3025 (Pt-34)
8	Anionic Detergents (as MBAS)	mg/l	BDL (DL0.1)	0.2	1.0	Annex K of IS 13428
9	Calcium (as Ca)	mg/l	42	75	200	IS 3025 (Pt-40)
10	Chloramines (as Cl ₂)	mg/l	BDL (DL0.1)	4.0	No relaxation	IS 3025 (Pt-26)
11	Chloride (as Cl)	mg/l	15	250	1000	IS 3025 (Pt-32)
12	Fluoride (as F)	mg/l	BDL (DL0.01)	1.0	1.5	APHA 23 rd Ed 4500F
13	Free Residual Chlorine	mg/l	BDL (DL0.05)	0.2	1	IS 3025 (Pt-26)
14	Nitrate (as NO ₃)	mg/l	BDL (DL1.0)	45	No relaxation	IS 3025 (Pt-34)
15	Phenolic Compounds (as C ₆ H ₅ OH)	mg/l	BDL (DL 0.001)	0.001	0.002	IS 3025 (Pt-43)
16	Sulphate (as SO ₄)	mg/l	65	200	400	IS 3025 (Pt-24)
17	Sulphide (as H ₂ S)	mg/l	BDL(DL 0.02)	0.05	No relaxation	IS 3025 (Pt-29)
18	Total Alkalinity (as CaCO ₃)	mg/l	50	200	600	IS 3025 (Pt-23)
19	Total Hardness (as CaCO ₃)	mg/l	150	200	600	IS 3025 (Pt-21)
20	Cyanide (as CN)	mg/l	BDL(DL 0.02)	0.05	No relaxation	IS 3025 (Pt-27)

Sneha Smita
 Checked By
 (SNEHA SMITA)

Purushottam Sharma
 Authorized Signatory
 (PURUSHOTTAM SHARMA)





TC-6518

TEST REPORT

Issued to

M/s Action Cancer Hospital
 C/o Manav Sevarth Trust at Facility No. 34
 Paschim Vihar, Punjabi Bagh, Delhi -110063

Doc No. : ELPL/IV/QF/20
 Amend. No. & Amend. Date : 02 & 17.02.2018
Lab Reference No. : 240928001 W
Issue Date : 05/10/2024
Your Reference : Email

Project Name: Expansion of 'Action Cancer Hospital' A-4, Paschim Vihar, Near Paschim Vihar East Metro Station, New Delhi 110063

Sample Particulars: Water sample was collected from water cooler at Action Cancer Hospital, A-4, Paschim Vihar, Near Paschim Vihar East Metro Station, New Delhi 110063 on 28/09/2024.

Type of sample	: Drinking Water	Sample Registration Date	: 28/09/2024
Sampling Date	: 28/09/2024	Analysis Starting Date	: 28/09/2024
Sampling Done by	: Lab representative	Analysis Completion Date	: 05/10/2024
Quantity received	: 2 Ltr approx.	Tests Required	: Mentioned below
Sample's Location	: Near By VIP Lounge	Sampling Method	: ELPL/III/SOP/20

Test Result

Page 2 of 2

S.No	Test Parameters	Units	Results	IS 10500 : 2012		Test Method
				Acceptable Limit, max.	Permissible Limit in the Absence of Alternate source, max.	
21	Aluminum (as Al)	mg/l	BDL (DL 0.01)	0.03	0.2	APHA 23 rd Ed.3120B
22	Barium (as Ba)	mg/l	BDL (DL 0.1)	0.7	No relaxation	APHA 23 rd Ed.3120B
23	Boron (as B)	mg/l	BDL (DL 0.1)	0.5	2.4	APHA 23 rd Ed.3120B
24	Copper (as Cu)	mg/l	BDL(DL 0.02)	0.05	1.5	APHA 23 rd Ed.3120B
25	Iron (as Fe)	mg/l	BDL (DL 0.05)	1.0	No relaxation	IS 3025 (Pt-53)
26	Magnesium (as Mg)	mg/l	10.9	30	100	APHA 23 rd Ed.3500B
27	Manganese (as Mn)	mg/l	BDL (DL 0.05)	0.1	0.3	APHA 23 rd Ed.3120B
28	Selenium (as Se)	mg/l	BDL (DL 0.01)	0.01	No relaxation	APHA 23 rd Ed.3120B
29	Silver (as Ag)	mg/l	BDL (DL 0.05)	0.1	No relaxation	APHA 23 rd Ed.3120B
30	Zinc (as Zn)	mg/l	BDL (DL 0.05)	5	15	APHA 23 rd Ed.3120B
31	Cadmium (as Cd)	mg/l	BDL(DL 0.001)	0.003	No relaxation	APHA 23 rd Ed.3120B
32	Lead (as Pb)	mg/l	BDL(DL 0.005)	0.01	No relaxation	APHA 23 rd Ed.3120B
33	Mercury (as Hg)	mg/l	BDL (DL0.001)	0.001	No relaxation	APHA 23 rd Ed.3120B
34	Molybdenum (as MO)	mg/l	BDL (DL 0.05)	0.07	No relaxation	APHA 23 rd Ed.3120B
35	Nickel (as Ni)	mg/l	BDL (D L0.01)	0.02	No relaxation	APHA 23 rd Ed.3120B
36	Total Arsenic (as As)	mg/l	BDL (DL 0.01)	0.01	No relaxation	APHA 23 rd Ed.3120B
37	Total Chromium (as Cr)	mg/l	BDL (DL 0.03)	0.05	No relaxation	APHA 23 rd Ed.3120B

*****END OF REPORT*****

BDL: Below Detection Limit

DL: Detection Limit

Sneha Smita
 Checked By
 (SNEH SMITA)

Authorized Signatory
 (PURUSHOTTAM SHARMA)





TC-6518

TEST REPORT

Issued to

M/s Action Cancer Hospital
C/o Manav Sevarth Trust at Facility No. 34
Paschim Vihar, Punjabi Bagh, Delhi -110063

Doc No. : ELPL/IV/QF/20
Amend. No. & Amend. Date : 02 & 17.02.2018
Lab Reference No. : 240928003 W
Issue Date : 05/10/2024
Your Reference : Email

Project Name: Expansion of 'Action Cancer Hospital' A-4, Paschim Vihar, Near Paschim Vihar East Metro Station, New Delhi 110063

Sample Particulars: Waste water sample was collected from STP Outlet at Action Cancer Hospital, A-4, Paschim Vihar, Near Paschim Vihar East Metro Station, New Delhi 110063 on 28/09/2024.

Type of sample	: STP Outlet	Sample Registration Date	: 28/09/2024
Sampling Date	: 28/09/2024	Analysis Starting Date	: 28/09/2024
Sampling Done by	: Lab representative	Analysis Completion Date	: 05/10/2024
Quantity received	: 2 Ltr approx.	Tests Required	: Mentioned below
Sample's Location	: STP Plant Room	Sampling Method	: ELPL/III/SOP/20

Test Result

Page 1 of 1

S.No.	Test Parameters	Units	Results	As Per CPCB Norm	Test Method
1	pH	-	6.49	5.0-9.0	IS 3025 (P-11)
2	Oil and grease	mg/l	3.5	10	IS 3025 (P-39)
3	Biochemical oxygen demand as BOD at 27°C for 3 days	mg/l	20	30	IS 3025 (P-44)
4	Chemical oxygen demand as COD	mg/l	110	250	IS 3025 (P-58)
5	Total suspended solids as TSS	mg/l	30	100	IS 3025 (P-17)

*****END OF REPORT*****

Sneha Smita
Checked By
(SNEHA SMITA)

Purushottam Sharma
Authorized Signatory
(PURUSHOTTAM SHARMA)



TC-6518

TEST REPORT

Issued to

M/s Action Cancer Hospital
C/o Manav Sevarth Trust at Facility No. 34
Paschim Vihar, Punjabi Bagh, Delhi -110063

Doc No. : ELPL/IV/QF/20
Amend. No. & Amend. Date : 02 & 17.02.2018
Lab Reference No. : 240928002 W
Issue Date : 05/10/2024
Your Reference : Email

Project Name: Expansion of 'Action Cancer Hospital' A-4, Paschim Vihar, Near Paschim Vihar East Metro Station, New Delhi 110063

Sample Particulars: Waste water sample was collected from STP Inlet at Action Cancer Hospital, A-4, Paschim Vihar, Near Paschim Vihar East Metro Station, New Delhi 110063 on 28/09/2024.

Type of sample	: STP Inlet	Sample Registration Date	: 28/09/2024
Sampling Date	: 28/09/2024	Analysis Starting Date	: 28/09/2024
Sampling Done by	: Lab representative	Analysis Completion Date	: 05/10/2024
Quantity received	: 2 Ltr approx.	Tests Required	: Mentioned below
Sample's Location	: STP Plant Room	Sampling Method	: ELPL/III/SOP/20

Test Result

Page 1 of 1

S.No.	Test Parameters	Units	Results	Test Method
1	pH	-	7.0	IS 3025 (P-11)
2	Oil and grease	mg/l	20	IS 3025 (P-39)
3	Biochemical oxygen demand as BOD at 27°C for 3 days	mg/l	340	IS 3025 (P-44)
4	Chemical oxygen demand as COD	mg/l	810	IS 3025 (P-58)
5	Total suspended solids as TSS	mg/l	146	IS 3025 (P-17)

*****END OF REPORT*****

Snehsmita
Checked By
(SNEH SMITA)

Purushottam Sharma
Authorized Signatory
(PURUSHOTTAM SHARMA)



TC-6518

TEST REPORT

Issued to

M/s Action Cancer Hospital
C/o Manav Sevarth Trust at Facility No. 34
Paschim Vihar, Punjabi Bagh, Delhi -110063

Doc No. : ELPL/IV/QF/20
Amend. No. & Amend. Date : 02 & 17.02.2018
Lab Reference No. : 240928004 S
Issue Date : 05/10/2024
Your Reference : Email

Project Name: Expansion of 'Action Cancer Hospital' A-4, Paschim Vihar, Near Paschim Vihar East Metro Station, New Delhi 110063.

Sample Particulars: Soil sample was collected from ground at Action Cancer Hospital, A-4, Paschim Vihar, Near Paschim Vihar East Metro Station, New Delhi 110063 on 28/09/2024.

Type of sample	: Soil	Sample Registration Date	: 28/09/2024
Sampling Date	: 28/09/2024	Analysis Starting Date	: 28/09/2024
Sampling Done by	: Lab representative	Analysis Completion Date	: 05/10/2024
Quantity received	: 1 Kg approx.	Tests Required	: Mentioned below
Sample's Location	: Nearby ACH backside area	Sampling Method	: Grab Method

Test Result

Page1of 1

S.No.	Test Parameters	Unit	Result	Test Method
1	pH (1:5)	-	8.12	IS 2720(P-26):1987
2	Conductivity (1:5)	µmhos/cm	396	IS 14767:2000
3	Bulk Density	gm/cc	1.28	ELPL/III/SOP/40
4	Chloride as Cl	mg/kg	527	ELPL/III/SOP/46
5	Calcium as Ca	mg/kg	6426	ELPL/III/SOP/42
6	Magnesium as Mg	mg/kg	814	ELPL/III/SOP/43
7	Organic matter	%	0.50	IS 2720(P-22):1972
8	Phosphorous	mg/kg	80	ELPL/III/SOP/47
9	Moisture	%	22	ELPL/III/SOP/53
10	Sulphate	mg/kg	144	IS:3025 (P-24)
11	Iron	mg/kg	55	USEPA 6010C:2000
12	Lead	mg/kg	BDL (DL-2.0)	USEPA 6010C:2000

*****END OF REPORT*****

Sneha Smita
Checked By
(SNEH SMITA)

Purushottam Sharma
Authorized Signatory
(PURUSHOTTAM SHARMA)



TC-6518

TEST REPORT

Issued to

M/s Action Cancer Hospital
C/o Manav Sevarth Trust at Facility No. 34
Paschim Vihar, Punjabi Bagh, Delhi -110063

Doc No. : ELPL/IV/QF/20
Amend. No. & Amend. Date : 02 & 17.02.2018
Lab Reference No. : 240928006 N
Issue Date : 05/10/2024
Your Reference : Email

Project Name: Expansion of 'Action Cancer Hospital' A-4, Paschim Vihar, Near Paschim Vihar East Metro Station, New Delhi 110063

Sample Particulars: Ambient Noise level testing was done at Action Cancer Hospital, A-4, Paschim Vihar, Near Paschim Vihar East Metro Station, New Delhi 110063 on 27/09/2024 to 28/09/2024.

Type of sample	: Ambient Noise	Sample Registration Date	: 28/09/2024
Sampling Date	: 27/09/2024 to 28/09/2024	Testing Starting Date	: 28/09/2024
Sampling Done by	: Lab representative	Testing Completion Date	: 05/10/2024
Quantity received	: 24 Hourly Sample	Tests Required	: Mentioned below
Sample's Location	: Near Gate No-1	Sampling Method	: ELPL/III/SOP/37

Page 1 of 1

Time	Unit	Leq	Method
Day Time(06:00 am to 10:00 pm)	dB(A)	60.9	ELPL/III/SOP/37
Night Time(10:00 pm to 06:00 am)	dB(A)	49.8	ELPL/III/SOP/37

Standards for Ambient Noise As per Noise Pollution (Regulation & Control Rule-2000)		Limits in dB (A) Leq*	
Area Code	Category of Area/Zone	Day time	Night time
(A)	Industrial area	75	70
(B)	Commercial area	65	55
(C)	Residential area	55	45
(D)	Silence Zone	50	40

*****END OF REPORT*****

*Leq : It is energy mean of the noise level over a specified period.

Sneha Smita
Checked By
(SNEHA SMITA)

Purushottam Sharma
Authorized Signatory
(PURUSHOTTAM SHARMA)





TC-6518

TEST REPORT

Issued to

M/s Action Cancer Hospital
C/o Manav Sevarth Trust at Facility No. 34
Paschim Vihar, Punjabi Bagh, Delhi -110063

Doc No. : ELPL/IV/QF/20
Amend. No. & Amend. Date : 02 & 17.02.2018
Lab Reference No. : 240928005 A
Issue Date : 05/10/2024
Your Reference : Email

Project Name: Expansion of 'Action Cancer Hospital' A-4, Paschim Vihar, Near Paschim Vihar East Metro Station, New Delhi 110063

Sample Particulars: Ambient Air Quality Monitoring was done at Action Cancer Hospital, A-4, Paschim Vihar, Near Paschim Vihar East Metro Station, New Delhi 110063 on 27/09/2024 to 28/09/2024.

Type of sample	: Ambient Air	Sample Registration Date	: 28/09/2024
Sampling Date	: 27/09/2024 to 28/09/2024	Analysis Starting Date	: 28/09/2024
Sampling Done by	: Lab representative	Analysis Completion Date	: 05/10/2024
Quantity received	: 24 Hourly Sample	Tests Required	: Mentioned below
Sample's Location	: Near Gate No-1	Sampling Method	: ELPL/III/SOP/21

Test Report

Page 1 of 1

S.No.	Test Parameters	Units	Results	NAAQS	Test Method
1	Particulate Matter as PM ₁₀	µg/m ³	209	100 (24 Hourly)	IS 5182 (Pt-23)
2	Particulate Matter as PM _{2.5}	µg/m ³	129	060 (24 Hourly)	ELPL/III/SOP/23
3	Sulphur Dioxide as SO ₂	µg/m ³	16.6	080 (24 Hourly)	IS 5182 (Pt-02)
4	Oxides of Nitrogen as NO _x	µg/m ³	37.8	080 (24 Hourly)	IS 5182 (Pt-06)
5	Carbon Monoxide as CO	mg/m ³	0.47	002 (08 Hourly)	IS 5182 (Pt-10)

*****END OF REPORT*****

Sneha Smita
Checked By
(SNEH SMITA)

Purushottam Sharma
Authorized Signatory
(PURUSHOTTAM SHARMA)



Environmental Monitoring Report

1. Ambient Air Quality Monitoring

Ambient air quality monitoring has been done quarterly basis at locations AAQ-1 (Near Gate No.1) and AAQ-1 (Near Gate No.1) for 24 Hrs. The detail of monitoring schedule is given in **Table-1**.

Table 1: Schedule of Ambient Air Quality Monitoring

S. No.	Duration of sampling (hours)	Date		Sample collected on	Location
		From	To		
1	24	10/06/2024	11/06/2024	11/06/2024	AAQ-1 (Near Gate No.1)
2	24	27/09/2024	28/09/2024	28/09/2024	AAQ-1 (Near Gate No.1)

Particulate Matter

PM₁₀: Monitoring results of PM₁₀ is given in **Table- 1(a)** and graphical representation is given in **Figure- 1(a)**.

Table-1 (a): Monitoring results for PM₁₀

S. No.	Sampling dates	Location Code	Sampling duration	Results (µg/m ³)	NAAQS (as per CPCB), µg/m ³
1	10/06/2024 to 11/06/2024	AAQ - 1	24 Hourly	232	100
2	27/09/2024 to 28/09/2024	AAQ - 1	24 Hourly	209	100

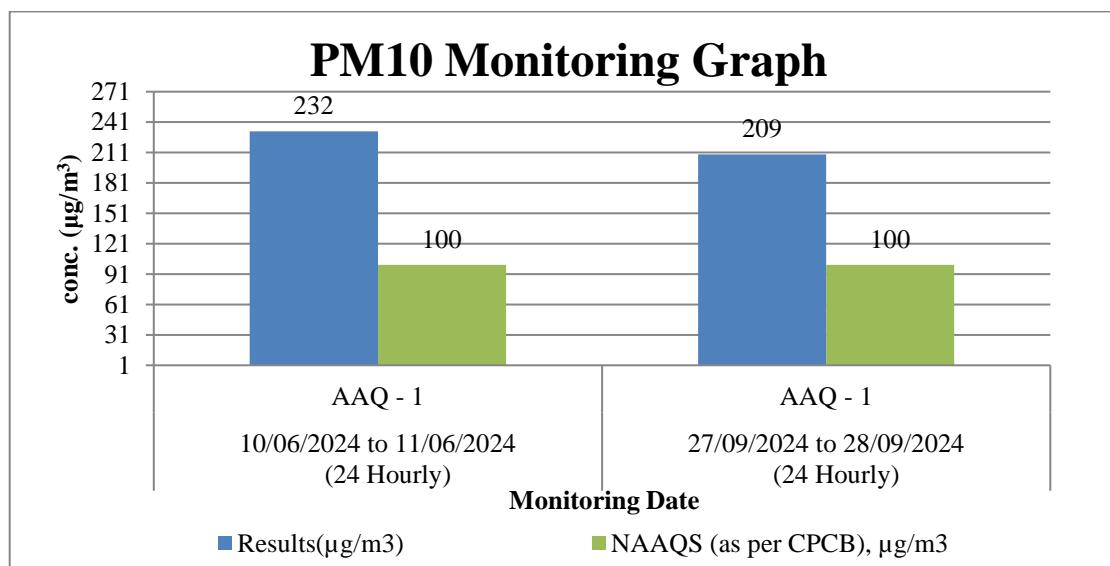


Figure 1 (a): PM₁₀ concentrations

The concentration of PM₁₀ was found higher than permissible limit by NAAQS.

“Expansion of Action Cancer Hospital A-4” located at Paschim Vihar, Near Paschim Vihar East Metro Station, New Delhi by M/s Action Cancer Hospital

PM_{2.5}: Monitoring results of PM_{2.5} is given in **Table-1 (b)** and graphical representation is given in **Figure- 1 (b)**

Table 1 (b): Monitoring results for PM_{2.5}

S. No.	Sampling dates	Location Code	Sampling duration	Results (µg/m ³)	NAAQS (as per CPCB), µg/m ³
1	10/06/2024 to 11/06/2024	AAQ - 1	24 Hourly	120	60
2	27/09/2024 to 28/09/2024	AAQ - 1	24 Hourly	129	60

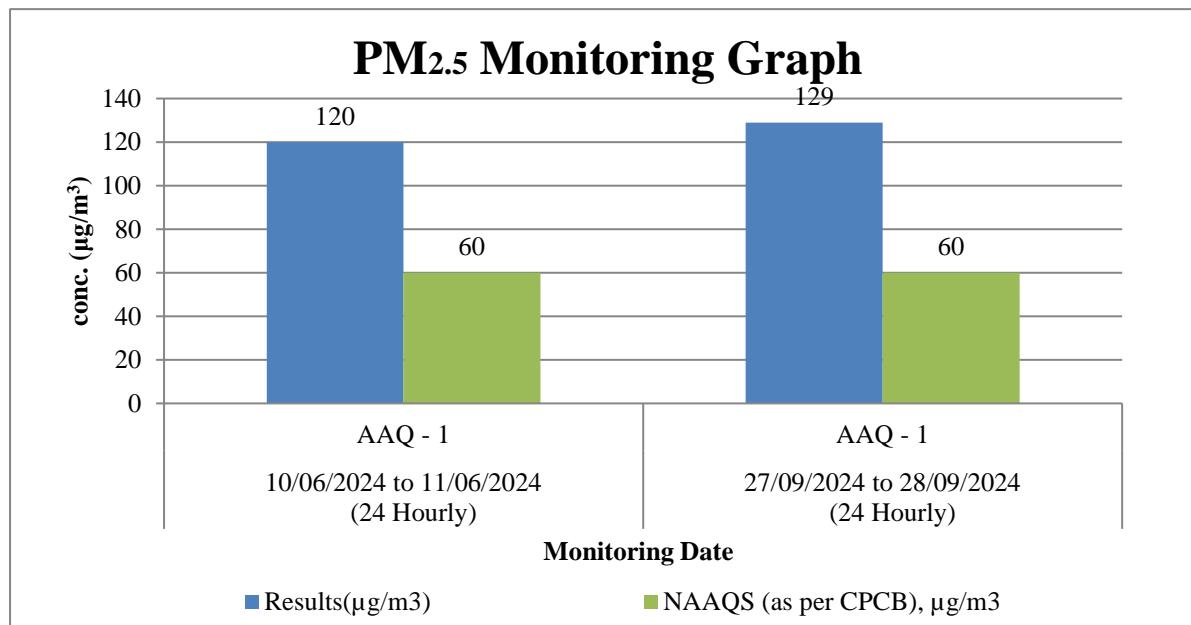


Figure 1 (b): PM_{2.5} concentrations

The concentration of PM_{2.5} was found to be higher than permissible limit by NAAQS.

Sulphur Dioxide (SO₂)

Monitoring results of SO₂ are given in **Table-1 (c)** and graphical representation is given in **Figure-1 (c)**

Table- 1(c): Monitoring results for SO₂

S. No.	Sampling dates	Location Code	Sampling duration	Results (µg/m ³)	NAAQS (as per CPCB), µg/m ³
1	10/06/2024 to 11/06/2024	AAQ - 1	24 Hourly	15.1	80
2	27/09/2024 to 28/09/2024	AAQ - 1	24 Hourly	16.6	80

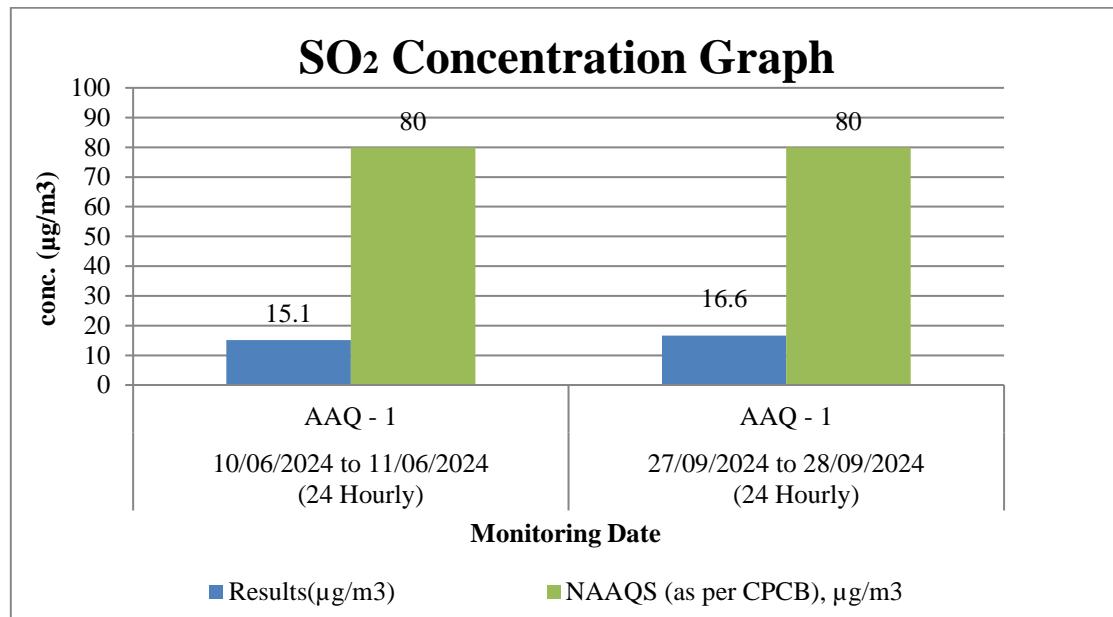


Figure-1(c): SO₂ concentrations

The concentration of SO₂ was observed below permissible Limit as per NAAQS.

Nitrogen Dioxide (NO₂)

Monitoring results of NO₂ is given in **Table-1 (d)** and graphical representation is given in **Figure-1 (d)**

Table-1 (d) Monitoring results for NO₂

S. No.	Sampling dates	Location Code	Sampling duration	Results ($\mu\text{g}/\text{m}^3$)	NAAQS (as per CPCB), $\mu\text{g}/\text{m}^3$
1	10/06/2024 to 11/06/2024	AAQ - 1	24 Hourly	46.2	80
2	27/09/2024 to 28/09/2024	AAQ - 1	24 Hourly	37.8	80

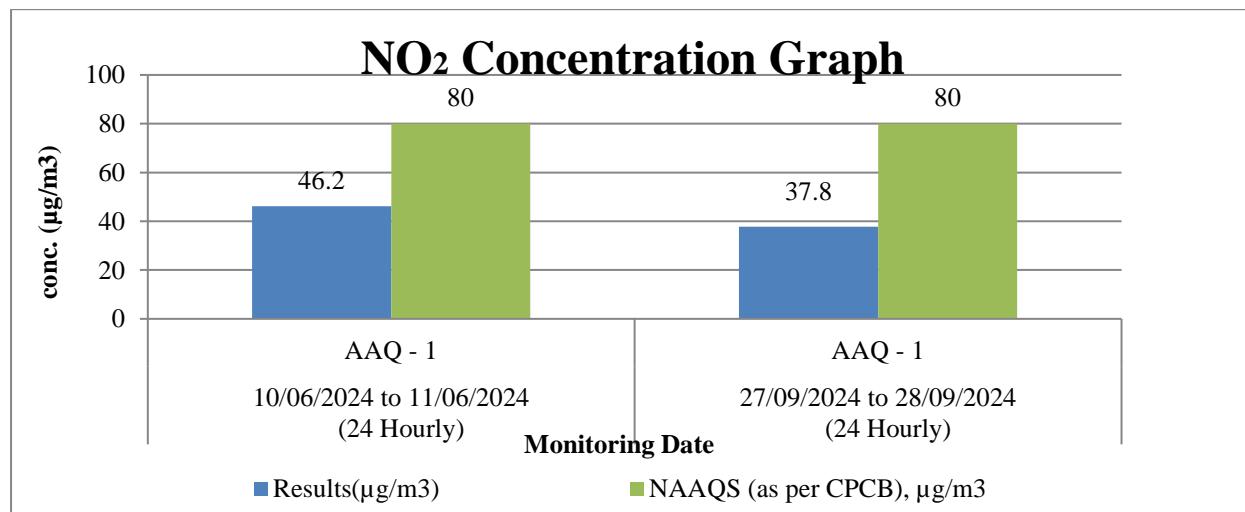


Figure 1 (d): NO₂ concentrations

“Expansion of Action Cancer Hospital A-4” located at Paschim Vihar, Near Paschim Vihar East Metro Station, New Delhi by M/s Action Cancer Hospital

The concentration of NO₂ was below the limits as permissible limit as per NAAQS.

Carbon Monoxide (CO)

Monitoring results of CO is given in **Table-1(e)** and graphical representation is given in **Figure-1(e)**

Table -1 (e): Monitoring results for CO

S. No.	Sampling dates	Location Code	Sampling duration	Results (mg/m ³)	NAAQS (as per CPCB), µg/m ³
1	10/06/2024 to 11/06/2024	AAQ - 1	08 Hourly	0.49	002
2	27/09/2024 to 28/09/2024	AAQ - 1	08 Hourly	0.47	002

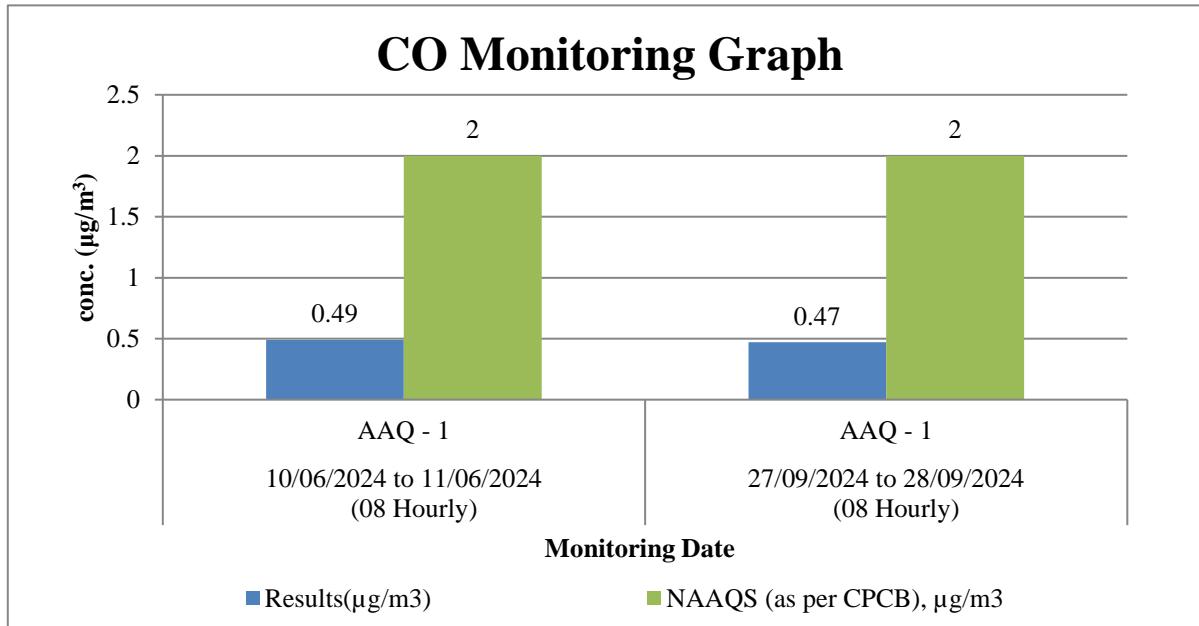


Figure 1 (e): CO concentrations

The concentration of CO was within the limit as prescribed by NAAQS.

2. Noise Monitoring

Noise monitoring was done quarterly basis at location ANQ-1 (OPD back side Area) and ANQ-1 (Near By ACH back side) for 24 Hrs. The details of monitoring are given in **Table-(2)**

Table (2): Schedule of Noise Monitoring

S. No.	Duration of sampling (hours)	Date		Sample collected on	Location
		From	To		
1	24	10/06/2024	11/06/2024	11/06/2024	ANQ-1(Near Gate No-1)
2	24	27/09/2024	28/09/2024	28/09/2024	ANQ-1 (Near Gate No-1)

Monitoring has been done for 24 hours. The results for day time & night time observations are given below:

Day Time

Monitoring results of day time is given in **Table- 2 (a)** and graphical representation is given in **Figure- 2 (a)**

Table 2 (a): Day Time monitoring result

S. No.	Monitoring Locations	Duration of Monitoring	Results dB(A)	Permissible Limit dB(A) (as per CPCB)
1	ANQ - 1	Day time (6:00 AM to 10:00 PM)	59.2	65
2	ANQ - 1	Day time (6:00 AM to 10:00 PM)	60.9	65

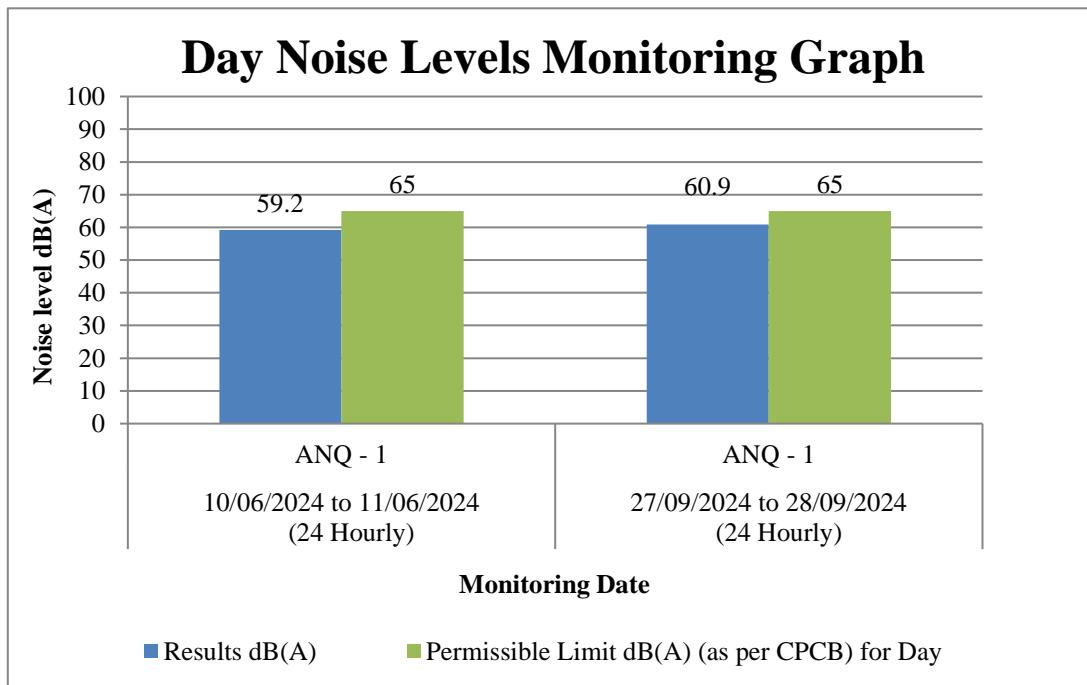


Figure 2 (a): Graph showing day time Noise monitoring result

The day Noise result was found to be within the limit as prescribed by NAAQS.

Night Time

Monitoring results of night time is given in **Table- 2 (b)** and graphical representation is given in **Figure-2 (b)**.

Table – 2 (b): Night Time monitoring result

S. No.	Monitoring Locations	Duration of Monitoring	Results dB(A)	Permissible Limit dB(A) (as per CPCB)
1	ANQ - 1	Night time (10:00 PM to 06:00AM)	48.6	55
2	ANQ - 1	Night time (10:00 PM to 06:00AM)	49.8	55

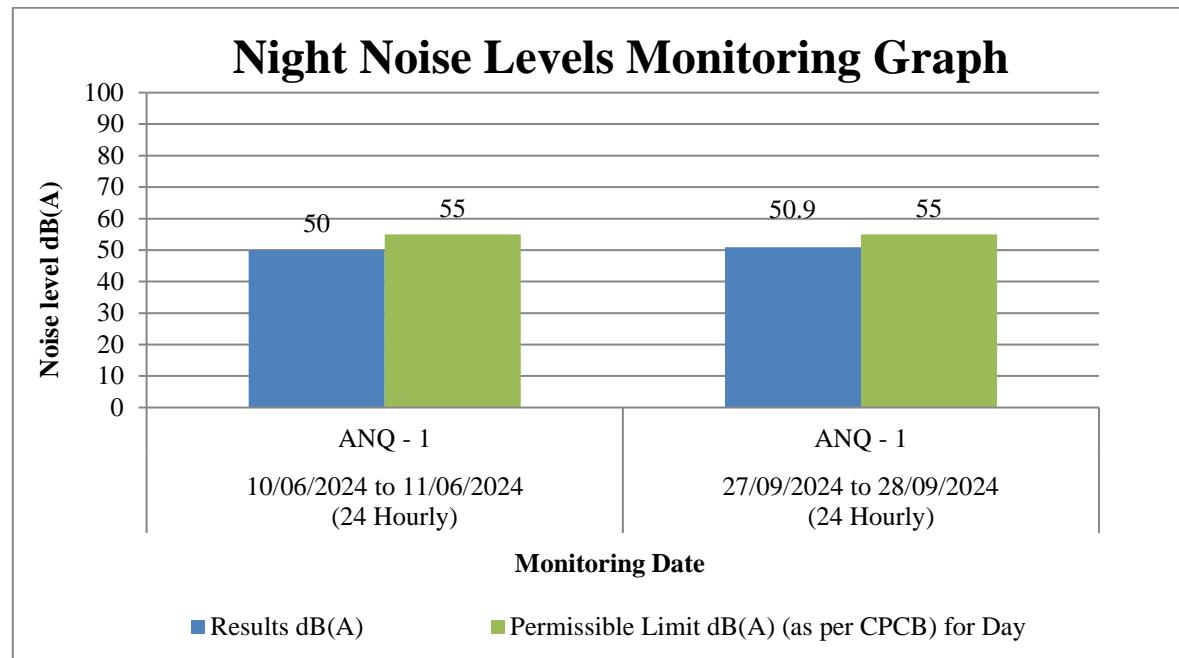


Figure 2 (b): Graph showing night time Noise monitoring result

The night Noise result was found to be within the limit as prescribed by NAAQS.

3. Drinking Water Monitoring

Schedule for Drinking water monitoring is given in **Table 3**.

Table 3: Schedule for Drinking water sample collection

Sample collected on	Location
10/06/2024	Near By VIP Lounge
28/09/2024	Near By VIP Lounge

Drinking water monitoring results given in **Table 3(a) & Table 3(b)**.

Table 3(a): - Drinking Water Monitoring Results (10/06/2024)

S. No	Test Parameters	Units	Results	IS 10500 : 2012		Test Method
				Acceptable Limit, max.	Permissible Limit in the Absence of Alternate source, max.	
1	Color	Hazen	BDL (DL-5.0)	5	15	IS 3025 (Pt-04)
2	Odour	-	Agreeable	Agreeable	Agreeable	IS 3025 (Pt-05)
3	pH	-	7.20	6.5-8.5	No relaxation	IS 3025 (Pt-11)
4	Taste	-	Agreeable	Agreeable	Agreeable	IS 3025 (Pt-08)
5	Turbidity	NTU	BDL(DL-1.0)	1	5	IS 3025 (Pt-10)
6	Total Dissolved	mg/l	120	500	2000	IS 3025 (Pt-16)

“Expansion of Action Cancer Hospital A-4” located at Paschim Vihar, Near Paschim Vihar East Metro Station, New Delhi by M/s Action Cancer Hospital

	Solids					
7	Ammonia (as total ammonia-N)	mg/l	BDL (DL0.5)	0.5	No relaxation	IS 3025 (Pt-34)
8	Anionic Detergents (as MBAS)	mg/l	BDL (DL0.1)	0.2	1.0	Annex K of IS 13428
9	Calcium as Ca	mg/l	18	75	200	IS 3025 (Pt-40)
10	Chloramines (as Cl ₂)	mg/l	BDL (DL0.1)	4.0	No relaxation	IS 3025 (Pt-26)
11	Chloride as Cl	mg/l	12.4	250	1000	IS 3025 (Pt-32)
12	Fluoride as F	mg/l	BDL(DL0.01)	1.0	1.5	APHA 23 rd Ed 4500F
13	Free Residual Chlorine	mg/l	BDL (DL0.05)	0.2	1	IS 3025 (Pt-26)
14	Nitrate as NO ₃	mg/l	BDL (DL1.0)	45	No relaxation	IS 3025 (Pt-34)
15	PheNolic Compounds (as C ₆ H ₅ OH)	mg/l	BDL (DL 0.001)	0.001	0.002	IS 3025 (Pt-43)
16	Sulphate as SO ₄	mg/l	38	200	400	IS 3025 (Pt-24)
17	Sulphide (as H ₂ S)	mg/l	BDL (DL 0.02)	0.05	No relaxation	IS 3025 (Pt-29)
18	Total Alkalinity as CaCO ₃	mg/l	45	200	600	IS 3025 (Pt-23)
19	Total Hardness as CaCO ₃	mg/l	85	200	600	IS 3025 (Pt-21)
20	Cyanide (as CN)	mg/l	BDL (DL 0.02)	0.05	No relaxation	IS 3025 (Pt-27)
21	Aluminum (as Al)	mg/l	BDL (DL 0.01)	0.03	0.2	APHA23 rd Ed.3120B
22	Barium (as Ba)	mg/l	BDL (DL 0.1)	0.7	No relaxation	APHA 23 rd Ed.3120B
23	Boron (as B)	mg/l	BDL (DL 0.1)	0.5	1.0	APHA 23 rd Ed.3120B
24	Copper (as Cu)	mg/l	BDL (DL 0.02)	0.05	1.5	APHA 23 rd Ed.3120B
25	Iron as Fe	mg/l	BDL (DL 0.05)	1.0	No relaxation	IS 3025 (Pt-53)
26	Magnesium as Mg	mg/l	9.7	30	100	APHA 23 rd Ed.3500B
27	Manganese as Mn	mg/l	BDL (DL 0.05)	0.1	0.3	APHA 23 rd Ed.3120B
28	Selenium (as Se)	mg/l	BDL (DL 0.01)	0.01	No relaxation	APHA 23 rd Ed.3120B
29	Silver (as Ag)	mg/l	BDL (DL 0.05)	0.1	No relaxation	APHA 23 rd Ed.3120B
30	Zinc (as Zn)	mg/l	BDL (DL 0.05)	5	15	APHA 23 rd Ed.3120B
31	Cadmium (as Cd)	mg/l	BDL (DL 0.001)	0.003	No relaxation	APHA 23 rd Ed.3120B
32	Lead (as Pb)	mg/l	BDL (DL 0.005)	0.01	No	APHA

“Expansion of Action Cancer Hospital A-4” located at Paschim Vihar, Near Paschim Vihar East Metro Station, New Delhi by M/s Action Cancer Hospital

					relaxation	23 rd Ed.3120B
33	Mercury (as Hg)	mg/l	BDL (DL0.001)	0.001	No relaxation	APHA 23 rd Ed.3120B
34	Molybdenum (as MO)	mg/l	BDL (DL 0.05)	0.07	No relaxation	APHA 23 rd Ed.3120B
35	Nickel (as Ni)	mg/l	BDL (D L0.01)	0.02	No relaxation	APHA 23 rd Ed.3120B
36	Total Arsenic (as As)	mg/l	BDL (DL 0.01)	0.01	No relaxation	APHA 23 rd Ed.3120B
37	Total Chromium (as Cr)	mg/l	BDL (DL 0.03)	0.05	No relaxation	APHA 23 rd Ed.3120B

Table 3(b): - Drinking Water Monitoring Results (28/09/2024)

S. No	Test Parameters	Units	Results	IS 10500 : 2012		Test Method
				Acceptable Limit, max.	Permissible Limit in the Absence of Alternate source, max.	
1	Color	Hazen	BDL (DL-5.0)	5	15	IS 3025 (Pt-04)
2	Odour	-	Agreeable	Agreeable	Agreeable	IS 3025 (Pt-05)
3	pH	-	7.71	6.5-8.5	No relaxation	IS 3025 (Pt-11)
4	Taste	-	Agreeable	Agreeable	Agreeable	IS 3025 (Pt-08)
5	Turbidity	NTU	BDL(DL-1.0)	1	5	IS 3025 (Pt-10)
6	Total Dissolved Solids	mg/l	178	500	2000	IS 3025 (Pt-16)
7	Ammonia (as total ammonia-N)	mg/l	BDL (DL0.5)	0.5	No relaxation	IS 3025 (Pt-34)
8	Anionic Detergents (as MBAS)	mg/l	BDL (DL0.1)	0.2	1.0	Annex K of IS 13428
9	Calcium as Ca	mg/l	42	75	200	IS 3025 (Pt-40)
10	Chloramines (as Cl ₂)	mg/l	BDL (DL0.1)	4.0	No relaxation	IS 3025 (Pt-26)
11	Chloride as Cl	mg/l	15	250	1000	IS 3025 (Pt-32)
12	Fluoride as F	mg/l	BDL (DL0.01)	1.0	1.5	APHA 23 rd Ed 4500F
13	Free Residual Chlorine	mg/l	BDL (DL0.05)	0.2	1	IS 3025 (Pt-26)
14	Nitrate as NO ₃	mg/l	BDL (DL1.0)	45	No relaxation	IS 3025 (Pt-34)
15	PheNolic Compounds (as C ₆ H ₅ OH)	mg/l	BDL (DL 0.001)	0.001	0.002	IS 3025 (Pt-43)
16	Sulphate as SO ₄	mg/l	65	200	400	IS 3025 (Pt-24)
17	Sulphide (as H ₂ S)	mg/l	BDL(DL 0.02)	0.05	No relaxation	IS 3025 (Pt-29)

“Expansion of Action Cancer Hospital A-4” located at Paschim Vihar, Near Paschim Vihar East Metro Station, New Delhi by M/s Action Cancer Hospital

18	Total Alkalinity as CaCO_3	mg/l	.50	200	600	IS 3025 (Pt-23)
19	Total Hardness as CaCO_3	mg/l	150	200	600	IS 3025 (Pt-21)
20	Cyanide (as CN)	mg/l	BDL(DL 0.02)	0.05	No relaxation	IS 3025 (Pt-27)
21	Aluminum (as Al)	mg/l	BDL (DL 0.01)	0.03	0.2	APHA 23 rd Ed.3120B
22	Barium (as Ba)	mg/l	BDL (DL 0.1)	0.7	No relaxation	APHA 23 rd Ed.3120B
23	Boron (as B)	mg/l	BDL (DL 0.1)	0.5	1.0	APHA 23 rd Ed.3120B
24	Copper (as Cu)	mg/l	BDL(DL 0.02)	0.05	1.5	APHA 23 rd Ed.3120B
25	Iron as Fe	mg/l	BDL (DL 0.05)	1.0	No relaxation	IS 3025 (Pt-53)
26	Magnesium as Mg	mg/l	10.9	30	100	APHA 23 rd Ed.3500B
27	Manganese as Mn	mg/l	BDL (DL 0.05)	0.1	0.3	APHA 23 rd Ed.3120B
28	Selenium (as Se)	mg/l	BDL (DL 0.01)	0.01	No relaxation	APHA 23 rd Ed.3120B
29	Silver (as Ag)	mg/l	BDL (DL 0.05)	0.1	No relaxation	APHA 23 rd Ed.3120B
30	Zinc (as Zn)	mg/l	BDL (DL 0.05)	5	15	APHA 23 rd Ed.3120B
31	Cadmium (as Cd)	mg/l	BDL(DL 0.001)	0.003	No relaxation	APHA 23 rd Ed.3120B
32	Lead (as Pb)	mg/l	BDL(DL 0.005)	0.01	No relaxation	APHA 23 rd Ed.3120B
33	Mercury (as Hg)	mg/l	BDL (DL0.001)	0.001	No relaxation	APHA 23 rd Ed.3120B
34	Molybdenum (as MO)	mg/l	BDL (DL 0.05)	0.07	No relaxation	APHA 23 rd Ed.3120B
35	Nickel (as Ni)	mg/l	BDL (D L0.01)	0.02	No relaxation	APHA 23 rd Ed.3120B
36	Total Arsenic (as As)	mg/l	BDL (DL 0.01)	0.01	No relaxation	APHA 23 rd Ed.3120B
37	Total Chromium (as Cr)	mg/l	BDL (DL 0.03)	0.05	No relaxation	APHA 23 rd Ed.3120B

4. Soil monitoring

Schedule for Soil monitoring are given in **Table 4**.

Table 4: Schedule for Soil sample collection

Sample collected on	Locations
10/06/2024	Near By ACH backside area
28/09/2024	Near By ACH backside area

Soil monitoring was monitored for Soil monitoring. The results are furnished in **Table-4(a)** below: -

Table 6(a): Results of Soil monitoring Project Area (10/06/2024)

S.No.	Test Parameters	Unit	Result	Test Method
1	pH (1:5)	-	8.44	IS 2720(P-26)1987
2	Conductivity (1:5)	µmhos/cm	372	IS 14767:2000
3	Bulk Density	gm/cc	1.32	ELPL/III/SOP/40
4	Chloride as Cl	mg/kg	446	ELPL/III/SOP/46
5	Calcium as Ca	mg/kg	6208	ELPL/III/SOP/42
6	Magnesium as Mg	mg/kg	632	ELPL/III/SOP/43
7	Organic matter	%	0.52	IS 2720(P-22):1972
8	Phosphorous	mg/kg	76	ELPL/III/SOP/47
9	Moisture	%	26.1	ELPL/III/SOP/53
10	Sulphate	mg/kg	136	IS:3025 (P-24)
11	Iron	mg/kg	48	USEPA 6010C:2000
12	Lead	mg/kg	BDL (DL-2.0)	USEPA 6010C:2000

Table 4(b): Results of Soil monitoring (28/09/2024)

S.No.	Test Parameters	Unit	Result	Test Method
1	pH (1:5)	-	8.12	IS 2720(P-26)1987
2	Conductivity (1:5)	µmhos/cm	396	IS 14767:2000
3	Bulk Density	gm/cc	1.28	ELPL/III/SOP/40
4	Chloride as Cl	mg/kg	527	ELPL/III/SOP/46
5	Calcium as Ca	mg/kg	6426	ELPL/III/SOP/42
6	Magnesium as Mg	mg/kg	814	ELPL/III/SOP/43
7	Organic matter	%	0.50	IS 2720(P-22): 1972
8	Phosphorous	mg/kg	80	ELPL/III/SOP/47
9	Moisture	%	22	ELPL/III/SOP/53
10	Sulphate	mg/kg	144	IS:3025(P-24)
11	Iron	mg/kg	55	USEPA 6010C:2000
12	Lead	mg/kg	BDL (DL-2.0)	USEPA 6010C:2000

5. STP Inlet monitoring

Schedule for STP Inlet monitoring are given in **Table 5**.

Table 5: Schedule for STP Inlet sample collection

Sample collected on	Locations
10/06/2024	STP Plant Room
28/09/2024	STP Plant Room

Table 5(a): Results of STP Inlet monitoring (10/06/2024)

S.No.	Test Parameters	Units	Results	Test Method
1	pH	-	6.50	IS 3025 (P-11)
2	Oil and grease	mg/l	10	IS 3025 (P-39)
3	Biochemical oxygen demand as BOD at 27°C for 3 days	mg/l	130	IS 3025 (P-44)
4	Chemical oxygen demand as COD	mg/l	360	IS 3025 (P-58)
5	Total suspended solids as TSS	mg/l	62	IS 3025 (P-17)

Table 5(b): Results of STP Inlet monitoring (28/09/2024)

S.No.	Test Parameters	Units	Results	Test Method
1	pH	-	7.0	IS 3025 (P-11)
2	Oil and grease	mg/l	20	IS 3025 (P-39)
3	Biochemical oxygen demand as BOD at 27°C for 3 days	mg/l	340	IS 3025 (P-44)
4	Chemical oxygen demand as COD	mg/l	810	IS 3025 (P-58)
5	Total suspended solids as TSS	mg/l	146	IS 3025 (P-17)

6. STP Outlet monitoring

Schedule for STP Outlet monitoring is given in **Table 6**.

Table 6: Schedule for STP Outlet sample collection

Sample collected on	Locations
10/06/2024	STP Plant Room
28/09/2024	STP Plant Room

Table 6(a): Results of STP Outlet monitoring (10/06/2024)

S.No.	Test Parameters	Units	Results	As Per CPCB Norms	Test Method
1	pH	-	7.00	5.5-9.0	IS 3025 (P-11)
2	Oil and grease	mg/l	03	10	IS 3025 (P-39)
3	Biochemical oxygen demand as BOD at 27°C for 3 days	mg/l	24	30	IS 3025 (P-44)
4	Chemical oxygen demand as COD	mg/l	120	250	IS 3025 (P-58)
5	Total suspended solids as TSS	mg/l	28	100	IS 3025 (P-17)

Table 6(b): Results of STP Outlet monitoring (28/09/2024)

“Expansion of Action Cancer Hospital A-4” located at Paschim Vihar, Near Paschim Vihar East Metro Station, New Delhi by M/s Action Cancer Hospital

S.No.	Test Parameters	Units	Results	As Per CPCB Norms	Test Method
1	pH	-	6.49	5.5-9.0	IS 3025 (P-11)
2	Oil and grease	mg/l	3.5	19	IS 3025 (P-39)
3	Biochemical oxygen demand as BOD at 27°C for 3 days	mg/l	20	30	IS 3025 (P-44)
4	Chemical oxygen demand as COD	mg/l	110	250	IS 3025 (P-58)
5	Total suspended solids as TSS	mg/l	30	100	IS 3025 (P-17)

Annexure-VIII

Copy of the Authorization & agreement for

BMW Management



DELHI POLLUTION CONTROL COMMITTEE

(Government of N.C.T. of Delhi)

4th & 5th Floor, ISBT Building Kashmere Gate, Delhi 110006

visit us at: <https://dpccocmms.nic.in>

(AUTHORIZATION UNDER BIO MEDICAL WASTE MANAGEMENT RULES, 2016)

File number of authorization : DPCC/(11)(5)(01)/2022/BMW/NST/AUTH/6977312

Application No: 6926999

Date:20/04/2022

1. M/s ACTION CANCER HOSPITAL (A UNIT OF MANAV SEVARTH TRUST) an occupier of the facility located at A-4,FC 34 H2 PASCHIM VIHAR 110063 is hereby granted this authorization for Generation, Segregation, Collection, Storage, Transportation, of Biomedical Waste at the premises and for Transportation, Treatment and Disposal of Bio-Medical Waste through Common Bio-Medical Waste Treatment Facility (CBMWTF) authorized by Delhi Pollution Control Committee.
2. Number of beds of HCF : 130
3. Quantity of Biomedical waste handled : 118.40 (Kg/day)
4. This authorization shall be in force for a period of Five Years and valid up to 15/12/2026.
5. This authorisation is subject to the conditions stated below and to such other conditions as may be specified in the rules for the time being in force under the Environment (Protection) Act, 1986.

Digitally signed by
Prem Swarup Pankaj
Prem Swarup Pankaj
Date: 2022.04.22
13:24:05 +05'30'
Signature.....
Designation

-:-Terms and Conditions:-

1. The occupier shall comply with the provisions of Bio-Medical Waste Management Rules, 2016 as amended to date.
2. The authorization or its renewal shall be produced for inspection at the request of any officer authorized by DPCC.
3. The occupier shall ensure that bio-medical waste is not mixed with other wastes and is segregated into containers / bags at the point of generation in accordance with Schedule-I (part I).
4. The occupier shall have a valid agreement with the operator of a facility authorized by DPCC for collection, transportation, treatment & disposal of the bio-medical waste.
5. The Occupier shall hand over the bio-medical waste timely to the authorized operator of a facility duly segregated, labelled, tagged and kept in proper containers for the collection, transportation, treatment & disposal as per Rules.
6. The occupier shall inform the prescribed authority immediately in case the operator of facility does not collect the bio medical waste with in the intended time or as per the agreed time.
7. The occupier shall maintain records of the Bio-Medical Waste generated and disposed of/ handed over. The record shall be made available, for inspection & verification, to any officer authorized by DPCC.
8. In case of any major accident involving Bio-Medical Waste, the occupier shall report the accident in Form-I, prescribed under the Rules, to DPCC.
9. In case the Occupier is having a DG Set, he shall comply with the noise standards laid down vide Gazette

SMS WATER GRACE
ACH

UC77

INDIA NON JUDICIAL



Government of National Capital Territory of Delhi

e-Stamp

Certificate No. : IN-DL28707794590814U
Certificate Issued Date : 09-Dec-2022 02:20 PM
Account Reference : IMPACC (IV) d782403/ DELHI/ DL-DLH
Unique Doc. Reference : SUBIN-DLDL78240332374438171391U
Purchased by : SMS WATER GRACE BMW PVT LTD
Description of Document : Article 5 General Agreement
Property Description : Not Applicable
Consideration Price (Rs.) : 0
(Zero)
First Party : SMS WATER GRACE BMW PVT LTD
Second Party : Not Applicable
Stamp Duty Paid By : SMS WATER GRACE BMW PVT LTD
Stamp Duty Amount(Rs.) : 10
(Ten only)

सत्यमेव जपते



Please write or type below this line

This agreement is made and executed at New Delhi on this 20 day of January 2023

BY AND BETWEEN

M/s SMS WATER GRACE BMW PVT. LTD., having its office at Sewage Treatment Plant, Delhi Jal Board Complex, Nilothi, New Delhi- 110041 (For short hereinafter referred to as 'Service Provider') through its Mr. Prabal Pratap Singh Jaison, Sr. Manager to enter into and sign this agreement for and on behalf of the Service Provider of the ONE PART.

Prabal



Statutory Alert:

1. The authenticity of this Stamp certificate should be verified at www.stampcertification.nic.in. Any discrepancy in the details on this Certificate and as available on the above website shall render this stamp certificate invalid.
2. The onus of checking the legitimacy is on the users of the certificate.
3. In case of any discrepancy, please inform the Competent Authority.

Medical Superintendent

AND

ACTION CANCER HOSPITAL through its Proprietor/Partner/Authorized Representative Mr./Dr. Archana Atreja of the OTHER PART. (For Short hereinafter referred to as "Waste Generator")

The expression of both the parties shall mean and include the parties, their respective legal heirs, successors, legal representatives, administrators, executors and assignees.

Whereas the Service Provider has been selected by Director of Health Services (DHS), Health & Family Welfare, Govt. Of N.C.T. of Delhi and duly authorized by the Delhi Pollution Control Committee (DPCC), under rule of 8(4) of the Bio-Medical Waste (Management & Handling) Rules 2016 for operating and providing facility for the collection, Reception, Treatment, Storage, Transportation and disposal of the bio-Medical Waste. And whereas the Waste Generator is desirous of out sourcing the disposal of its Bio-Medical Waste and have approached the service provider for providing its service in this regard and after discussions and due negotiations taken place, both the parties are agreed to enter into this agreement on the terms and conditions narrated herein after:-

NOW THIS AGREEMENT witnessed the following terms & conditions to be performed to by both parties to the present agreement.

1. That the Waste Generator will segregate, pack and label the bio-medical waste in the colour coded bags from the waste generation points as per guidelines of Bio-Medical Waste (Management & Handling) Rules 2016 and keep the said packed waste ready for collection by the staff of the Service Provider. The Service Provider will not collect any Bio-Medical waste which is not properly segregate and packed in accordance with guidelines of Bio-Medical Waste (Management & Handling) Rules 2016. The record of the collected waste shall be maintained by the Waste Generator with the acknowledgements signatures of the collection staff of the Service Provider to submit the annual Report to the concern Pollution Board in the prescribed format.
2. That the Waste Generator will deposit N/A Advance payment against the BMW disposal services and if the health care unit is closed before expiration of agreement the Service Provider will refund the balance amount after adjusting all the dues if any outstanding towards the Waste Generator.
3. That the Service Provider will charge to the Waste Generator, being Clinic/Pathological Lab/Diagnostic Centre etc. (Not having bed facilities) and being a Nursing Home/Hospital (Having Bed facilities) as per the following schedule of rates:



(i) Minimum charges of Rs.40,000/- (Rs. FORTY THOUSAND ONLY) + 12% GST per month for clinic/ Labs/ ladies hostels /Diagnostic Center/hospital (Beds 130) subject to a maximum collection of waste up to N/A Extra quantity of waste will be chargeable@ Rs.N/A per Kg. The service tax shall be borne by the Waste Generator upon the respective billings.

(ii) The rates enumerated in clause 3(i) above may be varied at any given point of time due to hike in fuel Price, Wages for Labour negotiation with any unanimous body i.e. DMA/IMA at District or state level or any other factor which may effect the cost.

4. That the waste generator undertakes to make the payment through 'Account Payee Cheque or Demand Draft' in favour of the M/s SMS WATER GRACE BMW PVT. LTD. On before 15th day of each successive month and thereafter the interest@ 18% for p.a. shall be Service Provider if the payment is not made within the stipulated period.

5. (a) Notwithstanding the aforesaid terms this agreement may be terminated by either party by giving 30 days written notice. However this requirement of 30 days notice shall not be applicable in the event the service charges are not paid by the Second Party as provided in Clause 6 of this agreement or upon the occurrence of any of events specified in Clause 5b (i) & (ii) in which events the service would be suspended/ terminated forthwith.


(b) Notwithstanding the aforesaid terms and conditions:-

- i. The Service Provider will be at liberty to discontinue this service to the Waste generator in the event: the Waste Generator does not pay the service charges.
- ii. The waste generator and Service Provider both to strictly follow the guidelines of the Bio-Medical Waste (Management & Handling) Rules 2016, during segregation, collection, Transportation and disposal of the bio-Medical Waste except due to the circumstances under force majeure clause and the circumstances beyond their control of the parties.

(c) That upon expiry of the term or the earlier termination of this agreement, the accounts shall be settled and the refundable and interest free Advance deposit referred to in Clause 2 above shall be returned without any interest thereon to the Waste Generator after the circumstance beyond their control of the parties.


6. That all the taxes, such as Contract Sales tax, Service Tax etc., if applicable, shall be paid and borne by the Waste Generator.

Rehman:
Medical Superintendent
ACTION CANCER HOSPITAL
In-Part of Manav Seva Trust



The stamp is circular with the text "SMS Water Grace BMW Pvt. Ltd." around the perimeter and "RECEIVED" in the center.


7. The neither party shall transfer and /or assign the rights granted under this agreement without the prior intimation and written permission of the other party and without obtaining a written undertaking by the proposed assignee/transferee agreeing to assume all of the said party 's obligations under this agreement and to abide by all the obligations and covenants contained herein.
8. That this agreement shall be governed by the laws of India and shall be interpreted and construed in accordance with the laws of India and Subject to the jurisdiction of Courts at Delhi, shall have exclusive jurisdiction to try, entertain and dispose between the parties thereto. All the notice, request, demands and other communications, required/permited to be given under this Agreement shall be in writing.
9. That the waste generator should get from time to time the service contract Agreement renewed from the service provider one month before the expiry of the validity of the Agreement. The Waste generator further undertakes to keep the validity period of the agreement for a minimum period of one year from the date of service as per pollution Control Committee/Board Rule and in between if the agreement is cancelled, they should directly intimate pollution control committee / Board with adequate reason about the cancelation of the agreement, failing which, all the consequence and penalties will be borne by the waste generate. Further, The waste generate also undertakes to give one month notice in writing if they want to discontinue the service and wish to switch over to another service provider failing which, they have to pay the service charge equivalent in one month minimum service charges to the service provider in lieu of one monthly notice period.
10. That in case the service contract agreement gets misplaced at the waste generator end, then an additional Rs. 100/- will be charged from the generation of issuing the agreement once again.
11. That the waste generator further undertakes to sign every page of the agreement and return both copies of the agreement to the service provider's signature and the services provider will return the duplicate copy of the agreement to the waste generator. On receipt of the agreement to the Waste generator will submit a copy of the agreement with the date of service expiry to the pollution control committee /board.
12. The term of this Agreement shall be for a period commencing from **01-04-2023 to 31-03-2024.**
13. That in case there is any change in the constitution of waste generator the same shall be informed forth with to the service provider.

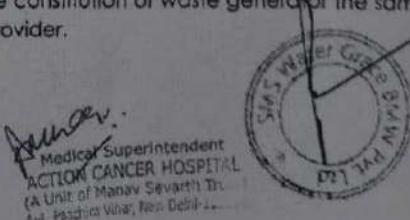

14. That both the parties under take to remain bound by the term and conditions set out herein above.

IN WITNESS WHEREOF, THE PARTIES HERE TO HAVE SET THERE SIGNATURE AND SEAL ON THE DAY AND YEAR MENTIONED HEREIN ABOVE.

WASTE GENERATOR


ATAUTHORIZED SIGNATOR General Superintendent
ACTION CANCER HOSPITAL

Address: (A unit of Manav Sevaarth Trust)
A-4, Paschim Vihar, New Delhi-110063


ACTION CANCER HOSPITAL,
H-2, A-4, PASCHIM VIHAR,
NEW DELHI-110063


Email:-


Fax: _____

Witness - H.C.E.

1.


13/01/2013


14/01/23


SMS WATER GRACE BMWPL LTD.
Grace
SWS

AUTHORISED SIGNATOR

Sewage Treatment Plant,

Delhi Jal Board Complex

New Delhi-110041


Ph: +91-8744076042

web : www.smsbmw.in

Email: prabal.singh@smpl.co.in

Witness:- SMSWGBMWPL

1.


8744076043

Annexure-X

Photograph of Separate wet and dry bins



Annexure-VIII

Copy of the Authorization & agreement for

BMW Management



DELHI POLLUTION CONTROL COMMITTEE

(Government of N.C.T. of Delhi)

4th & 5th Floor, ISBT Building Kashmere Gate, Delhi 110006

visit us at: <https://dpccocmms.nic.in>

(AUTHORIZATION UNDER BIO MEDICAL WASTE MANAGEMENT RULES, 2016)

File number of authorization : DPCC/(11)(5)(01)/2022/BMW/NST/AUTH/6977312

Application No: 6926999

Date:20/04/2022

1. M/s ACTION CANCER HOSPITAL (A UNIT OF MANAV SEVARTH TRUST) an occupier of the facility located at A-4,FC 34 H2 PASCHIM VIHAR 110063 is hereby granted this authorization for Generation, Segregation, Collection, Storage, Transportation, of Biomedical Waste at the premises and for Transportation, Treatment and Disposal of Bio-Medical Waste through Common Bio-Medical Waste Treatment Facility (CBMWTF) authorized by Delhi Pollution Control Committee.
2. Number of beds of HCF : 130
3. Quantity of Biomedical waste handled : 118.40 (Kg/day)
4. This authorization shall be in force for a period of Five Years and valid up to 15/12/2026.
5. This authorisation is subject to the conditions stated below and to such other conditions as may be specified in the rules for the time being in force under the Environment (Protection) Act, 1986.

Digitally signed by
Prem Swarup Pankaj
Prem Swarup Pankaj
Date: 2022.04.22
13:24:05 +05'30'
Signature.....
Designation

-:-Terms and Conditions:-

1. The occupier shall comply with the provisions of Bio-Medical Waste Management Rules, 2016 as amended to date.
2. The authorization or its renewal shall be produced for inspection at the request of any officer authorized by DPCC.
3. The occupier shall ensure that bio-medical waste is not mixed with other wastes and is segregated into containers / bags at the point of generation in accordance with Schedule-I (part I).
4. The occupier shall have a valid agreement with the operator of a facility authorized by DPCC for collection, transportation, treatment & disposal of the bio-medical waste.
5. The Occupier shall hand over the bio-medical waste timely to the authorized operator of a facility duly segregated, labelled, tagged and kept in proper containers for the collection, transportation, treatment & disposal as per Rules.
6. The occupier shall inform the prescribed authority immediately in case the operator of facility does not collect the bio medical waste with in the intended time or as per the agreed time.
7. The occupier shall maintain records of the Bio-Medical Waste generated and disposed of/ handed over. The record shall be made available, for inspection & verification, to any officer authorized by DPCC.
8. In case of any major accident involving Bio-Medical Waste, the occupier shall report the accident in Form-I, prescribed under the Rules, to DPCC.
9. In case the Occupier is having a DG Set, he shall comply with the noise standards laid down vide Gazette

SMS WATER GRACE
ACH

UC77

INDIA NON JUDICIAL



Government of National Capital Territory of Delhi

e-Stamp

Certificate No. : IN-DL28707794590814U
Certificate Issued Date : 09-Dec-2022 02:20 PM
Account Reference : IMPACC (IV) d782403/ DELHI/ DL-DLH
Unique Doc. Reference : SUBIN-DLDL78240332374438171391U
Purchased by : SMS WATER GRACE BMW PVT LTD
Description of Document : Article 5 General Agreement
Property Description : Not Applicable
Consideration Price (Rs.) : 0
(Zero)
First Party : SMS WATER GRACE BMW PVT LTD
Second Party : Not Applicable
Stamp Duty Paid By : SMS WATER GRACE BMW PVT LTD
Stamp Duty Amount(Rs.) : 10
(Ten only)

सत्यमेव जपते



Please write or type below this line

This agreement is made and executed at New Delhi on this 20 day of January 2023

BY AND BETWEEN

M/s SMS WATER GRACE BMW PVT. LTD., having its office at Sewage Treatment Plant, Delhi Jal Board Complex, Nilothi, New Delhi- 110041 (For short hereinafter referred to as 'Service Provider') through its Mr. Prabal Pratap Singh Jaison, Sr. Manager to enter into and sign this agreement for and on behalf of the Service Provider of the ONE PART.

Prabal



Statutory Alert:

1. The authenticity of this Stamp certificate should be verified at www.stampcertification.nic.in. Any discrepancy in the details on this Certificate and as available on the above website shall render this stamp certificate invalid.
2. The onus of checking the legitimacy is on the users of the certificate.
3. In case of any discrepancy, please inform the Competent Authority.

Medical Superintendent

AND


ACTION CANCER HOSPITAL through its Proprietor/Partner/Authorized Representative Mr./Dr. Archana Atreja of the OTHER PART. (For Short hereinafter referred to as "Waste Generator")

The expression of both the parties shall mean and include the parties, their respective legal heirs, successors, legal representatives, administrators, executors and assignees.

Whereas the Service Provider has been selected by Director of Health Services (DHS), Health & Family Welfare, Govt. Of N.C.T. of Delhi and duly authorized by the Delhi Pollution Control Committee (DPCC), under rule of 8(4) of the Bio-Medical Waste (Management & Handling) Rules 2016 for operating and providing facility for the collection, Reception, Treatment, Storage, Transportation and disposal of the bio-Medical Waste. And whereas the Waste Generator is desirous of out sourcing the disposal of its Bio-Medical Waste and have approached the service provider for providing its service in this regard and after discussions and due negotiations taken place, both the parties are agreed to enter into this agreement on the terms and conditions narrated herein after:-

NOW THIS AGREEMENT witnessed the following terms & conditions to be performed to by both parties to the present agreement.

1. That the Waste Generator will segregate, pack and label the bio-medical waste in the colour coded bags from the waste generation points as per guidelines of Bio-Medical Waste (Management & Handling) Rules 2016 and keep the said packed waste ready for collection by the staff of the Service Provider. The Service Provider will not collect any Bio-Medical waste which is not properly segregate and packed in accordance with guidelines of Bio-Medical Waste (Management & Handling) Rules 2016. The record of the collected waste shall be maintained by the Waste Generator with the acknowledgements signatures of the collection staff of the Service Provider to submit the annual Report to the concern Pollution Board in the prescribed format.
2. That the Waste Generator will deposit N/A Advance payment against the BMW disposal services and if the health care unit is closed before expiration of agreement the Service Provider will refund the balance amount after adjusting all the dues if any outstanding towards the Waste Generator.
3. That the Service Provider will charge to the Waste Generator, being Clinic/Pathological Lab/Diagnostic Centre etc. (Not having bed facilities) and being a Nursing Home/Hospital (Having Bed facilities) as per the following schedule of rates:

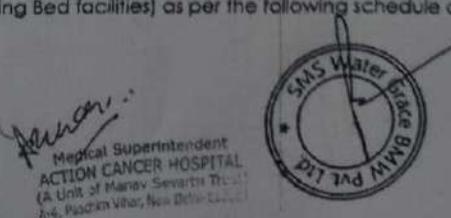

(i) Minimum charges of Rs.40,000/- (Rs. FORTY THOUSAND ONLY) + 12% GST per month for clinic/ Labs/ ladies hostels /Diagnostic Center/hospital (Beds 130) subject to a maximum collection of waste up to N/A Extra quantity of waste will be chargeable@ Rs.N/A per Kg. The service tax shall be borne by the Waste Generator upon the respective billings.

(ii) The rates enumerated in clause 3(i) above may be varied at any given point of time due to hike in fuel Price, Wages for Labour negotiation with any unanimous body i.e. DMA/IMA at District or state level or any other factor which may effect the cost.

4. That the waste generator undertakes to make the payment through 'Account Payee Cheque or Demand Draft' in favour of the M/s SMS WATER GRACE BMW PVT. LTD. On before 15th day of each successive month and thereafter the interest@ 18% for p.a. shall be Service Provider if the payment is not made within the stipulated period.

5. (a) Notwithstanding the aforesaid terms this agreement may be terminated by either party by giving 30 days written notice. However this requirement of 30 days notice shall not be applicable in the event the service charges are not paid by the Second Party as provided in Clause 6 of this agreement or upon the occurrence of any of events specified in Clause 5b (i) & (ii) in which events the service would be suspended/ terminated forthwith.


(b) Notwithstanding the aforesaid terms and conditions:-

- i. The Service Provider will be at liberty to discontinue this service to the Waste generator in the event: the Waste Generator does not pay the service charges.
- ii. The waste generator and Service Provider both to strictly follow the guidelines of the Bio-Medical Waste (Management & Handling) Rules 2016, during segregation, collection, Transportation and disposal of the bio-Medical Waste except due to the circumstances under force majeure clause and the circumstances beyond their control of the parties.

(c) That upon expiry of the term or the earlier termination of this agreement, the accounts shall be settled and the refundable and interest free Advance deposit referred to in Clause2 above shall be returned without any interest thereon to the Waste Generator after the circumstance beyond their control of the parties.


6. That all the taxes, such as Contract Sales tax, Service Tax etc., if applicable, shall be paid and borne by the Waste Generator.

Ramachandran
Medical Superintendent
ACTION CANCER HOSPITAL
A Unit of Manav Seva Sangh Trust



The stamp is circular with the text "SMS Water Grace BMW Pvt. Ltd." around the perimeter and "PVT. LTD." in the center.


7. The neither party shall transfer and /or assign the rights granted under this agreement without the prior intimation and written permission of the other party and without obtaining a written undertaking by the proposed assignee/transferee agreeing to assume all of the said party 's obligations under this agreement and to abide by all the obligations and covenants contained herein.
8. That this agreement shall be governed by the laws of India and shall be interpreted and construed in accordance with the laws of India and Subject to the jurisdiction of Courts at Delhi, shall have exclusive jurisdiction to try, entertain and dispose between the parties thereto. All the notice, request, demands and other communications, required/permited to be given under this Agreement shall be in writing.
9. That the waste generator should get from time to time the service contract Agreement renewed from the service provider one month before the expiry of the validity of the Agreement. The Waste generator further undertakes to keep the validity period of the agreement for a minimum period of one year from the date of service as per pollution Control Committee/Board Rule and in between if the agreement is cancelled, they should directly intimate pollution control committee / Board with adequate reason about the cancelation of the agreement, failing which, all the consequence and penalties will be borne by the waste generate. Further, The waste generate also undertakes to give one month notice in writing if they want to discontinue the service and wish to switch over to another service provider failing which, they have to pay the service charge equivalent in one month minimum service charges to the service provider in lieu of one monthly notice period.
10. That in case the service contract agreement gets misplaced at the waste generator end, then an additional Rs. 100/- will be charged from the generation of issuing the agreement once again.
11. That the waste generator further undertakes to sign every page of the agreement and return both copies of the agreement to the service provider's signature and the services provider will return the duplicate copy of the agreement to the waste generator. On receipt of the agreement to the Waste generator will submit a copy of the agreement with the date of service expiry to the pollution control committee /board.
12. The term of this Agreement shall be for a period commencing from **01-04-2023 to 31-03-2024.**
13. That in case there is any change in the constitution of waste generator the same shall be informed forth with to the service provider.

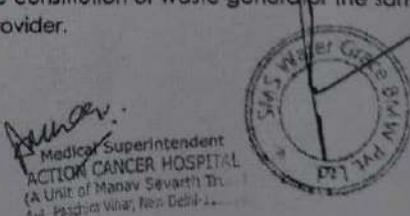

14. That both the parties under take to remain bound by the term and conditions set out herein above.

IN WITNESS WHEREOF, THE PARTIES HERE TO HAVE SET THERE SIGNATURE AND SEAL ON THE DAY AND YEAR MENTIONED HEREIN ABOVE.

WASTE GENERATOR


ATAUTHORIZED SIGNATOR General Superintendent
ACTION CANCER HOSPITAL
(A unit of Manav Sevaarth Trust)
Address: A-4, Paschim Vihar, New Delhi-110063


ACTION CANCER HOSPITAL,
H-2, A-4, PASCHIM VIHAR,
NEW DELHI-110063


Email:-


Fax: _____

Witness - H.C.E.

1.


13/01/2013


14/01/23


SMS WATER GRACE BMWPL LTD.
* * * * *
AUTHORISED SIGNATOR
Sewage Treatment Plant,

Delhi Jal Board Complex

New Delhi-110041


Ph: +91-8744076042

web : www.smsbmw.in

Email: prabal.singh@smstl.co.in

Witness:- SMSWGBMWPL

1.



8744076043

Annexure-XII

Copy of Traffic circulation plan

Annexure-XIII

Copy of Green Belt Development Plan

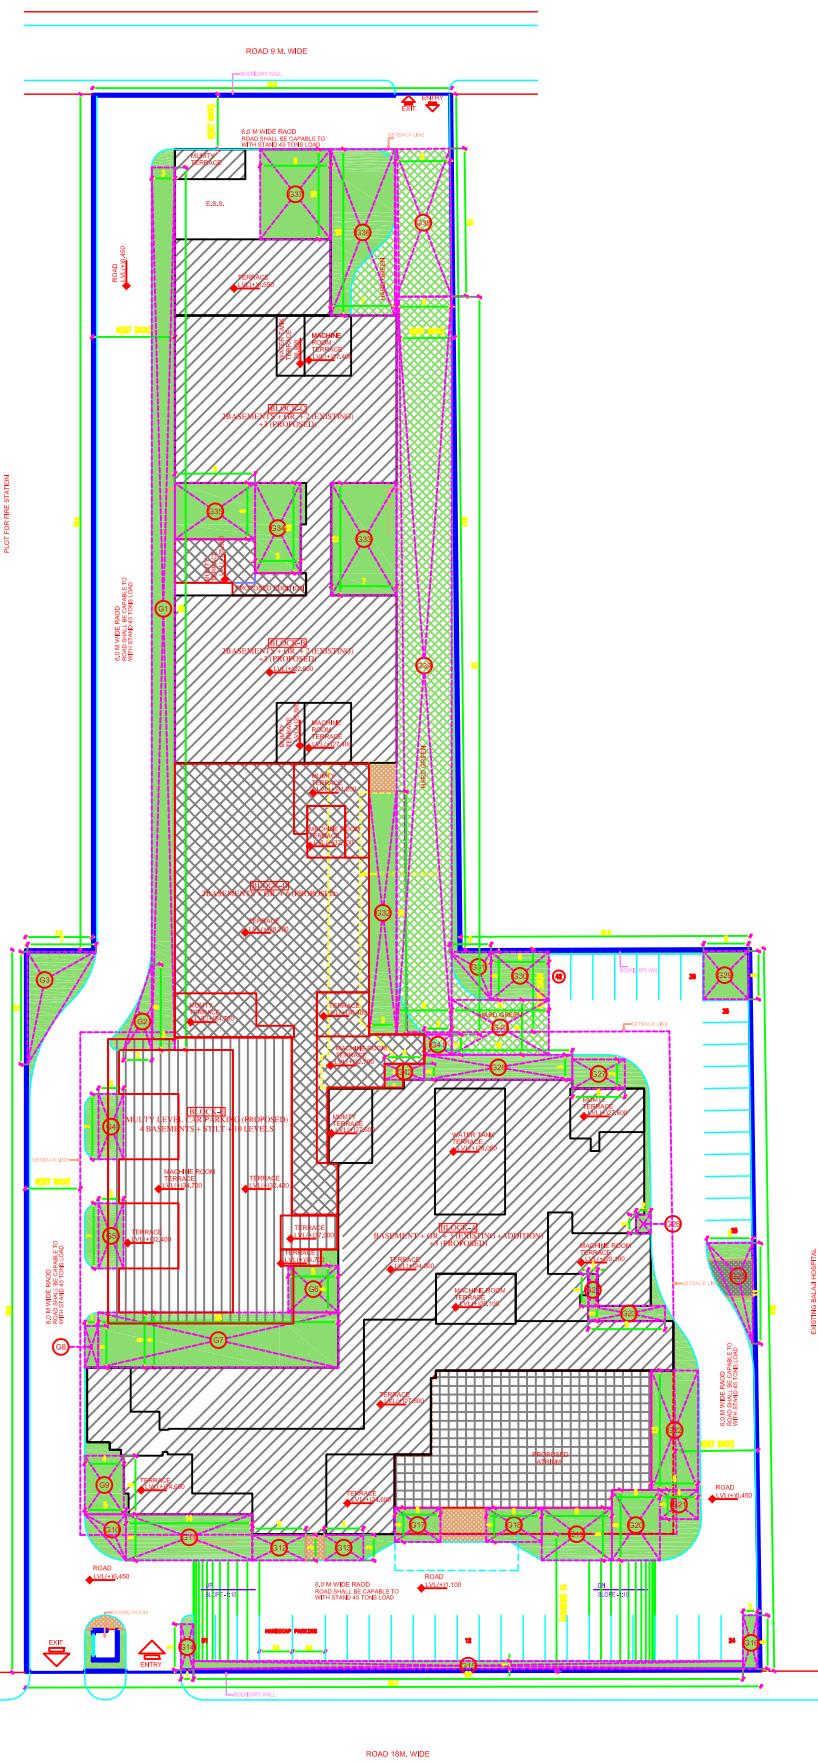


NOTE :-
COMPLETION FOR EXISTING BUILDING OBTAINED
VIDE FILE NUMBER 37/CC/B/E2/07 DATED 31/03/2009

SET BACKS FOR EXISTING BUILDING KEPT AS PER
BYELAWS ALLOWED AT THAT TIME

SET BACKS FOR PROPOSED BUILDING KEPT AS PER
MPD 2021

NOTE:-
THE ENTIRE AREA OF THE BUILDING ON ALL FLOORS IS
MECHANICALLY VENTILATED AND IS AIR CONDITIONED.



Annexure-XIV

**Photographs of Green Belt Development
Area**



Annexure-XIV

**Photographs of Green Belt Development
Area**



Annexure-XV

**Copy of Detailed CER Budget with
activities**

MANAV SEVARTH TRUST

FC-34, A-4 Block, Paschim Vihar, New Delhi-110063

Tel. No. 011-42888950, 42888888

4/119

UNDERTAKING

I, Satyapal S/o Shri Balwant, Authorised signatory of **Manav Sevarth Trust** for the project Expansion of "Action cancer Hospital" at FC-34, Block A-4, Paschim Vihar, Near Paschim Vihar Last Metro Station, New Delhi hereby Solemnly affirm & undertake as under:

That the cost of expansion for project is Rs. 50 cr.

That, the expenditure for Corporate Environment Responsibility (CER) for the above project as per MoEF&CC Office Memorandum no. F.No. 22-65/2017-IA.III dated 01.05.2018 will be 1% of the capital investment on expansion part (Rs. 0.5 crore) of the project.

As per the Office Memorandum some of the activities which can be carried out in CER, are infrastructure creation for drinking water supply, sanitation, health, education, skill development, roads, cross drains, electrification including solar power, solid waste management facilities, scientific support and awareness to local farmers to increase yield of crop and fodder, rain water harvesting, soil and water conservation works, avenue plantation, plantation in community areas, etc.

S. No.	Activity	Provision	Areas	Cost in INR Lakhs					
				1st Year	2nd Year	3rd Year	4th Year	5th Year	Total Cost
1.	Clean drinking water	6 no. Water coolers & tanks (1000 lt.) Fitted with all accessories.	Within 2 km area radius of the hospital subject to land allotted by MCD/DDA	1.0	1.0	1.0	1.0	1.0	5.0
2.	Skill Development	Skill Development for ward boys, Patient care, nurses, maintenance of equipment and admin work by giving training.	Paschim Vihar	6.0	6.0	6.0	6.0	6.0	30.0

Continued


MANAV SEVARATH TRUST

FC-34, A-4 Block, Paschim Vihar, New Delhi-110063

Tel. No. 011-42888950, 42888888

3.	Education	In today scenario, as the cancer is exponentially rising but with advance technology it is manageable & treatable especially in early stages, hence as health care provider it is now our prime responsibility to create awareness amongst the public about early detection of cancer. Education will be imparted to the general public regarding various symptoms so that cancer can be detected at early stages so that it can be cured also. Lectures will be delivered by our oncologists advising them to lead healthy life style & educating them regarding the side effect of tobacco & Alcohol etc	Paschim Vihar	3.0	3.0	3.0	3.0	3.0	15.0
	Total			10.0	10.0	10.0	10.0	10.0	50.0

Manav Sevarath Trust



Authorised Signatory

Annexure-XXI

Copy of land documents

DDA
Papers

214-
LDP

दिल्ली विकास प्राधिकरण
Delhi Development Authority

FILE No.: 11 (2023/24)

प्लॉट नं.

Plot No. 11-2

ब्लॉक नं.

Block No. 1

पॉकेट नं.

Pocket No.


सेक्टर नं.

Sector No. 1

SCHEME FOR VILLAGE CENTRE

पूर्ण प्रयोग: NO. 34 AT PASCHIM PURI.

LAND USE IN P.L.P.

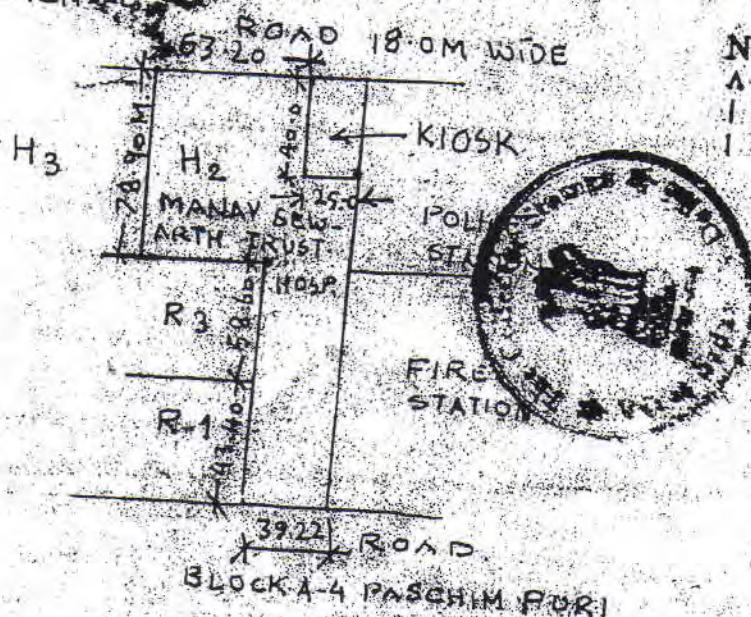

क्षेत्र:
Area: 1.0 Hac. Sq-Yds/Sq-Mts/Acre

पट्टाधारी/वारेंटर
LESSER/VENDEE

PREPARED BY

दिल्ली विकास प्राधिकरण, नई दिल्ली-
Delhi Development Authority

पट्टाधारी/वारेंटर वारा
LESSOR/VENDOR

DDA/PR

MANAV SEVARTH TRUST
FC-34, A-4, PASCHIM VIHAR
NEW DELHI-110063

DL-No. 961212-82

Delhi

INSTITUTIONAL

PERPETUAL LEASE

Sy
S. S. Dated 18/1/2000
Sub Register No. 115-1999
Dated 18/1/2000
S. S. Name
S. S. Name

THIS INDENTURE made this 10th day of January, 2000, in the year of one thousand nine hundred and Two Thousand One, between the President of India (hereinafter called "the Lessor") of the one part and Manav Sevaarth Trust (hereinafter called "the Lessee") through its President/Secretary, Shri/Smt. Major S. A. Puri, of

the Societies Registration Act, 1956, and having its registered office at 506 Hemkant Tower, 98, Nehru Place, New Delhi - 19 (hereinafter called "the Lessee") of the other part.

WHEREAS THE LESSEE HAS applied to the Lessor for the grant of a perpetual lease of nazul land and the Lessor has on the faith of the statements and the representation made by the Lessee agreed to demise the plot of nazul land hereinafter described and in the manner hereinafter appearing.

NOW THIS INDENTURE WITNESSETH that in consideration of the Lessee having paid to the Lessor Rs. 1,23,55,200/- (Rs. One Lakh Twenty Three Thousand Five Hundred and only) as

towards premium before the execution of these presents (the receipt whereof the Lessor hereby acknowledges) and of the rent hereinafter reserved and of the covenants on the part of the Lessee hereinafter contained, the Lessor, doth hereby demise unto the Lessee

ALL THAT plot of nazul land containing by admeasurement an area of 1.12 acres or there about situate at Plot No. 4/2, Pashchim Vihar

which nazul land is more particularly described in the schedule hereunder written and whose boundaries thereof for greater clearness have been delineated on the layout plan annexed to these presents and theron coloured red (hereinafter called "the said nazul land) TOGETHER with all rights, easements and appurtenances whatsoever to the said nazul land belonging or appertaining TO HOLD the premises hereby demised unto the Lessee in perpetuity from the 9th day of January, 2000.

one thousand nine hundred and Ninety Five YIELDING AND PAYING therefore the yearly rent payable in advance of Rs. Three Lac Eight Thousand (Rupees Lakh Eight Thousand only) upto the day of one thousand nine hundred and and thereafter

File No. 33190 dated 21/12/2000

Certified that the instrument is properly stamped under section 32 of the Indian stamp Act. The stamp duty is Rs. 10/-

(2)

@ of 2.5%..... the premium the sum already paid and such other sum or sums hereafter to be paid towards premium under the covenants & conditions hereinafter contained or such other enhanced rent as may hereinafter be assessed under the covenants and conditions hereinafter contained to be paid towards premium under the covenants and conditions hereinafter contained clear of all deductions, by equal half yearly payments on the fifteenth day of January and fifteenth day of July in each year at the Reserve Bank of India, New Delhi, or at such other place as may be notified by the Lessor for this purpose, from time to time the first of such payments to be made on the fifteenth day of..... one thousand nine hundred and and the rent amounting to Rs..... (Rs..... only) from the date of commencement of this lease to the last mentioned date having been paid before the execution of these presents.

Subject always to the exception; reservations, covenant and conditions hereinafter contained, that is to say as follows;

I. The Lessor excepts and reserves unto himself all mines, minerals, coal, gold-washing, earth oils and quarries in or under the said land and full right and power at all times to do all acts and things which may be necessary or expedient for the purpose of searching for, working, obtaining removing and enjoying the same without providing or leaving any vertical support for the surface of the said land or for any building for the time being standing thereon provided always that the Lessor shall make reasonable compensation to the Lessee for all damage directly occasioned by the exercise of the rights hereby reserved or any of them.

II. The Lessee for himself, successor and assignees covenants with the Lessor in the manner following that is to say;

(1) The Lessee shall pay within such time such additional sum or sums towards premium as may be decided upon by the Lessor on account of the compensation awarded by the Land Acquisition Collector in respect of the said land or any part thereof being enhanced on reference or in appeal or both and the decision of the Lessor in this behalf shall be final and binding on the Lessee.

The yearly rent of T.W.D. 8. Half percent of the premium hereby reserved shall be calculated on the sum received towards premium by the Lessor before the execution of these presents and such additional sum or sums payable towards premium as provided herein from 9th day of January one thousand nine hundred and fifty five.

(2) The Lessee shall pay unto Lessor the yearly rent hereby reserved on the day and in the manner herein appointed.

(3) The Lessee shall not deviate in any manner from the Master Plan for Delhi and the Zonal Development Plans nor alter the size of the said land whether by sub-division amalgamation or otherwise.

(4) The Lessee shall within a period of two years from the 9th days of January one thousand nine hundred and fifty five (and the time so specified shall be of the essence of the contract) after obtaining sanction to the building plan, with necessary designs, plans and specifica-

(3)

land and complete in a substantial and workmanlike manner a building for ~~Hospital~~
.....with the requisite and proper walls, sewers and drain and other conveniences in accordance with the sanctioned building plan and to the satisfaction of such municipal or other authority.

(5) (a) The Lessee shall not sell, transfer, assign or otherwise part with possession of the whole or any part of the said land or any building thereon except with the previous consent in writing of the Lessor which he shall be entitled to refuse in his absolute discretion.

PROVIDED that such consent shall not be given for a period of ten years from the commencement of this lease unless, in the opinion of the Lessor, exceptional circumstances exist for the grant of such consent.

PROVIDED FURTHER that, in the event of the consent being given the Lessor may impose such terms and conditions as he thinks fit and the Lessor shall be entitled to claim and recover the whole or a portion (as the Lessor may in his absolute discretion determine) of the unearned increase in the value (i.e. the difference between the premium paid and the market value) of the said land at the time of sale, transfer, assignment, or parting with the possession and the decision of the Lessor in respect of the market value, shall be final and binding.

PROVIDED FURTHER that the Lessor shall have the pre-emptive right to purchase the property after deducting such percentage as decided by the Lessor of un-earned increase as aforesaid.

(b) Notwithstanding any thing contained in sub-clause (a) above, the Lessee may with the previous consent in writing of the Lt. Governor, of Delhi (hereinafter called "the Lt. Governor") mortgage or charge the said land to such person as may be approved by the Lt. Governor in his absolute discretion.

PROVIDED that, in the event of the sale or fore-closure of the mortgaged or charged property, the Lessor shall be entitled to claim and recover such percentage as decided by the Lessor of the unearned increase in the value, of the said land as aforesaid, and the amount of the Lessor's share of the said unearned increase shall be a first charge, having priority over the said mortgage or charge. The decision of the Lessor in respect of the market value of the said land shall be final and binding on all parties concerned.


PROVIDED FURTHER that the Lessor shall have the pre-emptive right to purchase the mortgaged or charged property after deducting such percentage as decided by the Lessor of the unearned increase as aforesaid.

(6) The Lessor's right to the recovery of the unearned increase and the pre-emptive right to purchase the property as mentioned hereinbefore shall apply equally to an involuntary sale or transfer whether it be by or through an executing or insolvency court.

(7) Whenever the title of the Lessee in the said land is transferred, in any manner whatsoever, the transferee shall be bound by all the covenants and conditions contained herein and be answerable in all respects therefore.

(8) Whenever the title of the Lessee in the said land is transferred in any manner whatsoever the transferor and the transferee shall, within three months of the transfer give notice of such transfer in writing to the Lessor.

The transferee or the person on whom the title devolves at the time of the transfer



supply the Lessor certified copies of the document(s) evidencing the transfer or devolution.

(9) The Lessee shall from time to time and at all times pay and discharge all rates, taxes, charges and assessments of every description which are now or may at any time hereafter during the continuance of this lease be assessed, charged imposed upon the said land hereby demised or on any building to be erected thereupon or on the landlord or tenant in respect thereof.

(10) All arrears of rent and other payments due in respect of the said land hereby demised or any of them shall be recoverable in the same manner as arrears of land revenue.

(11) The lessee shall in all respects comply with and be bound by the building, drainage and other bye-laws of the proper municipal or other authority for the time being in force.

(12) The lessee shall not without sanction or permission in writing of the proper municipal or other authority erect any building or make any alteration or addition to such building on the demised land.

(13) The Lessee shall not without the written consent of the Lessor carry on, or permit to be carried on, on the said land or in any building thereon any trade or business whatsoever or use the same or permit the same to be used for any purpose other than that of *Hospital*

..... or do, or suffer to be done therein any act, or thing whatsoever which in the opinion of the Lessor may be nuisance, annoyance or disturbance to the Lessor and persons living in neighbourhood.

PROVIDED that if the Lessee is desirous of using the said land or the building thereon for a purpose other than that of *Hospital*

..... the Lessor may allow such charge of user on such terms and conditions including payment of additional premium and additional yearly rent as the Lessor may in his absolute discretion determine.

(14) The Lessee shall at all reasonable times grant access to the said land to the Lt. Governor for being satisfied that the covenants and conditions herein contained have been and are being complied with.

(15) The Lessee shall on the determination of this Lease peaceably yield up the said land and the buildings thereon upon the Lessor.

III. If the sum or sums payable towards the premium or the yearly rent hereby reserved or any part thereof shall at any time be in arrear and unpaid for one calendar month next after any of the days whereon the same shall have become due, whether the same shall have been demanded or not, or if it is discovered that this Lease has been obtained by suppression of any action by any mis-statement, mis-representation or fraud or if there shall have been in the opinion of the Lessor, whose decision shall be final, any breach by the lessee by any person claiming through or under it, or of any of the covenants or conditions herein contained and on its part to be observed or performed, then and in any such case, it shall be lawful for the Lessor, notwithstanding the waiver of any previous cause or right of reentry upon the said land hereby demised and the buildings,

(5)

thereon to re-enter upon and take possession of the said land and the buildings and fixture thereon and thereupon, and everything herein contained shall cease and determine and the Lessor shall be entitled to any compensation what so ever, not to the return of any premium paid by it.

PROVIDED that notwithstanding any thing contained herein to the contrary, the Lessor may without prejudice to his right of re-entry as aforesaid, and in his absolute discretion, give notice of common breaches temporarily or otherwise, on receipt of such amount and on such terms and conditions as may be determined by him and may also accept the payment of a sum or sums of the rent which shall be in arrear as aforesaid together with interest at the rate of ten percent per annum or such other rate as the Lessor may in his absolute discretion prescribed from time to time.

IV. No. forfeiture or re-entry shall be effected until the Lessor has served on the Lessee a notice in writing.

(a) specifying the particular breach complained of, and

(b) if the breach is capable of remedy requiring the Lessee to remedy the breach, and the Lessee fails within such reasonable time as may be mentioned in the notice to remedy the breach if it is capable of remedy and in the event of forfeiture or re-entry the Lessor may in his discretion relieve against forfeiture on such terms and conditions as he thinks proper.

Nothing in this clause shall apply to forfeiture or re-entry


(a) for breach of covenants and conditions relating to sub-division or amalgamation, erection, completion, the alteration of the size of the said land and transfer of the said land as mentioned in Clause II, or

(b) in case this lease has been obtained by suppression of any fact, mis-statement, mis-representation or fraud.

V. The rent hereby reserved shall be enhanced from the first day of January ~~one thousand~~ and ~~one thousand~~ and ~~Twenty~~ ~~Five~~ and thereafter at the end of each successive period of thirty years provided that increase in the rent fixed at each enhancement shall not at each such time exceed one-half of the increase in the letting value of the site without bldgs., at the date on which the enhancement is due, and such letting value shall be assessed by the Collector or Additional Collector of Delhi as may be appointed by the Lessor.

PROVIDED ALWAYS that any such assessment of the letting value for the purpose of this provision shall be subject to the same right on the part of the Lessee of appeal from the orders of the said Collector or Additional Collector and within such time as if the same were an assessment by a Revenue Officer under the Punjab Land Revenue Act 1887 (Act XVII of 1887) or any amending Act, for the time being in force and the proceeding for or in relation to any such appeal shall be in all respects governed by the provisions of the said Act, in the same manner as if the same had been taken thereunder.

VI. In the event of any question, dispute or difference arising under these presents or in connection therewith (except as to any matter the decision of which is specially provided for by these presents) the same shall be referred to the sole arbitration of the Lieutenant Governor or any other person appointed by him. It will be observed that the arbitrator is a Government Servant, and that he has to deal with the matter in accordance with the law.

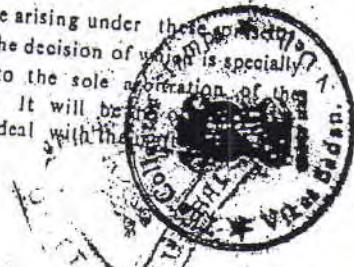

(6)

the Lease relates, or that in the course of his duties as a Government Servant he has expressed views on all or any of the matters in dispute or difference. The award of the arbitrator shall be final and binding on the parties.

The arbitrator may, with the consent of the parties, enlarge the time from time to time, for making and publishing the award.

Subject as aforesaid, the arbitration Act, 1940 and the Rules there under and any modifications thereof for the time being in force shall be deemed to apply to the arbitration proceedings under this Clause.

VII. All notices, orders, directions, consents, or approvals to be given under this Lease shall be in writing and shall be signed by such officers as may be authorised by the Lt. Governor and shall be considered as duly served upon the Lessee if the same shall have been delivered at or sent by post to the registered office of the Lessee or any person claiming any right to the said land if the same shall have been affixed to any building or erection whether temporary or otherwise upon the said land or shall have been delivered at or sent by post to the then residence, office or place of business or usual or last known residence, office or place of business of the Lessee or such person.

VIII. All powers exercisable by the Lessor under this lease may be exercised by the Lt. Governor. The Lessor may also authorise any other officer or officers to exercise all or any powers exercisable by him under this Lease.

(b) The Lt. Governor may authorise any officer or officers to exercise all or any of the powers which he is empowered to exercise under this Lease except the powers of the lessor exercisable by him by virtue of sub-clause(a) above.

IX. In this Lease the expression "The Lt. Governor" means the Lt. Governor of Delhi for the time being or in case his designation is changed or his office is abolished, the officer who for the time being is entrusted, whether or not in addition to other functions, with the functions similar to those of the Lt. Governor by whatever designation such officer may be called. The said expression shall further include such officer as may be designated by the Lessor to perform the functions of the Lt. Governor under the Lease.

X. The expression 'the Lessor' herein before used shall where the context so admits include his successors and assigns, and the expressions 'the Lessee' hereinbefore used shall mean the Mangal Sevaarth Trust.

XI. This lease is granted under the Government Grants Act, 1895. (Act. XV of 1895).

IN WITNESS WHEREOF Shri Amritlal Aman Puri

L. A. P. for and on behalf of and by the order and direction of the Lessor has hereunto set his hand and the common seal of the Lessee has hereunto been affixed the day and year above written.



(7)

Signed by Shri.mati Amritा Amrit Kaur
L.A.O.

for and on behalf of and by the order and
direction of the President of India (Lessor) in
the presence of.

(1) Shri SRI. BHAGWAN
RAJ.

The common seal of the...

(Lessee) is hereby affixed in the presence of
Shri...

(Name and designation) in pursuance of bye-law
No.

(Lessee)/Resolution No.

dt, the
of the managing Committee of the

(Lessee) and the said(a)

Shri....

(1) Shri Ashok Chopra
151-152 Pocket G-2 Sector 47
Rohini Delhi-85
(2) Shri V.K. SUBHAKHRI
R-8, New Presidnagar, N.D.L.

(THE SCHEDULE ABOVE REFERRED TO)

North

South

East

West

ELIMINATE THIS
PART OF THE FORM

SEAL

Open

For Manav Sevark Trust

Trusted



SEAL

Ashok Chopra

V.K. Subhakri



This document of Perpetual Lease of
Presented by Sh/Smt. Major S.A. Husi
S/o/W/o late. Lt. Col. N. Husi
R/o 206 Hanuman Tower
to the office of the Sub Registrar, 98 Nehru Place
New Delhi on this 18 day of January 2000
between the hours of 10-12 AM
New Delhi

Sub-Registrar-VII
New Delhi

18-1-2001

Execution admitted by the said
Sh/Smt. Major S.A. Husi
S/o/W/o Vendor (Mortg/Exe)
has been id ... d by Shri ...
S ... (Marginal Witness)
w ocess No ... is known to me. Contents of
document are known to the parties who
understand the consideration and admit
them as parties.

Sub-Registrar-VII
New Delhi

18-1-2001

Certified that the left or right
as the case may be hand thumb
impression of the executant has
been affixed in my presence.

Sub-Registrar-VII
New Delhi

18-1-2001

Having Satisfied myself that the document was
duly executed by Shri Amrit Singh in his
Official Capacity, his attendance
signature are appended with and document is
submitted to register

L.A.O.

D.O.A. New Delhi

Sub-Registrar-VII
New Delhi

18-1-2001

Registered No. 1200 in additional Book No. I
Vol. No. 1114 on Pages 92 to 96
on this 18 day of January 2000
and left thumb impression has been taken
in my presence.

Sub-Registrar-VII
New Delhi

18-1-2001

Annexure-XVII

Copy of electricity bills

Meter Details Annexure

Name	: Action Cancer Hospital	Sanctioned Load	: 344.00 (kVA)	CA No.	: 150112691
Billing Address	: FC-34 (Unit of Manav Sevarth Trust), Paschim Vihar DELHI 110063	Contract Demand	: 344.00 (kVA)	Energisation Date	: 25-04-2012
Supply Address	: FC-34 (Unit of Manav Sevarth Trust), Mobile / Tel. No. : 9891183701	M D I	: 348.00 (kVA)	Meter Type	: 3PSK
Email ID	: maintenance@actionhospital.com	Power Factor	: 0.992	Supply Type	: HT(11KV)
District / Division	: Punjabi Bagh	Pole No.	: PJBNAHT00S1	Bill No.	: 100010013625
Walking Sequence	: PJBKA1009A0AA	Meter Reading Status	: DL	Bill Basis	: Actual
Bill Month	: APR-24	Cycle No.	: KA		
Bill Date	: 29-04-2024	Tariff Category	: Large Industrial Power		

Net Meter Consumption Details (Date Of Reading:)

Total Solar Generation Units	For the Billing Period			Cumulative Generation in FY			Solar Installation Details			Date of Installation		Capacity kWp			
I/F Units (If any)	Export Reading			Import Reading			Net Difference			Moderated Units			Excess Gen Unit	Shared by Prim	C/F Uni (If any)
	Normal	Peak	Offpeak	Normal	Peak	Offpeak	Normal	Peak	Offpeak	Normal	Peak	Offpeak			

(Consumption in the above table are in kWh/kVah, as applicable)

Meter No	Units	Billed Consumption (Current)		Billed Consumption (Previous)		Multiplication Factor	Current Consumption	
		Date of Meter Reading(24:00Hrs)	Reading	Date of Meter Reading	Reading		Days	Units
29902016	KWH	27-04-2024	28361.25	27-03-2024	28068.55	600.00	31	175620.00
29902016	KW	27-04-2024	0.57			600.00		342.00
29902016	KVAH	27-04-2024	28625.72	27-03-2024	28330.54	600.00	31	177108.00
29902016	KVA	27-04-2024	0.58			600.00		348.00
29902016	KVAHP	27-04-2024	7969.03	27-03-2024	7892.84	600.00	31	45714.00
29902016	KVAHO	27-04-2024	6215.05	27-03-2024	6146.42	600.00	31	41178.00

EBILL Customer

29 MAY 2024

Bill of Supply for Electricity

Due Date (देय तिथि):

12-06-2024

Name: Action Cancer Hospital

Billing Address: FC-34 (Unit of Manav Sevarth Trust), Paschim Vihar DELHI 110063

Supply Address: FC-34 (Unit of Manav Sevarth Trust).

Mobile / Tel. No.: 9891183701

Email ID: maintenance@actionhospital.com

District / Division: Punjabi Bagh

Walking Sequence: PJBKA1009A0AA

Bill Month: MAY-24

Bill Date: 28-05-2024

Sanctioned Load: 344.00 (kVA)
Contract Demand: 344.00 (kVA)
MDI: 372.00 (kVA)
Power Factor: 0.990
Pole No.: PJBNHT00S1
Meter Reading Status: DL
Cycle No.: KA
Tariff Category: Large Industrial Power

CA No.: 150112691
Energisation Date: 25-04-2012
Meter Type: 3PSK
Supply Type: HT(11KV)
Bill No.: 100039474092
Bill Basis: Actual
O.D. No.: R/24/10425372984
CCTV Tagged: No
Street Light Tagged: No
Wi-Fi Tagged: No

Customer Care Centre No. (ग्राहक सेवा केंद्र का नंबर) 19123 (24x7 Toll Free)

Meter No. (मीटर सं.)	Unit (यूनिट)	Billed Consumption (Current)		Billed Consumption (Previous)		Multiplication Factor (गुणांक)	Current Consumption (वर्तमान खरा)	
		Date of Meter Reading (मीटर रीडिंग की तिथि)	Reading (रीडिंग)	Date of Meter Reading (मीटर रीडिंग की तिथि)	Reading (रीडिंग)		Days (दिन)	Unit (यूनिट)
		Meter	Details in Annexure					

Billing Details (बिल का विवरण)

Current Period Charges (वर्तमान अवधि का शुल्क) (28-04-2024 to 26-05-2024)

Adopt e-bill, Save trees. Provide email details to us through website/call/email.

Fixed Charge = "A" ₹	Consumption Measured During	Energy Units Consumed / Billed (खपत / बिल में लिये गए यूनिट)	Slabwise Energy Charge (स्लेब अपारिश विद्युत शुल्क)	Slab-wise Power Purchase Adjustment Charge (स्लेब अपारिश विद्युत शुल्क)	Time of Day (TOD) Charge टॉम ऑफ डे (टोटोडी) शुल्क	Surcharge @ 8% on (Energy Charge + Fixed Charge - Rebate) = "E" ₹	Electricity Tax @ 2% on Energy Charge, Surcharge on Energy Charge, PPAC amount & TOD Surcharge Rebate amount = "F" ₹	Total Amount (K = A+B+C+D+E+F+G+H+I+J) ₹ (कुल राशि)
87300.00 0.94 Mth(s)	OFFPEAK(S)	4080.00	7.75	31620.00	35.83 11329.45		110161.03	92749.70
	PEAK(S)	4501.00	7.75	34882.75	35.83 12498.49		95390.90	
PPAC on Fixed Charge = "G" ₹	NORMAL(S)	87876.00	7.75	681039.00	35.83 244016.28		TCS Amount = "I" ₹	
	OFFPEAK(S)	35364.00	7.75	274071.00	35.83 78559.71 (20.00)	(54814.20)	Base Amt. Surcharge	60467.05
31279.59	PEAK(S)	39011.00	7.75	302335.25	35.83 129992.06 (20.00)		Other Charges "J" ₹	
CCTV Units 0.00							1971.29	
Street Light Units							CCTV Bill Amount	
Wi-Fi Units								0.00
Total Units = 170832		Total (B) = 1323948.00		Total (C) = 476395.98	Total (D) = 5652.85			



Past Dues / Refunds / Subsidy (पिछला बकाया / वापसी / सब्सिडी) Consumer registered under GST may submit its GSTIN at concerned division

Provisional Bill Refunds/वापसी		Arrears (बकाया)		Late Payment Surcharge (LPSC)		Total Charges Payable (कुल देय शुल्क)	Rebate / Subsidy (वापसी / सब्सिडी)	Net Amount Payable (कुल देय राशि)
Refund Unit	Refund Amount (राशि)	Period to which it relates (जिस अवधि से संबद्ध है)						
0	(1207.75)					2224641.59	(54179.91)	2170461.68

Amount not immediately payable, if any. (राशि जो तुरंत देय नहीं है, यारि तो तो)

BG Security Deposit ₹

BG Expiry Date

Service line cum Development Charges paid (पुगता किया गया सर्विसलाइन एवं डेवलपमेंट शुल्क) ₹ 0.00

Cash Security Deposit ₹ 648000.00

Interest accrued for FY 2023-24, already adjusted in bill No.

₹ (48941.61)

100010013625 (generated for the period 28-03-2024 to 27-04-2024)

Interest for FY 2024-25 will be adjusted in your first bill to be generated in FY 2025-26

Bill Amount Payable (बिल देय राशि)

₹ 2170460.00

Due Date of Payment (मुग्यतान देय तिथि) 12-06-2024

If payment is made after the due date, LPSC for the delay, shall be charged in the next bill. (नियत तिथि के बाद मुग्यतान करने पर इस विलंब द्वारा अगले बिल में लेप्लाइसेंसी जोड़ दिया जाएगा।)

Last payment ₹ 2194912.00 received on 09-05-2024. Payment accounted upto 25-05-2024. The connection shall be liable for disconnection on non-payment of all dues (including arrears of previous bill(s) by due date, after notice as per Section 56(1) of the Electricity Act, 2003. Charges for reconnection - Single phase ₹ 200, Three phase ₹ 500. "LET'S MOVE TO ELECTRIC VEHICLES FOR BETTER TOMORROW (JED अवधि के लिए विद्युत वाहन की परफ करेंगे करेंगे")

IMPORTANT MESSAGE (गहत्वपूर्ण सूचना)

*Other charges includes -Load violation Surcharge:1971.29 Power Purchase Adjustment Charge (PPAC) @ 35.83% been levied on energy & fixed charge w.e.f 01.05.2024. CCTV Bill amount include Energy, RA, PPAC, PTC and Electricity Tax on CCTV consumption. In case any variation in SLD charges noted, consumer may visit divisional office for requisite correction. Pension Surcharge @ 7.00% has been levied on energy & fixed charge w.e.f. 01.10.2021. The amount of Security Deposit against your connection is mentioned herewith under the heading "Security Deposit with DISCOM". Please check this amount and report any discrepancy by furnishing documentary proof in that regard available with you, at the customer care centre of respective division office. Anyone treating Electricity Bill as conclusive proof of Residence is advised to verify the particulars. Switch off lights and appliances from mains when not in use. This will conserve energy and reduce your electricity bill.ELCB is a safeguard against

(This bill is computer generated, hence does not require any signature.)



Meter Details Annexure

Name	: Action Cancer Hospital	Sanctioned Load	: 344.00 (kVA)	CA No.	: 150112691
Billing Address	: FC-34 (Unit of Manav Sevarth Trust). Paschim Vihar. DELHI 110063	Contract Demand	: 344.00 (kVA)	Energisation Date	: 25-04-2012
Supply Address	: FC-34 (Unit of Manav Sevarth Trust). Mobile / Tel. No. : 9891183701	M D I	: 372.00 (kVA)	Meter Type	: 3PSK
Email ID	: maintenance@actionhospital.com	Power Factor	: 0.990	Supply Type	: HT(11KV)
District / Division	: Punjabi Bagh	Pole No.	: PJBKA1009A0AA	Bill No.	: 100039474092
Walking Sequence		Meter Reading Status	: DL	Bill Basis	: Actual
Bill Month	: MAY-24	Cycle No.	: KA		
Bill Date	: 28-05-2024	Tariff Category	: Large Industrial Power		

Net Meter Consumption Details (Date Of Reading:)

Total Solar Generation Units	For the Billing Period			Cumulative Generation in FY			Solar Installation Details			Date of Installation		Capacity kWp			
i/F Units (If any)	Export Reading			Import Reading			Net Difference			Moderated Units			Excess Gen Unit	Shared by Prim	C/F Unit (If any)
	Normal	Peak	Offpeak	Normal	Peak	Offpeak	Normal	Peak	Offpeak	Normal	Peak	Offpeak			

(Consumption in the above table are in kWh/kVah, as applicable)

Meter No	Units	Billed Consumption (Current)			Billed Consumption (Previous)			Multiplication Factor	Current Consumption	
		Date of Meter Reading(24:00Hrs)	Reading		Date of Meter Reading		Reading		Days	Units
29902016	KWH	26-05-2024	28643.23		27-04-2024		28361.25	600.00	29	16918.00
29902016	KW	26-05-2024	0.61					600.00		366.00
29902016	KVAH	26-05-2024	28910.44		27-04-2024		28625.72	600.00	29	170832.00
29902016	KVA	26-05-2024	0.62					600.00		372.00
29902016	KVAHP	26-05-2024	8041.55		27-04-2024		7969.03	600.00	29	43512.00
29902016	KVAHO	26-05-2024	6280.79		27-04-2024		6215.05	600.00	29	39444.00

Ref No. BRPL/2023-24/MDI/LE-SD/CA No. 150112691

Dated: 28-05-2024

Name : Action Cancer Hospital
Address : FC-34 (Unit of Manav Sevarth Trust) .
Paschim Vihar DELHI 110063
Division : Punjabi Bagh
CA No : 150112691

Subject: Revision of Sanctioned Load / Security Deposit as per DERC (Supply Code and Performance Standards) Regulations 2017, Clause 17 (4)

Dear Sir/Madam,

As per above regulations, sanctioned load for the above CA is required to be revised on the basis of highest of average of Maximum Demand* readings recorded as per billing cycle covering any four consecutive calendar months in the preceding financial year i.e. from 01.04.2023 to 31.03.2024. The security amount and all other charges also need to be revised correspondingly.

Maximum demand recorded during the four consecutive months in FY 2023-24, is given below:

S. No.	Maximum Demand (kW/kVA)	Billing period
1	336.00	28-APR-2023 To 27-MAY-2023
2	342.00	28-MAY-2023 To 27-JUN-2023
3	330.00	28-JUN-2023 To 27-JUL-2023
4	342.00	28-JUL-2023 To 27-AUG-2023

Average of maximum demand readings recorded as per billing cycle covering above four consecutive calendar months rounded off to the lower integer comes to 337 /347 kW/kVA, whereas your existing sanctioned load/ contract demand is 334 /344 kW/kVA. Thus, your sanctioned load/ contract demand is required to be increased to 337 /347 kW/kVA.

Based on the load revision, an additional security deposit of Rs 13500.00 is to be paid by you. This amount will be debited to your July month electricity bill under head - Other charges.

Your sanctioned load / contract demand has been revised as per DERC Regulation and the agreement signed between you and BRPL also to be considered as revised accordingly. In case of any disagreement please revert within 30 days otherwise load and agreement will be considered as accepted by you.

You would appreciate that health and safety of your installation are essential for not only maintaining reliable supply to your premises, but also for all other installations in your vicinity as well to ensure safety for you, your family and society at large (including BRPL Employees). Therefore, it is requested to kindly take immediate steps to ensure the compliance of above-mentioned applicable laws/regulation pursuant to the said revision in sanctioned load in regard to the following:

Test report mentioning load details including details of RCCB & MCB duly signed by consumer and electrical contractor.

Kindly submit the above document within 15 days from the receipt of this letter via email on brpl.customercare@relianceada.com or visit division office of your area. The sanctioned load will be increased accordingly.

In case of non-compliance/failure in submission of above documents within the above specified timelines, BRPL may take appropriate actions as per the applicable laws/regulations.

Further, you are also requested to retain the copy of such document with yourself for any future reference/requirement by any external agencies/authorities or otherwise.

For any further clarification please contact our Customer Care Teams at Division Office or our Toll-free Call Center at 19123.

Thanking you,

Yours faithfully,

MR NISHANT SRIVASTAVA
Division Head (B)
Tel No. : 49209489

* Maximum demand means the highest load measured in kVA or kW at the point of supply of a consumer during a consecutive period of 30 minutes during the month.

Ref No. BRPL/2023-24/MDI/LE-SD/CA No. 150112691

तारीख : 28-05-2024

नाम : Action Cancer Hospital
पता : FC-34 (Unit of Manav Sevarth Trust) .
Paschim Vihar DELHI 110063
डिविजन : Punjabi Bagh
CA No : 150112691

विषय: डीईआरसी (आपूर्ति सहिता और प्रदर्शन मानक) विनियमन 2017, उपर्युक्त 17 (4)

प्रिय गहोदय/गहोदया,

उपरोक्त विनियमन के अनुसार, उपरोक्त CA के संबंध में रवीकृत लोड को पिछले वित्त वर्ष में आर्थित 01.04.2023 से 31.03.2024 के दौरान लगातार चार कैलेंडर माह में विलिंग वक के अनुसार दर्ज अधिकतम मांग* रीडिंग के सर्वाव्य औसत के अनुसार संशोधित किया जाएगा। सुरक्षा राशि और अन्य प्रगारों को भी तदनुसार संशोधित करने की आवश्यकता है।

वित्त वर्ष 2023-24 में लगातार चार महीनों के दौरान दर्ज की गई अधिकतम मांग का व्यौदा इस प्रकार है:

क्रम संख्या	अधिकतम मांग (kW/kVA)	विलिंग अवधि
1	336.00	28-APR-2023 To 27-MAY-2023
2	342.00	28-MAY-2023 To 27-JUN-2023
3	330.00	28-JUN-2023 To 27-JUL-2023
4	342.00	28-JUL-2023 To 27-AUG-2023

लगातार चार कैलेंडर महीनों के उपर्युक्त विलिंग साइकल के अनुसार दर्ज की गई अधिकतम मांग रीडिंग का औसत निचले अंक तक पूर्णांकित करने पर 337/347 kW/kVA आता है, जबकि आपका मैंजूदा रवीकृत लोड/अनुबंध मांग 334/344 kW/kVA है। इसलिए आपके स्वीकृत लोड/अनुबंध मांग को 337/347 kW/kVA तक बढ़ाने की आवश्यकता है।

लोड संशोधन के आधार पर आपको अतिरिक्त 13500.00 रुपये सिक्योरिटी डिपॉजिट का भुगतान करना होगा। यह राशि आपके जुलाई महीने के विजली विल में अन्य शुल्क नद के बाहर डेबिट की जाएगी।

आपकी रवीकृत लोड/अनुबंध मांग को डीईआरसी विनियमन के अनुसार संशोधित किया गया है और आपके तथा **BRPL** के बीच हस्ताक्षरित समझौते को भी तदनुसार संशोधित माना जाएगा। किसी भी असहमति के मामले में कृपया 30 दिनों के भीतर अपना जवाब दें अन्यथा लोड और रामज़ाते को आपके द्वारा रवीकृत माना जाएगा।

आप इसकी सहाना करेंगे कि आपके इनरटॉलेशन की सेटिंग और सुरक्षा न केवल आपके परिसर में भरोसेमंद आपूर्ति बनाए रखने के लिए आवश्यक है, बहिं आपके आसपास के अन्य रासी इन्स्टीलेशन के साथ-साथ आपके आपके परिवार और व्यापक तीर पर समाज (दीआरपीएल कर्मवारियों सहित) की सुरक्षा सुनिश्चित करने के लिए भी आवश्यक है। इसलिए, अनुरोध है कि निम्नलिखित के संबंध में रवीकृत लोड में उक्त संशोधन के अनुसार उपर्युक्त लागू कानूनों/विनियमों का अनुपालन सुनिश्चित करने के लिए तत्काल कदम उठाएं।

उपरोक्ता और विचुत डेकेदार द्वारा विधिवत हस्ताक्षरित आरसीसीबी और एमरीबी के विवरण सहित लोड विवरण का उल्लेख करने वाली परीक्षण रिपोर्ट।

कृपया उपरोक्त दरतायेज इस पत्र के प्राप्त होने के 15 दिनों के भीतर brpl.customer-care@relianceada.com पर ईमेल के माध्यम से जमा करें या अपने दोस्त के डिविजन कार्यालय में विजिट करें। स्वीकृत लोड तदनुसार बढ़ाया जाएगा।

उपरोक्त निर्दिष्ट समयसीमा के भीतर उपर्युक्त दरतायेजों को प्रत्युत करने में गैर-अनुपालन/विफलता के मामले में, दीआरपीएल लागू कानूनों/विनियमों के अनुसार उचित कार्रवाई कर सकती है।

इसके साथ ही आपसे यह भी अनुरोध किया जाता है कि किसी बाहरी एजेंसियों/प्राधिकरणों या अन्य द्वारा गविष्य में किसी संर्व/आवश्यकता के लिए ऐसे दरतायेज की प्रति अपने पास रखें।

किसी भी अन्य स्पष्टीकरण के लिए कृपया डिविजन कार्यालय में हमारी ग्राहक सेवा टीम या हमारे टोल-फ्री कॉल सेंटर 19123 पर रांपकर करें।

धन्यवाद,

आपका विश्वासी

MR. NISHANT SRIVASTAVA
Division Head (B)
Tel No.: 49209489

* अधिकतम मांग का मतलब महीने के दौरान 30 मिनट की लगातार अवधि में उपरोक्ता के रालाई पॉइंट पर kVA या kW में मापा गया उच्चतम लोड है।

Meter Details Annexure

Name	: Action Cancer Hospital	Sanctioned Load	: 344.00 (kVA)	CA No.	: 150112691
Billing Address	: FC-34 (Unit of Manav Sevarth Trust). Paschim Vihar DELHI 110063	Contract Demand	: 344.00 (kVA)	Energisation Date	: 25-04-2012
Supply Address	: FC-34 (Unit of Manav Sevarth Trust). Mobile / Tel. No. : 9891183701	M D I	: 372.00 (kVA)	Meter Type	: 3PSK
Email ID	: maintenance@actionhospital.com	Power Factor	: 0.993	Supply Type	: HT(11KV)
District / Division	: Punjabi Bagh	Pole No.	: PJBNAH00S1	Bill No.	: 100188945667
Walking Sequence	: PJBKA1009A0AA	Meter Reading Status	: DL	Bill Basis	: Actual
Bill Month	: JUN-24	Cycle No.	: KA		
Bill Date	: 27-06-2024	Tariff Category	: Large Industrial Power		

Net Meter Consumption Details (Date Of Reading:)

Total Solar Generation Units	For the Billing Period			Cumulative Generation in FY			Solar Installation Details			Date of Installation			Capacity kWp		
W/F Units (If any)	Export Reading			Import Reading			Net Difference			Moderated Units			Excess Gen Unit	Shared by Prim	C/F Unit (If any)
	Normal	Peak	Offpeak	Normal	Peak	Offpeak	Normal	Peak	Offpeak	Normal	Peak	Offpeak			

(Consumption in the above table are in kWh/kVah, as applicable)

Meter No	Units	Billed Consumption (Current)		Billed Consumption (Previous)		Multiplication Factor	Current Consumption	
		Date of Meter Reading(24:00Hrs)	Reading	Date of Meter Reading	Reading		Days	Units
29902016	KWH	27-06-2024	28975.30	26-05-2024	28643.23	600.00	32	199242.00
29902016	KW	27-06-2024	0.62			600.00		372.00
29902016	KVAH	27-06-2024	29244.69	26-05-2024	28910.44	600.00	32	200550.00
29902016	KVA	27-06-2024	0.62			600.00		372.00
29902016	KVAHP	27-06-2024	8127.19	26-05-2024	8041.55	600.00	32	51384.00
29902016	KVAHO	27-06-2024	6358.07	26-05-2024	6280.79	600.00	32	46368.00

The revised tariff schedule is effective from 1st October 2021

Categories	Description	Fixed/Demand Charge		Energy Charge					Categories	Description	Fixed/Demand Charge	Energy Charge	Temporary					
		Load(kW)	(₹/month)	0-200 Units	201-400 Units	401-800 Units	801-1200 Units	Above 1200 Units					Categories	Fixed Charge	Energy Charge			
Domestic	Individual connections: Domestic Light / Mixed Domestic Power, Farm House upto 21kW	Upto 2kW >2kW to 5kW >5kW to 15kW >15kW to 25kW >25kW	20/kW/mth 50/kW/mth 100/kW/mth 200/kW/mth 250/kW/mth	₹ 3.00	₹ 4.50	₹ 6.50	₹ 7.00	₹ 8.00	Agriculture	Agriculture	125/kW/mth	₹ 1.50/kWh	Domestic including GHS	Same as relevant category	Same as relevant category			
	Single point supply at 11kV for GHS - Domestic Lighting / Fan and Power	150/kW/mth								Mushroom	Mushroom Cultivation upto 100 kW	200/kW/mth	₹ 3.50/kWh					
Non-Domestic	Shopkeepers	Upto 3kVA >3kVA	250 kVA/mth						Public Utility	Delhi Jal Board, DMRC, Public Lighting etc.	250/kVA/mth	₹ 6.25/kVAh	Delhi International Airport Limited (DIAL)	250/kVA/mth	₹ 7.75/kVAh	Threshers during the threshing season	MCD E.Tax of ₹ 270 / conn/mth	Flat Rate - ₹ 5400/mth
	Other Non-Domestic									Advertisements and Hoardings	250/kVA/mth	₹ 8.50/kVAh			LT		₹ 4.50/kWh	All other including construction
Industrial	Industrial								Charging Stations for E-Rickshaw/ E-Vehicle on Single Point Delivery				HT	₹ 4.00/kVAh	1.30 times of relevant category of tariff			

Schedule of Time of Day (TOD) Tariff

Month	Peak hours	Surcharge on Energy Charges	Off-Peak hours	Rebate on Energy Charges
May-Sept/October	1400-1700 hrs and 2200-0100 hrs	20% (*waived for Sep 2020)	0400-1000 hrs	20%

For other than peak & off-peak hours normal energy charges are applicable. Mandatory for >10kV / 11kVA other than Domestic. Optional for 3 Phase Domestic Consumers.

Consumption History (खपत का विवरण) :

Period	From	To	No. of Days	Units (kwh/kvah)	Total Bill Payable	Bill Basis
27-05-2024	27-06-2024	32	200550	2546610.00	Actual	
28-04-2024	26-05-2024	29	170832	2170460.00	Actual	
28-03-2024	27-04-2024	31	177108	2195530.00	Actual	
28-02-2024	27-03-2024	29	143682	330470.00	Actual	
28-01-2024	27-02-2024	31	147828	1886820.00	Actual	
28-12-2023	27-01-2024	31	143424	1732480.00	Actual	

Paying your electricity bill (Bill payment information)

Payment Options

1. You can pay your bill by cash / cheque/DD/Pay Order up to Rs 4000/- and for amount more than Rs 4000/- by cheque/DD/Pay Order.
2. According to DERC's recent tariff order, it is mandatory for all consumers (except Domestic, Agriculture & Mushroom Cultivation) to pay their monthly electricity bills exceeding Rs 20,000/- through digital mode as on 1 October, 2021.
3. Drop your cheque in our drop boxes at various RWAs/offices and at BRPL Counters. The list of drop boxes is available on the website.
4. Bill payment counters are open from 0900 hrs to 1500 hrs, from Monday to Saturday.
5. Bill payment upto Rs 50,000/- can be paid in cash at Bank branches of PNB and Bank of Baroda.

Points to remember while paying your bill

1. Please pay your electricity bill only on obtaining computer generated bill.
2. Do not make payment to unauthorized agencies / tools.
3. In case your cheque is returned unpaid or dishonored by bank, cheque return charges (presently Rs. 200 + GST, as applicable) will be imposed and action will be taken under Section 138 of the Negotiable Instruments Act 1881.
4. Convenience fee on card swipe and online payments applicable on payment amount above Rs 5000/- is to be borne by the consumer. For charge details, kindly visit our website www.bsedesdelhi.com.

Customer Complaint Management:

For any query / complaint, you may contact us using any of the following options:

- Call Center No. 19123 (24x7 Toll Free)
- Customer Care Centers (Timing Mon to Fri : 9:30 AM to 5:30 PM & Sat: 9:30 AM to 1:00 PM)
- Email - brpl.customercare@relianceada.com
- www.bsedesdelhi.com

Escalation matrix for complaints:

1. In case you are not satisfied with the resolution of your query / complaint, you may contact the below listed BRPL officials-
 - Customer Care Officer (Timing 09:15 AM to 3:15 PM)
 - Business Manager (between 10AM to 11AM on any working day)
 - Circle Head (with prior appointment)
2. Head-Customer Care,
BSES Rajdhani Power Limited,
BSES Bhawan, Nehru Place, New Delhi-110019
Email - brplhead.customercare@relianceada.com
3. Consumer Grievance Redressal Forum (CGRF): In case you are not satisfied with the response of the above, you may approach CGRF-BRPL, Sub-station Building, Sector-V, Pushp Vihar, New Delhi-110017.
Email: cgrfbrpl@gmail.com
4. Electricity Ombudsman: An appeal against the CGRF order may be filed with Electricity Ombudsman, B-53, Paschimi Marg, Vasant Vihar, New Delhi-110057.

Pay your electricity bills conveniently by any of the following options:

Payment Options			Timings	
Digital Online Payments	<ul style="list-style-type: none"> • Bhami BillPay(BBPS) - Pay option of all BBPS enabled Payments App (Paytm etc.) (Zero Charges) • QR code on Bill - Powered by BOB • BSES Mobile App/Website - UPI, IMPS, Internet Banking, Credit / Debit Cards, Mobile Wallets, QR Code • RTGS / NEFT / ECS 		24x7	
Cash Counters	<p>BRPL Cash Counters:</p> <ul style="list-style-type: none"> • Cash - Upto Rs. 4000/- • Cheque & Demand Draft- No amount limit for Domestic, Agriculture & Mushroom Cultivation category consumers and for other category consumers maximum allowed is upto Rs. 20,000/-. • Credit / Debit Cards • UPI 		9AM - 3PM	
24*7 self payment Kiosk	24*7 self payment Kiosks by cards, each division office		24x7	
Bank Branches	<p>Bank of Baroda and PNB</p> <ul style="list-style-type: none"> • Cash - Upto Rs. 50,000/- only for Domestic, Agriculture & Mushroom Cultivation category consumers and for other category consumers maximum permissible limit is upto Rs. 20,000/-. • Cheque & Demand Draft- No amount limit for Domestic, Agriculture & Mushroom Cultivation category consumers and for other category consumers maximum allowed is upto Rs. 20,000/-. • Transfer by account holders 	Bank Timings		
Cheque Drop boxes	<p>Select RWA locations</p> <p>BRPL owned drop boxes at counters</p>	<p>Cheque & Demand Draft- No amount limit for Domestic, Agriculture & Mushroom Cultivation category consumers and for other category consumers maximum allowed is upto Rs. 20,000/-.</p> <p>BRPL owned drop boxes at counters</p>	24x7	9AM - 5PM
Cheque by Post	To BRPL division offices- Cheque & Demand Draft- No amount limit for Domestic, Agriculture & Mushroom Cultivation category consumers and for other category consumers maximum allowed is upto Rs. 20,000/-.		24x7	

Disclaimer: This electricity bill is only for electricity supply to the premises occupied by the consumer and should not be construed as having bearing on the rights or liabilities over the premises.

आवासीकरण: यह बिजली का बिल उपभोक्ता के निवास/ कार्यालय पर विजली को आपूर्ति के लिए है, और इसे उस खाने पर उपभोक्ता के अधिकारों या स्वामित्व समान न संदर्भ नहीं।

"GoNCTD vide Order No. F.6/85/Power/2024/447-459 dated 14.03.2024 has extended subsidy to Domestic Consumers for Financial Year 2024-2025 of entire bill amount upto 200 Units/month, Slab 201-400 Units/month will get subsidy upto 14.03.2024 in the amount of ₹ 800/month. No subsidy consumption above 400 Units/month"

दिल्ली सरकार को आदेश संखा F.6/85/Power/2024/447-459 dated 14.03.2024 के अनुसार धर्मशुल्क उपभोक्ताओं के लिए सभी विदेशी वर्ष 2024-25 तक बढ़ा दी है, 200 यूनिट/मास तक के सर्वान्वयन राशि, 200-400 यूनिट/मास पर 800 रुपये संख्या 400 यूनिट प्रति माह से ऊपर खपत के लिए कोई संधारणा नहीं।

विजली के अवधि विवर के लिए/ वार्षिक रूप से विवर के लिए ताप्ति करें।

• विजली की अवधि - 14.03.2024 (विवर वार्षिक रूप से विवर के लिए ताप्ति करें)।

• विजली की अवधि - 14.03.2024 (विवर वार्षिक रूप से विवर के लिए ताप्ति करें)।

• विजली की अवधि - 14.03.2024 (विवर वार्षिक रूप से विवर के लिए ताप्ति करें)।

• विजली की अवधि - 14.03.2024 (विवर वार्षिक रूप से विवर के लिए ताप्ति करें)।

• विजली की अवधि - 14.03.2024 (विवर वार्षिक रूप से विवर के लिए ताप्ति करें)।

• विजली की अवधि - 14.03.2024 (विवर वार्षिक रूप से विवर के लिए ताप्ति करें)।

• विजली की अवधि - 14.03.2024 (विवर वार्षिक रूप से विवर के लिए ताप्ति करें)।

• विजली की अवधि - 14.03.2024 (विवर वार्षिक रूप से विवर के लिए ताप्ति करें)।

• विजली की अवधि - 14.03.2024 (विवर वार्षिक रूप से विवर के लिए ताप्ति करें)।

• विजली की अवधि - 14.03.2024 (विवर वार्षिक रूप से विवर के लिए ताप्ति करें)।

• विजली की अवधि - 14.03.2024 (विवर वार्षिक रूप से विवर के लिए ताप्ति करें)।

• विजली की अवधि - 14.03.2024 (विवर वार्षिक रूप से विवर के लिए ताप्ति करें)।

• विजली की अवधि - 14.03.2024 (विवर वार्षिक रूप से विवर के लिए ताप्ति करें)।

• विजली की अवधि - 14.03.2024 (विवर वार्षिक रूप से विवर के लिए ताप्ति करें)।

• विजली की अवधि - 14.03.2024 (विवर वार्षिक रूप से विवर के लिए ताप्ति करें)।

• विजली की अवधि - 14.03.2024 (विवर वार्षिक रूप से विवर के लिए ताप्ति करें)।

• विजली की अवधि - 14.03.2024 (विवर वार्षिक रूप से विवर के लिए ताप्ति करें)।

• विजली की अवधि - 14.03.2024 (विवर वार्षिक रूप से विवर के लिए ताप्ति करें)।

• विजली की अवधि - 14.03.2024 (विवर वार्षिक रूप से विवर के लिए ताप्ति करें)।

• विजली की अवधि - 14.03.2024 (विवर वार्षिक रूप से विवर के लिए ताप्ति करें)।

• विजली की अवधि - 14.03.2024 (विवर वार्षिक रूप से विवर के लिए ताप्ति करें)।

• विजली की अवधि - 14.03.2024 (विवर वार्षिक रूप से विवर के लिए ताप्ति करें)।

• विजली की अवधि - 14.03.2024 (विवर वार्षिक रूप से विवर के लिए ताप्ति करें)।

• विजली की अवधि - 14.03.2024 (विवर वार्षिक रूप से विवर के लिए ताप्ति करें)।

• विजली की अवधि - 14.03.2024 (विवर वार्षिक रूप से विवर के लिए ताप्ति करें)।

• विजली की अवधि - 14.03.2024 (विवर वार्षिक रूप से विवर के लिए ताप्ति करें)।

• विजली की अवधि - 14.03.2024 (विवर वार्षिक रूप से विवर के लिए ताप्ति करें)।

• विजली की अवधि - 14.03.2024 (विवर वार्षिक रूप से विवर के लिए ताप्ति करें)।

• विजली की अवधि - 14.03.2024 (विवर वार्षिक रूप से विवर के लिए ताप्ति करें)।

• विजली की अवधि - 14.03.2024 (विवर वार्षिक रूप से विवर के लिए ताप्ति करें)।

• विजली की अवधि - 14.03.2024 (विवर वार्षिक रूप से विवर के लिए ताप्ति करें)।

• विजली की अवधि - 14.03.2024 (विवर वार्षिक रूप से विवर के लिए ताप्ति करें)।

• विजली की अवधि - 14.03.2024 (विवर वार्षिक रूप से विवर के लिए ताप्ति करें)।

• विजली की अवधि - 14.03.2024 (विवर वार्षिक रूप से विवर के लिए ताप्ति करें)।

• विजली की अवधि - 14.03.2024 (विवर वार्षिक रूप से विवर के लिए ताप्ति करें)।

• विजली की अवधि - 14.03.2024 (विवर वार्षिक रूप से विवर के लिए ताप्ति करें)।

• विजली की अवधि - 14.03.2024 (विवर वार्षिक रूप से विवर के लिए ताप्ति करें)।

• विजली की अवधि - 14.03.2024 (विवर वार्षिक रूप से विवर के लिए ताप्ति करें)।

• विजली की अवधि - 14.03.2024 (विवर वार्षिक रूप से विवर के लिए ताप्ति करें)।

• विजली की अवधि - 14.03.2024 (विवर वार्षिक रूप से विवर के लिए ताप्ति करें)।

• विजली की अवधि - 14.03.2024 (विवर वार्षिक रूप से विवर के लिए ताप्ति करें)।

• विजली की अवधि - 14.03.2024 (विवर वार्षिक रूप से विवर के लिए ताप्ति करें)।

• विजली की अवधि - 14.03.2024 (विवर वार्षिक रूप से विवर के लिए ताप्ति करें)।

• विजली की अवधि - 14.03.2024 (विवर वार्षिक रूप से विवर के लिए ताप्ति करें)।

• विजली की अवधि - 14.03.2024 (विवर वार्षिक रूप से विवर के लिए ताप्ति करें)।

• विजली की अवधि - 14.03.2024 (विवर वार्षिक रूप से विवर के लिए ताप्ति करें)।

• विजली की अवधि - 14.03.2024 (विवर वार्षिक रूप से विवर के लिए ताप्ति करें)।

• विजली की अवधि - 14.03.2024 (विवर वार्षिक रूप से विवर के लिए ताप्ति करें)।

• विजली की अवधि - 14.03.2024 (विवर वार्षिक रूप से विवर के लिए त

Meter Details Annexure

Name	: Action Cancer Hospital	Sanctioned Load	: 344.00 (kVA)	CA No.	: 150112691
Billing Address	: FC-34 (Unit of Manav Sevarth Trust), Paschim Vihar DELHI 110063	Contract Demand	: 344.00 (kVA)	Energisation Date	: 25-04-2012
Supply Address	: FC-34 (Unit of Manav Sevarth Trust), Mobile / Tel. No. : 9891183701	M D I	: 378.00 (kVA)	Meter Type	: 3PSK
	Email ID : maintenance@actionhospital.com	Power Factor	: 0.993	Supply Type	: HT(11KV)
District / Division	: Punjabi Bagh	Pole No.	: PJBNAH00S1	Bill No.	: 100039629459
Walking Sequence	: PJBKA1009A0AA	Meter Reading Status	: DL	Bill Basis	: Actual
Bill Month	: JUL-24	Cycle No.	: KA		
Bill Date	: 29-07-2024	Tariff Category	: Large Industrial Power		

Net Meter Consumption Details (Date Of Reading:)

Total Solar Generation Units	For the Billing Period			Cumulative Generation in FY			Solar Installation Details			Date of Installation		Capacity kWp			
I/F Units (If any)	Export Reading			Import Reading			Net Difference			Moderated Units			Excess Gen Unit	Shared by Prim	C/F Uni (If any)
	Normal	Peak	Offpeak	Normal	Peak	Offpeak	Normal	Peak	Offpeak	Normal	Peak	Offpeak			
(Consumption in the above table are in kWh/kVah, as applicable)															

Meter No	Units	Billed Consumption (Current)		Billed Consumption (Previous)		Multiplication Factor	Current Consumption	
		Date of Meter Reading(24:00Hrs)	Reading	Date of Meter Reading	Reading		Days	Units
29902016	KWH	26-07-2024	29269.57	27-06-2024	28975.30	600.00	29	176562.00
29902016	KW	26-07-2024	0.63			600.00		378.00
29902016	KVAH	26-07-2024	29540.95	27-06-2024	29244.69	600.00	29	177756.00
29902016	KVA	26-07-2024	0.63			600.00		378.00
29902016	KVAHP	26-07-2024	8202.46	27-06-2024	8127.19	600.00	29	45162.00
29902016	KVAHO	26-07-2024	6428.33	27-06-2024	6358.07	600.00	29	42156.00

Annexure-XXI

Photographs of covered material with

Green net



Annexure-XZIII

Copy of PUC certificate

Form 59

[See rules 115 (2)]

Pollution Under Control Certificate


Authorised By :
Government of Haryana

Date : **10/04/2024**
Time : **17:28:54 PM**
Validity upto : **09/04/2025**



Certificate SL. No. : HR07300180006968
 Registration No. : HR73B9350
 Date of Registration : 28/Mar/2024
 Month & Year of Manufacturing : January-2024
 Valid Mobile Number : *****6355
 Emission Norms : BHARAT STAGE VI
 Fuel : DIESEL
 PUC Code : HR0730018
 GSTIN :
 Fees :
 MIL observation : No

Vehicle Photo with Registration plate
60 mm x 30 mm

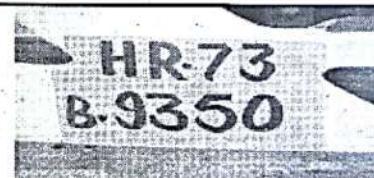

Sr. No.	Pollutant (as applicable)	Units (as applicable)	Emission limits	Measured Value (upto 2 decimal places)
1	2	3	4	5
Idling Emissions	Carbon Monoxide (CO)	percentage (%)		
	Hydrocarbon, (THC/HC)	ppm		
High Idling emissions	CO	percentage (%)		
	RPM	RPM	2500 ± 200	
Smoke Density	Lambda	-	1 ± 0.03	
	Light absorption coefficient	1/metre	0.7	0.26

This PUC certificate is system generated through the national register of motor vehicles and does not require any signature.

Note : 1. Vehicle owners to link their mobile numbers to registered vehicle by logging to <https://puc.parivahan.gov.in>

Authorised Signature with stamp of PUC operator

60mm x 20 mm

Form 59

[See rules 115 (2)]

Pollution Under Control Certificate


Authorised By :
Government of Haryana

Date : **10/04/2024**
Time : **17:21:23 PM**
Validity upto : **09/04/2025**



Certificate SL. No. : HR07300180006967
Registration No. : HR73B1288
Date of Registration : 07/Mar/2024
Month & Year of Manufacturing : January-2024
Valid Mobile Number : *****6355
Emission Norms : BHARAT STAGE VI
Fuel : DIESEL
PUC Code : HR0730018
GSTIN :
Fees :
MIL observation. : No

Vehicle Photo with Registration plate
60 mm x 30 mm

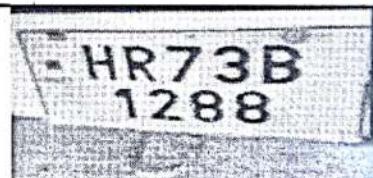

Sr. No.	Pollutant (as applicable)	Units (as applicable)	Emission limits	Measured Value (upto 2 decimal places)
1	2	3	4	5
Idling Emissions	Carbon Monoxide (CO)	percentage (%)		
	Hydrocarbon, (THC/HC)	ppm		
High Idling emissions	CO	percentage (%)		
	RPM	RPM	2500 ± 200	
Smoke Density	Lambda	-	1 ± 0.03	
	Light absorption coefficient	1/metre	0.7	0.35

This PUC certificate is system generated through the national register of motor vehicles and does not require any signature.

Note : 1. Vehicle owners to link their mobile numbers to registered vehicle by logging to <https://puc.parivahan.gov.in>

Authorised Signature with stamp of PUC operator
60mm x 20 mm



Scanned with OKEN Scanner

Form 59

[See rules 115 (2)]

Pollution Under Control Certificate

Authorised By :
Government of Haryana


Date : **10/04/2024**
Time : **17:39:28 PM**
Validity upto : **09/04/2025**



Certificate SL. No. : HR07300180006970
Registration No. : HR73B1655
Date of Registration : 07/Mar/2024
Month & Year of Manufacturing : January-2024
Valid Mobile Number : *****6355
Emission Norms : BHARAT STAGE VI
Fuel : DIESEL
PUC Code : HR0730018
GSTIN :
Fees :
MIL observation : No

Vehicle Photo with Registration plate

60 mm x 30 mm

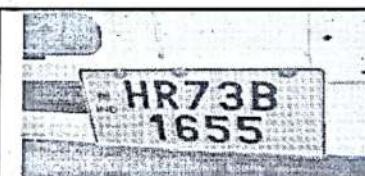

Sr. No.	Pollutant (as applicable)	Units (as applicable)	Emission limits	Measured Value (upto 2 decimal places)
1	2	3	4	5
Idling Emissions	Carbon Monoxide (CO)	percentage (%)		
	Hydrocarbon, (THC/HC)	ppm		
High Idling emissions	CO	percentage (%)		
	RPM	RPM	2500 ± 200	
Smoke Density	Lambda	-	1 ± 0.03	
	Light absorption coefficient	i/metre	0.7	0.23

This PUC certificate is system generated through the national register of motor vehicles and does not require any signature.

Note : 1. Vehicle owners to link their mobile numbers to registered vehicle by logging to <https://puc.parivahan.gov.in>

Authorised Signature with stamp of PUC operator
60mm x 20 mm

Form 59

[See rules 115 (2)]

Pollution Under Control CertificateAuthorised By :
Government of HaryanaDate : **10/04/2024**
Time : **17:33:31 PM**
Validity upto : **09/04/2025**

Certificate SL. No. : HR07300180006969
 Registration No. : HR73B6582
 Date of Registration : 09/Apr/2024
 Month & Year of Manufacturing : January-2024
 Valid Mobile Number : *****6355
 Emission Norms : BHARAT STAGE VI
 Fuel : DIESEL
 PUC Code : HR0730018
 GSTIN :
 Fees :
 MIL observation : No

Vehicle Photo with Registration plate
60 mm x 30 mm

Sr. No..	Pollutant (as applicable)	Units (as applicable)	Emission limits	Measured Value (upto 2 decimal places)
1	2	3	4	5
Idling Emissions	Carbon Monoxide (CO)	percentage (%)		
	Hydrocarbon, (THC/HC)	ppm		
High idling emissions	CO	percentage (%)		
	RPM	RPM	2500 ± 200	
Smoke Density	Lambda	-	1 ± 0.03	
	Light absorption coefficient	1/metre	0.7	0.22

This PUC certificate is system generated through the national register of motor vehicles and does not require any signature.

Note : 1. Vehicle owners to link their mobile numbers to registered vehicle by logging to <https://puc.parivahan.gov.in>Authorised Signature with stamp of PUC operator
60mm x 20 mm

Scanned with OKEN Scanner

Annexure-XXII

Photograph of PM 10 and PM 2.5 Sensor



GPS Map Camera

Delhi, Delhi, India

C-BLOCK, RITU APARTMENT, Cottage Enclave, Paschim Vihar, Delhi,

110063, India

Lat 28.674675°

Long 77.110954°



Call Us 19123 (TOLL FREE)

Bill of Supply for Electricity

Name : Action Cancer Hospital

Billing Address : FC-34 (Unit of Manav Sevath Trust),
Paschim Vihar DELHI 110063Supply Address : FC-34 (Unit of Manav Sevath Trust), Paschim Vihar DELHI
Mobile / Tel No. : 9891183701

Email ID : maintenance@actionhospital.com

District/Division : Punjabi Bagh

Walking Sequence : PJBKA1009A0AA

Bill Month : AUG-24

Bill Date : 28-08-2024

Sanctioned Load : 344.00 (kVA)

Contract Demand : 344.00 (kVA)

MDI : 384.00 (kVA)

Power Factor : 0.992

Pole No : PJBNH00S1

Meter Reading Status : DL

Cycle No. : KA

Tariff Category : Large Industrial Power

Due Date (देय तिथि):

12-09-2024

CA No. : 150112691

Energisation Date : 25-04-2012

Meter Type : 3PSK

Supply Type : HT(11KV)

Bill No. : 100010325042

Bill Basis : Actual

O.D. No. : R/24/10434934314

CCTV Tagged : No

Street Light Tagged : No

Wi-Fi Tagged : No

Meter No. (मीटर सं.)	Unit (प्रूनिट)	Billed Consumption (Current)		Billed Consumption (Previous)		Multiplication Factor (गुणांक)	Current Consumption (वर्तमान खपत)	
		Date of Meter Reading (मीटर रीडिंग की तिथि)	Reading (रीडिंग)	Date of Meter Reading (मीटर रीडिंग की तिथि)	Reading (रीडिंग)		Days (दिन)	Unit (प्रूनिट)
			Meter	Details in Annexure				

Billing Details (बिल का विवरण)

Current Period Charges (वर्तमान अवधि का शुल्क) (27-07-2024 to 27-08-2024)

"LET'S MOVE TO ELECTRIC VEHICLES FOR BETTER TOMORROW"

(अपने गाड़िया के लिए विद्युत वाहन की तरक़ित करें)

Fixed Charge="A" ₹ (स्थायी शुल्क)	Consumption Measured During (वर्षात अवधि मापे)	Energy Units Consumed / Billed (वर्षात / विनिट में शामिल विद्युत शुल्क)	Slabwise Energy Charge (रेल्वे आपारिंग विद्युत शुल्क)	Slabwise Power Purchase Adjustment Charge (लैंग आपारिंग विद्युत शुल्क)	Time of Day (TOD) Charge टॉइल शाफ़े (टॉइल) शुल्क	Surcharge @ 8% on (Energy Charge + Fixed Charge + Rebate) ="E" र	Electricity Tax @ 5% on Energy Charge, Surcharge on Energy Charge, PPAC amount & TOD Surcharge/Rate amount = "H" विद्युत शुल्क, विद्युत शुल्क के अधिकार, पीपीएस रात्रि रेट टॉइल की अधिकार, पूर्ण र. 5% विद्युत कर)	Total Amount (K = A+B+C+D+E+ F+G+H+I+J) ₹ (कुल राशि)
Units Rate ₹ (प्रूनिट र)	Amount = "B" ₹ (राशि)	PPAC % on B (B पर पीपीएस प्रतिशत)	PPAC Amount = "C" ₹ (पीपीएस राशि)	TOD % on "B" (B में टॉइल प्रतिशत)	TOD Surcharge/ Rebate Amount = "D" ₹ (टॉइल वार्षिक विद्युत रेट राशि)			
99096.77 1.03 Mth(s)	NORMAL(S)	99090.00	7.75	767947.50	35.83	275155.58		125705.19
	OFFPEAK(S)	45444.00	7.75	352191.00	35.83	100952.02	(20.00) (70438.20)	Pension Surcharge @ 7% on Energy Charge + Fixed Charge + Rebate) = "F" 109992.04
PPAC on Fixed Charge = "G" ₹	PEAK(S)	50328.00	7.75	390042.00	35.83	167702.46	20.00 78008.40	TCS Amount ₹ "I" Base Amt. Surcharge Other Charges "J" 3094.25 CCTV Bill Amount
35506.37								
CCTV Units								
0.00								
Street Light Units								
Wi-Fi Units								
Total Units = 194862		Total (B) = 1510180.50		Total (C) = 543810.08		Total (D) = 7570.20		0.00



Past Dues / Refunds / Subsidy (पिछला बकाया / वापसी / सब्सिडी) Consumer registered under GST may submit its GSTIN at concerned division

Provisional Bill Refunds/(वापसी)	Arrears (बकाया)	late Payment Surcharge (LPSC)	Total Charges Payable (कुल देय शुल्क)	Rebate / Subsidy (वापसी / सब्सिडी)	Net Amount Payable (कुल देय राशि)
Refund Unit	Refund Amount ₹	Period to which it relates (जिस अवधि से संबंध है)	रिये से मुगातान पर अधिकार)		
0			2540829.95	(61846.82)/	2478983.13
Amount not immediately payable, if any. (राशि जो त्रुट देय नहीं है, यदि हो तो)		BG Security Deposit ₹			
₹		BG Expiry Date			
Service line cum Development Charges paid (मुगाता या वापसी लाइन एवं डेवलपमेंट शुल्क)	₹ 0.00	Cash Security Deposit	₹ 648000.00		
Interest accrued for FY 2023-24			₹ (48941.61)		
100010013625 (generated for the period 28-03-2024 to 27-04-2024)					
Interest for FY 2024-25		will be adjusted in your first bill to be generated in FY	2025-26		

Bill Amount Payable
(बिल देय राशि)

₹ 2478980.00

Due Date of Payment
(मुगातान देय तिथि) 12-09-2024If payment is made after the due date, LPSC for the delay, shall be charged in the next bill.
(नियत तिथि के बाद मुगातान करने पर इस लिए विद्युत अगले बिल में लागी एसरी जोड़ दिया जाएगा.)

Last payment ₹ 2252405.00 received on 09-08-2024 . Payment accounted upto 25-08-2024 .

Consumption History (वर्षात का विवरण) :

Period	No. of Days	Units (kWh/kVah)	Total Bill Payable	Bill Basis
From	To			
28-06-2024	26-07-2024	29	177756	2254660.00 Actual
27-05-2024	27-06-2024	32	200550	254661.00 Actual
28-04-2024	26-05-2024	29	170832	2170460.00 Actual
28-03-2024	27-04-2024	31	177108	2195530.00 Actual
28-02-2024	27-03-2024	29	143682	330470.00 Actual
28-01-2024	27-02-2024	31	147828	1886820.00 Actual

(This bill is computer generated, hence does not require any signature.)

Contact Details: (संपर्क संबंधी विवरणः)

Nearest Payment Centre
1ST FLOOR, A-BLOCK, BSES BHAWAN NEHRU PLACE
NEW DELHI 110019 (Tel No: 49209489)Business Manager : MR NISHANT SRIVASTAVA (49209489)
Commercial Officer : MR BHUPESH DHASMANA (49209485)

Tariff structure

Categories	Description	Fixed/Demand Charge		Energy Charge					Categories	Description	Fixed/Demand Charge	Energy Charge	Temporary							
		Load(kW)	(₹/month)	0-200 Units	201-400 Units	401-800 Units	801-1200 Units	Above 1200 Units					Categories	Fixed Charge	Energy Charge					
Domestic	Individual connections: Domestic Light / Mixed Domestic Power; Farm House upto 21kW	Upto 2kW	20/kW/mth	₹ 3.00	₹ 4.50	₹ 6.50	₹ 7.00	₹ 8.00	Agriculture	Agriculture	125/kW/mth	₹ 1.50/kWh	Domestic including GHS	Same as relevant category	Same as relevant category					
		>2kW to 5kW	50/kW/mth						Mushroom	Mushroom Cultivation upto 100 kW	200/kW/mth	₹ 3.50/kWh								
		>5kW to 15kW	100/kW/mth						Public Utility	Delhi Jal Board, DMRC, Public Lighting etc.	250/kVA/mth	₹ 6.25/kVAh								
	Single point supply at 11kV for GHS- Domestic Lighting / Fan and Power	>15kW to 25kW	200/kW/mth	₹ 250/kW/mth					Delhi International Airport Limited (DIAL)	250/kVA/mth	₹ 7.75/kVAh	₹ 7.75/kVAh	Thresholders during the threshing season	MCD E.Tax of ₹ 270 / conv/mth	Flat Rate - ₹ 5400/mth					
		>25kW	250/kW/mth						Advertisements and Hoardings	250/kVA/mth	₹ 8.50/kVAh	₹ 8.50/kVAh								
Non-Domestic	Shopkeepers	Upto 3kVA	250 kVA/mth	₹ 8.00/kVAh					Charging Stations for E-Rickshaw/ E-Vehicle on Single Point Delivery			LT	₹ 4.50/kWh	All other including construction	Same as relevant category	1.30 times of relevant category of tariff				
	Other Non-Domestic	>3kVA		₹ 8.50/kVAh								HT	₹ 4.00/kVAh							
Industrial	Industrial	250/kVA/mth		₹ 7.75/kVAh																

Schedule of Time of Day (TOD) Tariff

Month	Peak hours	Surcharge on Energy Charges	Off-Peak hours	Rebate on Energy Charges
May-September	1400-1700 hrs and 2200-0100 hrs	20%	0400-1000 hrs	20%

For other than peak & off-peak hours normal energy charges are applicable. Mandatory for >10kW / 11kVA other than Domestic. Optional for 3 Phase Domestic Consumers.

Customer Complaint Management:

For any query / complaint, you may contact us using any of the following options:

- Call Center No. 19123 (24x7 Toll Free)
- Customer Care Centers (Timing Mon to Fri : 9:30 AM to 5:30 PM & Sat: 9:30 AM to 1:00 PM)
- Email - brpl.customercare@relianceada.com
- www.beesoftlhi.com

Escalation matrix for complaints:

1. In case you are not satisfied with the resolution of your query / complaint, you may contact the below listed BRPL officials-
 - Customer Care Officer (Timing 09:15 AM to 3:15 PM)
 - Business Manager (between 10AM to 11AM on any working day)
 - Circle Head (with prior appointment)

2. Head-Customer Care

2. Head-Customer Care,
BSES Rajdhani Power Limited,
BSES Bhawan, Nehru Place, New Delhi-110019
Email: bmhhead_cxstomerservice@reliancepsdca.com

3. Consumer Grievance Redressal Forum (CGRF): In case you are not satisfied with the response of the above, you may approach CGRF-BRPL, Sub-station Building, Sector 10, Mohali, Punjab 160017.

Sector-V, Pushp Vihar, New
Email: certbnl@gmail.com

4. **Electricity Ombudsman:** An appeal against the CGRF order may be filed with Electricity Ombudsman, B-53, Paschim Marg, Vasant Vihar, New Delhi-110057.

Paying your electricity bill (Bill payment information)

Payment Options

Payment Options

1. You can pay your bill by cash /cheque/ DD /Pay Order up to Rs 4000/- and for amount more than Rs 4000/- by cheque/DD/Pay Order.
2. According to DERC's recent tariff order, it is mandatory for all consumers (except Domestic, Agriculture & Mushroom Cultivation) to pay their monthly electricity bills exceeding Rs 20,000/- through digital modes w.e.f October 1, 2021.
3. Drop your cheque in our drop boxes at various RWA offices and at BPLC Counters. The list of drop boxes is available on the website.
4. Bill payment centres are open from 0900 hrs to 1500 hrs, from Monday to Saturday.

5. Bill payment upto Rs 50,000/- can be paid in

Points to remember while paying your bill


1. Please pay your electricity bill only on obtaining computer generated bill.
2. Do not make payment to unauthorized agencies / touts.
3. In case your cheque is returned unpaid / dishonored by bank, cheque return charges (presently Rs. 200 + GST, as applicable) will be imposed and action will be taken under Section 138 of the Negotiable Instruments Act 1881.
4. Convenience fee on card swipe and online payments is applicable on payment amount above Rs 5000/- is to be borne by the consumer. For charge details, kindly refer to the payment method section.

Pay your electricity bills conveniently by any of the following options:

Payment Options			Timings
Digital Online Payments	<ul style="list-style-type: none"> • Bharat BillPay (BBPS) - Pay option at all BBPS enabled Payments App (Paytm etc.) (Zero Charges) • QR code on bill - Powered by BOB • BSEST Mobile App / Website - UPI, IMPS, Internet Banking, Credit / Debit Cards, Mobile Wallets, QR Code • RTGS / NEFT / ECS 		24x7
Caah Counters	BRPL Cash Counters: <ul style="list-style-type: none"> • Cash - Upto Rs. 400/- • Cheque & Demand Draft- No amount limit for Domestic, Agriculture & Mushroom Cultivation category consumers and for other category consumers maximum allowed is upto Rs. 20,000/- • Credit / Debit Cards • UPI 		9AM - 5PM
24x7 self payment Kiosk	24x7 self payment Kiosks by cards, each division office		24x7
Bank Branches	<p>Bank of Baroda and PNB</p> <ul style="list-style-type: none"> • Cash - Upto Rs. 50,000/- only for Domestic, Agriculture & Mushroom Cultivation category consumers and for other category consumers maximum permissible limit is upto Rs. 20,000/- • Cheque & Demand Draft- No amount limit for Domestic, Agriculture & Mushroom Cultivation category consumers and for other category consumers maximum allowed is upto Rs. 20,000/- • Transfer by account holders 		Bank Timing
Cheque Drop Boxes	Select RWA locations	Cheque & Demand Draft - No amount limit for Domestic, Agriculture & Mushroom Cultivation category consumers and for other category consumers maximum allowed is upto Rs. 20,000/-	24x7
Cheque by Post	To BRPL division offices	Cheque & Demand Draft - No amount limit for Domestic, Agriculture & Mushroom Cultivation category consumers and for other category consumers maximum allowed is upto Rs. 20,000/-	9AM - 5PM
			24x7

For payment of energy bill		
Details	SBI Bank	Axis Bank
Beneficiary Name	BSES Rajdhani Power Limited	BSES Rajdhani Power Limited
Beneficiary A/C No.	SBIBRE (Fixed) + 9 Digit Customer Account Number (Variable)	VBRE(Fixed) + 9 digit customer account number (Variable) (For eg. VBRE123456789)
IFSC Code	SBIN0004266	UTIBOCCH274
Bank Name	State Bank of India	Axis Bank Ltd
Branch Address	State Bank of India, CMP Centre	9th floor, Solaris C wing, Opp L&T gate no. 5, Sakhi Vihar Road, Powai, Mumbai-400072

The connection shall be liable for disconnection on non-payment of all dues (including arrears of previous bill(s) by due date, after notice as per Section 56(1) of the Electricity Act, 2003. Charges for reconnection - Single phase ₹200, Three phase ₹500.)



- Cheque should not be post dated.
- Write your telephone number on backside of the cheque.
- Cheque should be account payee and payable at Delhi.
- Do not staple. Only clip the cheque to payment slip.

Meter Details Annexure

Name	: Action Cancer Hospital	Sanctioned Load	: 344.00 (kVA)	CA No.	: 150112691
Billing Address	: FC-34 (Unit of Manav Sevarth Trust), Paschim Vihar, DELHI 110063	Contract Demand	: 344.00 (kVA)	Energisation Date	: 25-04-2012
		M D I	: 384.00 (kVA)	Meter Type	: 3PSK
		Power Factor	: 0.992	Supply Type	: HT(11KV)
		Pole No.	: PJBHT00S1	Bill No.	: 100010325042
Supply Address	FC-34 (Unit of Manav Sevarth Trust), Mobile / Tel. No. : 9891183701	Meter Reading Status	: DL	Bill Basis	: Actual
Email ID	: maintenance@actionhospital.com	Cycle No.	: KA		
District / Division	: Punjabi Bagh	Tariff Category	: Large Industrial Power		
Walking Sequence	: PJBKA1009A0AA				
Bill Month	: AUG-24				
Bill Date	: 28-08-2024				

Net Meter Consumption Details (Date Of Reading:)

Total Solar Generation Units	For the Billing Period			Cumulative Generation in FY			Solar Installation Details			Date of Installation		Capacity kWp			
/F Units (If any)	Export Reading			Import Reading			Net Difference			Moderated Units			Excess Gen Unit	Shared by Prim	C/F Uni (If any)
	Normal	Peak	Offpeak	Normal	Peak	Offpeak	Normal	Peak	Offpeak	Normal	Peak	Offpeak			

(Consumption in the above table are in kWh/kVah, as applicable)

Meter No	Units	Billed Consumption (Current)		Billed Consumption (Previous)		Multiplication Factor	Current Consumption	
		Date of Meter Reading(24:00Hrs)	Reading	Date of Meter Reading	Reading		Days	Units
29902016	KWH	27-08-2024	29591.67	26-07-2024	29269.57	600.00	32	193260.00
29902016	KW	27-08-2024	0.64			600.00		384.00
29902016	KVAH	27-08-2024	29865.72	26-07-2024	29540.95	600.00	32	194862.00
29902016	KVA	27-08-2024	0.64			600.00		384.00
29902016	KVAHP	27-08-2024	8286.34	26-07-2024	8202.46	600.00	32	50328.00
29902016	KVAHO	27-08-2024	6504.07	26-07-2024	6428.33	600.00	32	45444.00



Call Us 19123 (TOLL FREE)

Bill of Supply for Electricity

Name: Action Cancer Hospital

Billing Address: FC-34 (Unit of Manav Sevith Trust),
Paschim Vihar, DELHI 110063

Mobile / Tel No: 9891183701

Email ID: maintenance@actionhospital.com

District/Division: Panjab Bagh

Walking Sequence: PJBKA1009A0AA

Bill Month: SEP-24

Bill Date: 28-09-2024

Sanctioned Load: 344.00 (kVA)

Contract Demand: 344.00 (kVA)

MDI: 378.00 (kVA)

Power Factor: 0.989

Pole No: PJBNNH00S1

Meter Reading Status: DL

Cycle No: KA

Tariff Category: Large Industrial Power

Due Date (देय तिथि):

14-10-2024

CA No: 150112691

Energisation Date: 25-04-2012

Meter Type: 3PSK

Supply Type: HT (11KV)

Bill No: 100069655862

Bill Basis: Actual

O.D. No: R/24/10438063457

CCTV Tagged: No

Street Light Tagged: No

Wi-Fi Tagged: No

Meter No. (मीटर सं.)	Unit (यूनिट)	Billed Consumption (Current)		Billed Consumption (Previous)		Multiplication Factor (गुणांक)	Current Consumption (कर्तमान रकम)	
		Date of Meter Reading (मीटर रीडिंग की तिथि)	Reading (रीडिंग)	Date of Meter Reading (मीटर रीडिंग की तिथि)	Reading (रीडिंग)		Days (दिन)	Unit (यूनिट)
		Meter		Details in Annexure				

Billing Details (बिल का विवरण)

Current Period Charges (वर्तमान अवधि का शुल्क) (28-08-2024 to 25-09-2024)

"LET'S MOVE TO ELECTRIC VEHICLES FOR BETTER TOMORROW
(उत्तम भवित्व के लिए विद्युत वाहन की पहल बदलाव करें)"

Fixed Charge="A" ₹ (व्यापारी शुल्क)	Consumption Measured During (बिल अवधि माप)	Energy Units Consumed / Billed (व्यापार / बिल में विद्युत रुपये)	Slabwise Energy Charge (स्लेब अवधि विद्युत शुल्क)	Slab-wise Power Purchase Adjustment Charge (स्लेब अवधि विद्युत का संबंधित शुल्क)	Time of Day (TOD) Charge टोड चार्ज (दिनांक शुल्क)	Surcharge @ 8% on (Energy Charge + Fixed Charge + Rebate) = "E" विद्युत शुल्क + नियंत्रण शुल्क + फिक्स्ड चार्ज + रिबेट का 8% विद्युत शुल्क	Electricity Tax @ 5% on Energy Charge, Surcharge on Energy Charge, PPAC amount & TOD Surcharge/Rebate amount = "H" विद्युत शुल्क, विद्युत शुल्क के विविध विविध राशि विद्युत शुल्क का 5% विद्युत शुल्क	Total Amount (K = A+B+C+D+E+F+G+H+I+J) कुल राशि
90943.55 0.96 MWh(s)	NORMAL(S)	93900.00	7.75	727725.00	35.83	260743.87	118408.43	99901.57
OFF PEAK(S)		43746.00	7.75	339031.50	35.83	97179.99 (20.00)	(67806.30)	103607.38
PPAC on Fixed Charge = "G" ₹	PEAK(S)	46578.00	7.75	360979.50	35.83	155206.74 20.00	72195.90	TCS Amount ₹ "I"
32585.08								Base Amt. Surcharge
CCTV Units 0.00								Other Charges "J"
Street Light Units								2454.03
Wi-Fi Units								CCTV Bill Amount
Total Units = 184224			Total (B) = 1427736.00	Total (C) = 513130.60	Total (D) = 4389.60		0.00	



Past Dues / Refunds / Subsidy (पिछला बकाया / वापसी / सब्सिडी) Consumer registered under GST may submit its GSTIN at concerned division

Provisional Bill Refunds/(वापसी)		Arrears (बकाया)		Late Payment Surcharge (LPSC)		Total Charges Payable (कुल देय शुल्क)	Rebate / Subsidy* (छूट / सब्सिडी)	Net Amount Payable (कुल देय राशि)
Refund Unit	Refund Amount (राशि)	Amount (राशि)	Period to which it relates (जिस अवधि से संबंधित है)	(दिन से मुग्धता पर अधिकार)	(दिन से मुग्धता पर अधिकार)			
0	2482.13		Since AUG-24			2395638.37	(58357.69)/	2337280.68
Amount not immediately payable, if any. (राशि जो तुरंत देय नहीं है, यदि हो तो)				BG Security Deposit BG Expiry Date				
Service line cum Development Charges paid (मुग्धता किया गया सार्विकलाइन एवं डेवलपमेंट शुल्क)		₹ 0.00		Cash Security Deposit	₹ 648000.00			
Interest accrued for FY 2023-24, already adjusted in bill No. 100010013625 (generated for the period 28-03-2024 to 27-04-2024)					₹ (48941.61)			
Interest for FY 2024-25 will be adjusted in your first bill to be generated in FY 2025-26								

Last payment ₹ 2478501.00 received on 03-09-2024. Payment accounted upto 25-09-2024

Consumption History (व्यापार का विवरण) :

Period		No. of Days	Units (kWh/kVAh)	Total Bill Payable	Bill Basis
From	To				
27-07-2024	27-08-2024	32	194862	2478980.00	Actual
28-06-2024	26-07-2024	29	177756	2254660.00	Actual
27-05-2024	27-06-2024	32	200550	2546610.00	Actual
28-04-2024	26-05-2024	29	170832	2170460.00	Actual
28-03-2024	27-04-2024	31	177108	2195530.00	Actual
28-02-2024	27-03-2024	29	143682	330470.00	Actual

(This bill is computer-generated, hence does not require any signature.)

30 SEP 2024

IMPORTANT MESSAGE (महत्वपूर्ण सूचना)

Contact Details: (संपर्क संबंधी विवरणः)

Nearest Payment Centre
1ST FLOOR, A-BLOCK, BSES BHAWAN NEHRU PLACE
NEW DELHI 110019 (Tel No: 49209489)Business Manager : MR NISHANT SRIVASTAVA (49209489)
Commercial Officer : MR BHUPESH DHASMANA (49209485)

Meter Details Annexure

Name	Action Cancer Hospital		Sanctioned Load	: 344.00 (kVA)	CA No.	: 150112691
Billing Address	FC-34 (Unit of Manav Sevarth Trust), Paschim Vihar DELHI 110063		Contract Demand	: 344.00 (kVA)	Energisation Date	: 25-04-2012
Supply Address	FC-34 (Unit of Manav Sevarth Trust), Mobile / Tel. No. 9891183701		M D I	: 378.00 (kVA)	Meter Type	: 3PSK
			Power Factor	: 0.989	Supply Type	: HT(11KV)
			Pole No.	: PJBHT00S1	Bill No.	: 100069655862
			Meter Reading Status	: DL	Bill Basis	: Actual
			Cycle No.	: KA		
			Tariff Category	Large Industrial Power		
Mobile / Tel. No.						
Email ID	maintenance@actionhospital.com					
District / Division	Punjabi Bagh					
Walking Sequence	PJBKA1009A0AA					
Bill Month	SIP-24					
Bill Date	28-09-2024					

Net Meter Consumption Details (Date Of Reading:)

Total Solar Units	Generation During the Billing Period			Generation During Current FY (APR To MAR)			Solar Installation Details			Date of Installation	Capacity kWp			
/F Units (If any)	Export Reading			Import Reading			Net Difference			Moderated Units			Excess Gen Unit Prim	Shared by C/F Unit (If any)
	Normal	Peak	Offpeak	Normal	Peak	Offpeak	Normal	Peak	Offpeak	Normal	Peak	Offpeak		

(Consumption in the above table are in kWh/kVAh, as applicable)

Meter No	Units	Billed Consumption (Current)		Billed Consumption (Previous)		Multiplication Factor	Current Consumption	
		Date of Meter Reading(24:00Hrs)	Reading	Date of Meter Reading	Reading		Days	Units
29902016	KWH	25-09-2024	29895.20	27-08-2024	29591.67	600.00	29	182118.00
29902016	KW	25-09-2024	0.63			600.00		378.00
29902016	KVAH	25-09-2024	30172.76	27-08-2024	29865.72	600.00	29	184224.00
29902016	KVA	25-09-2024	0.63			600.00		378.00
29902016	KVAHP	25-09-2024	8363.97	27-08-2024	8286.34	600.00	29	46578.00
29902016	KVAHO	25-09-2024	6576.98	27-08-2024	6504.07	600.00	29	43746.00

Annexure-XVIII

Photograph of DG Set

Photographs of DG Sets



Annexure-XXIV

Copy of Newspaper Advertisement

NATIONAL
CONSUMER
DISPUTES
REDRESSAL
COMMISSION
Upbhokta Nyay
Bhawan, 'F' Block,
General Pool Office
Complex, INA, New
Delhi - 110023
CONSUMER
COMPLAINT
NO. 1976 OF 2017
Ajay Kumar
Manocha and Ors.
...Complainant(s)

Versus

M/s Aims Max
Gardenia
Developers

...Opp. Party(s)

The Purchasers/
Allottees of the
Residential Flats in
"Golf City / Eco
City" Comprising of
Towers 13 and 11
Towers in Plot No. 8
& 11 Respectively +
1 Community
Center, Located in
Sector 75, Noida,
UP Developed By
M/s. Aims Max
Gardenia
Developers Pvt.
Ltd. and ANR.

Whereas the above
Complainants have,
through Mr.
Sudeepa Kumar
Pal, Advocate, A-
1102, Prateek
Edifice, Sector-107,
Noida-201301,
Mobile:
9899399424 filed the
captioned Consumer
Complaint before the
Hon'ble National
Consumer Disputes
Redressal
Commission, New
Delhi on behalf
and/or for the benefit
of all the consumers
who have either
booked or have been
allotted flats, in the
project namely

"GOLF CITY / ECO
CITY"
COMPRISING OF
TOWERS 13 AND 11
TOWERS IN PLOT
NO. 8 AND 11
RESPECTIVELY + 1
COMMUNITY
CENTER,
LOCATED IN
SECTOR 75,
NOIDA, UP being
developed by the
Opposite Party
named above for
redressal of their

18.07.2019 is
pleased to direct
issue of notice of the
institution of the
above captioned
complaint to all the
consumers having
same interest in the
matter. Accordingly,
all allottees of the
above referred
Project having the
same grievance
against the Opposite
Party, may appear
before the
Commission in
person or through an
Advocate /
Authorized
Representative on
28.11.2019 at 10:30
a.m. They can
inspect the file of the
aforementioned
complaint in the
office of the Counsel
for the
Complainant(s) and
apply for being
impleaded as a party
to the complaint.
They may also note
that the decision of
the Commission in
the captioned
complaint will be
binding on all the
consumers on
whose behalf and/or
for whose benefit the
complaint is
instituted.

Dated, this 25th day
of September 2019
By order
S. Hanumath Rao
Joint Registrar

Sri Balaji
Action Medical Institute
PUBLIC NOTICE
Sri Balaji Action Medical Institute is
pleased to inform that the
"Environmental Clearance" at FC-34,
A-4 Paschim Vihar Delhi" has been
accorded with Environmental
Clearance vide Ref. No. F No 21-
7/2019-1A-III dated 18th October,
2019 from Ministry of Environment
& Forests, Govt. of India. The
copies of the clearance letters are
available with the Ministry of
Environment & Forests and can also
be seen on their website:
www.envfor.nic.in
Lala Munni Lal Mange Ram
Charitable Trust

Action Cancer Hospital
PUBLIC NOTICE
Action Cancer Hospital is pleased
to inform that the "Environmental
Clearance" at FC-34, A-4 Paschim
Vihar Delhi" has been accorded
with Environmental Clearance vide
Ref. No. F.No 21-8/2019-1A-III
dated 06th August, 2019 from
Ministry of Environment & Forests,
Govt. of India. The copies of the
clearance letters are available with
the Ministry of Environment &
Forests and can also be seen on

Youths save girl from assaulter, then rape her; 4 arrested

Shikha.Salaria@timesgroup.com

Noida: Her trust was breached, not once but twice in a matter of minutes. A youth she had accompanied after being promised a job tried to force himself on her. Relieved she was when two men came to her rescue, but three minutes is all that it took the rescuers to turn assaulters.

A girl — possibly 16 — was allegedly gang-raped by as many as five men near a green belt in Sector 63, minutes after she had been rescued by them from another assaulter. The alleged gang rape took place on Wednesday evening in an isolated green stretch in Sector 63, barely 400 metres from the Bahlolpur police outpost.

The girl had been brought there by a 21-year-old man called Ravi, who had promised to land her a job in the export company where he worked as a clerk. The girl, youngest of five sisters, is from a poor family and lost her father as a child.

An FIR registered by her family in Phase 3 police station said Ravi tried to kiss the girl and force himself on her when she raised an alarm. "Hearing her cries, two men arrived and beat up Ravi, forcing him to flee. Within a few minutes, they gang-raped the girl, and called three of their friends. They, too, took turns to rape her," the FIR read.

The girl's family is poor, which is why she was in dire need of a job. "We could not even afford her studies. Her father passed away when she was

just one. I work in a private firm and somehow manage to feed my children," the girl's mother said.

The girl was earlier employed with a packaging firm in Noida and had recently lost her job. "She was down with viral and her platelet count was low. She could not attend office for 15 days. When she went to join work, she was asked not to come," her mother said.

**The girl was allegedly
gang-raped by as many
as five men near a green
belt in Sector 63,
minutes after she had
been rescued by them
from another assaulter**

Noida police chief Vaibhav Krishna said the group of youths who rescued her from Ravi first beat her up, gagged her and then took turns to rape her. "They were two of them. They informed three others, who, too, raped her," he said.

According to the medical report, the girl has suffered contusions and abrasions on the back and arms.

However, there was confusion over the girl's age. While the girl's family claimed she was 16, her Aadhaar mentioned 21. Currently, the cops are treating it as a case of rape of an adult. SP (City) Vineet Jaiswal said an age determination test had been conducted on Friday. Four persons, including Ravi, have been arrested.

DT-16/11/2019

Sewage plants to miss NGT's 2020 target

Paras.Singh@timesgroup.com

New Delhi: Though National Green Tribunal (NGT) has fixed December 2020 as the deadline for completing work on four under-construction sewage treatment plants (STP) in the city, it's unlikely that the target would be met.

Delhi Jal Board CEO Nikhil Kumar said that work on only two of the STPs would be completed by the deadline, while the other two plants would become operational by 2022. The plants are located at Rithala, Kondli, Okhla and Coronation Pillar.

Once operational, these plants would have a combined capacity to treat 275 million gallons of sewage per day. They form a key component of the Yamuna Action Plan by significantly increasing wastewater treatment capacity. Currently, Delhi has the capacity to treat 507 MGD of sewage.

Kumar submitted that commissio-

**DJB clears
various plans
to recharge
groundwater**

TIMES NEWS NETWORK

New Delhi: Besides unveiling the new septage collection scheme, Delhi Jal Board in its 150th board meeting on Friday cleared a host of projects aimed at reviving lakes, improving the green cover and groundwater levels in south Delhi.

The projects include revival of four completely dry lakes using phytotrid technology, creation of a 34-acre wetland near Timarpur, oxidation ponds and laying of pumping infrastructure to carry treated wastewater from Okhla to Bhatti Mines for groundwater recharge.

Four waterbodies at Rasulpur, Bindapur, Dhichau Kalan and Tikri Kalan would be rejuvenated using phytotrid treatment technology. The wastewater treatment plants would be

...Complainant(s) Versus M/s Aims Max Gardenia Developers ...Opp. Party(s) The Purchasers/ Allotees of the Residential Flats in "Golf City / Eco City" Comprising of Tov. 13 and 11 Towers in Plot No. 8 & 11 Respectively + 1 Community Center, Located in Sector 75, Noida, UP Developed By M/s. Aims Max Gardenia Developers Pvt. Ltd. and ANR.

Whereas the above Complainants have, through Mr. Sudeepa Kumar Pal, Advocate, A-1102, Prateek Edifice, Sector-107, Noida-201301, Mobile: 9899399424 filed the complaint before the Hon'ble National Consumer Disputes Redressal Commission, New Delhi on behalf and/or for the benefit of all the consumers who have either booked or have been allotted flats, in the project namely "GOLF CITY / ECO CITY" comprising of TOWERS 13 AND 11 TOWERS IN PLOT NO. 8 AND 11 RESPECTIVELY + 1 COMMUNITY CENTER, LOCATED IN SECTOR 75, NOIDA, UP being developed by the Opposite Party named above for redressal of their

before the Commission in person or through an Advocate / Authorized Representative on 28.11.2019 at 10:30 a.m. They can inspect the file of the aforementioned complaint in the office of the Counsel for the Complainant(s) and apply for being impleaded as a party to the complaint. They may also note that the decision of the Commission in the captioned complaint will be binding on all the consumers on whose behalf and/or for whose benefit the complaint is instituted.

Dated, this 25th day of September 2019

By order
S. Hanumatha Rao
Joint Registrar

himself on her. Relieved she was when two men came to her rescue, but three minutes is all that it took the rescuers to turn assaulters.

A girl — possibly 16 — was allegedly gang-raped by as many as five men near a green belt in Sector 63, minutes after she had been rescued by them from another assaulter. The alleged gang rape took place on Wednesday evening in an isolated green stretch in Sector 63, barely 400 metres from the Baholpur police outpost.

The girl had been brought there by a 21-year-old man called Ravi, who had promised to land her a job in the export company where he worked as a clerk. The girl, youngest of five sisters, is from a poor family and lost her father as a child.

An FIR registered by her family in Phase 3 police station said Ravi tried to kiss the girl and force himself on her when she raised an alarm. "Hearing her cries, two men arrived and beat up Ravi, forcing him to flee. Within a few minutes, they gang-raped the girl, and called three of their friends. They, too, took turns to rape her," the FIR read.

The girl's family is poor, which is why she was in dire need of a job. "We could not even afford her studies. Her father passed away when she was

down with viral and her platelet count was low. She could not attend office for 15 days. When she went to join work, she was asked not to come," her mother said.

The girl was allegedly gang-raped by as many as five men near a green belt in Sector 63, minutes after she had been rescued by them from another assaulter

Noida police chief Vaibhav Krishna said the group of youths who rescued her from Ravi first beat her up, gagged her and then took turns to rape her. "They were two of them. They informed three others who, too, raped her," he said.

According to the medical report, the girl has suffered contusions and abrasions on the back and arms.

However, there was confusion over the girl's age. While the girl's family claimed she was 16, her Aadhar mentioned 21. Currently, the cops are treating it as a case of rape of an adult. SP (City) Vineet Jaiswal said an age determination test had been conducted on Friday. Four persons, including Ravi, have been arrested.

DT-16/11/2019

PUBLIC NOTICE
Sri Balaji Action Medical Institute is pleased to inform that the "Environmental Clearance" at FC-34, A-4 Paschim Vihar Delhi" has been accorded with Environmental Clearance vide Ref. No. F No 21-7/2019-1A-III dated 18th October, 2019 from Ministry of Environment & Forests, Govt. of India. The copies of the clearance letters are available with the Ministry of Environment & Forests and can also be seen on their website: www.envfor.nic.in
Lala Munni Lal Mange Ram Charitable Trust

PUBLIC NOTICE
Action Cancer Hospital is pleased to inform that the "Environmental Clearance" at FC-34, A-4 Paschim Vihar Delhi" has been accorded with Environmental Clearance vide Ref. No. F.No 21-8/2019-1A-III dated 06th August, 2019 from Ministry of Environment & Forests, Govt. of India. The copies of the clearance letters are available with the Ministry of Environment & Forests and can also be seen on

Sewage plants to miss NGT's 2020 target

Paras.Singh@timesgroup.com

New Delhi: Though National Green Tribunal (NGT) has fixed December 2020 as the deadline for completing work on four under-construction sewage treatment plants (STP) in the city, it's unlikely that the target would be met.

Delhi Jal Board CEO Nikhil Kumar said that work on only two of the STPs would be completed by the deadline, while the other two plants would become operational by 2022. The plants are located at Rithala, Kondli, Okhla and Coronation Pillar.

Once operational, these plants would have a combined capacity to treat 275 million gallons of sewage per day. They form a key component of the Yamuna Action Plan by significantly increasing wastewater treatment capacity. Currently, Delhi has the capacity to treat 607 MGD of sewage.

Kumar submitted that commis-

DJB clears various plans to recharge groundwater

TIMES NEWS NETWORK

New Delhi: Besides unveiling the new septic collection scheme, Delhi Jal Board in its 150th board meeting on Friday cleared a host of projects aimed at reviving lakes, improving the green cover and groundwater levels in south Delhi.

The projects include removal of four completely dry lakes using phytoremediation technology, creation of a 34-acre wetland near Timarpur, oxidation ponds and laying pumping infrastructure to carry treated wastewater from Okhla to Bhatti Maka for groundwater recharge.

Four waterbodies at Rastpur, Bindapur, Dhichau Kalan and Tikri Kalan would be rejuvenated using phytoremediation technology. The wastewater treatment plants would

Annexure-XXV

Receiving of Previous Compliance

Report of June 2024

Your (**Environment Clearance**) application has been **Submitted** with following details

Proposal No	1A/DL/MIS/91893/2019
Compliance ID	34937504
Compliance Number(For Tracking)	EC/M/COMPLIANCE/34937504/2024
Reporting Year	2024
Reporting Period	01 Jun(01 Oct - 31 Mar)
Submission Date	09-05-2024
IRO Name	
IRO Email	
State	
IRO Office Address	
Note:- SMS and E-Mail has been sent to , with Notification to Project Proponent.	

